


ALL MEASUREMENT ARE TAKEN FROM OUTSIDE OF RIM WALL

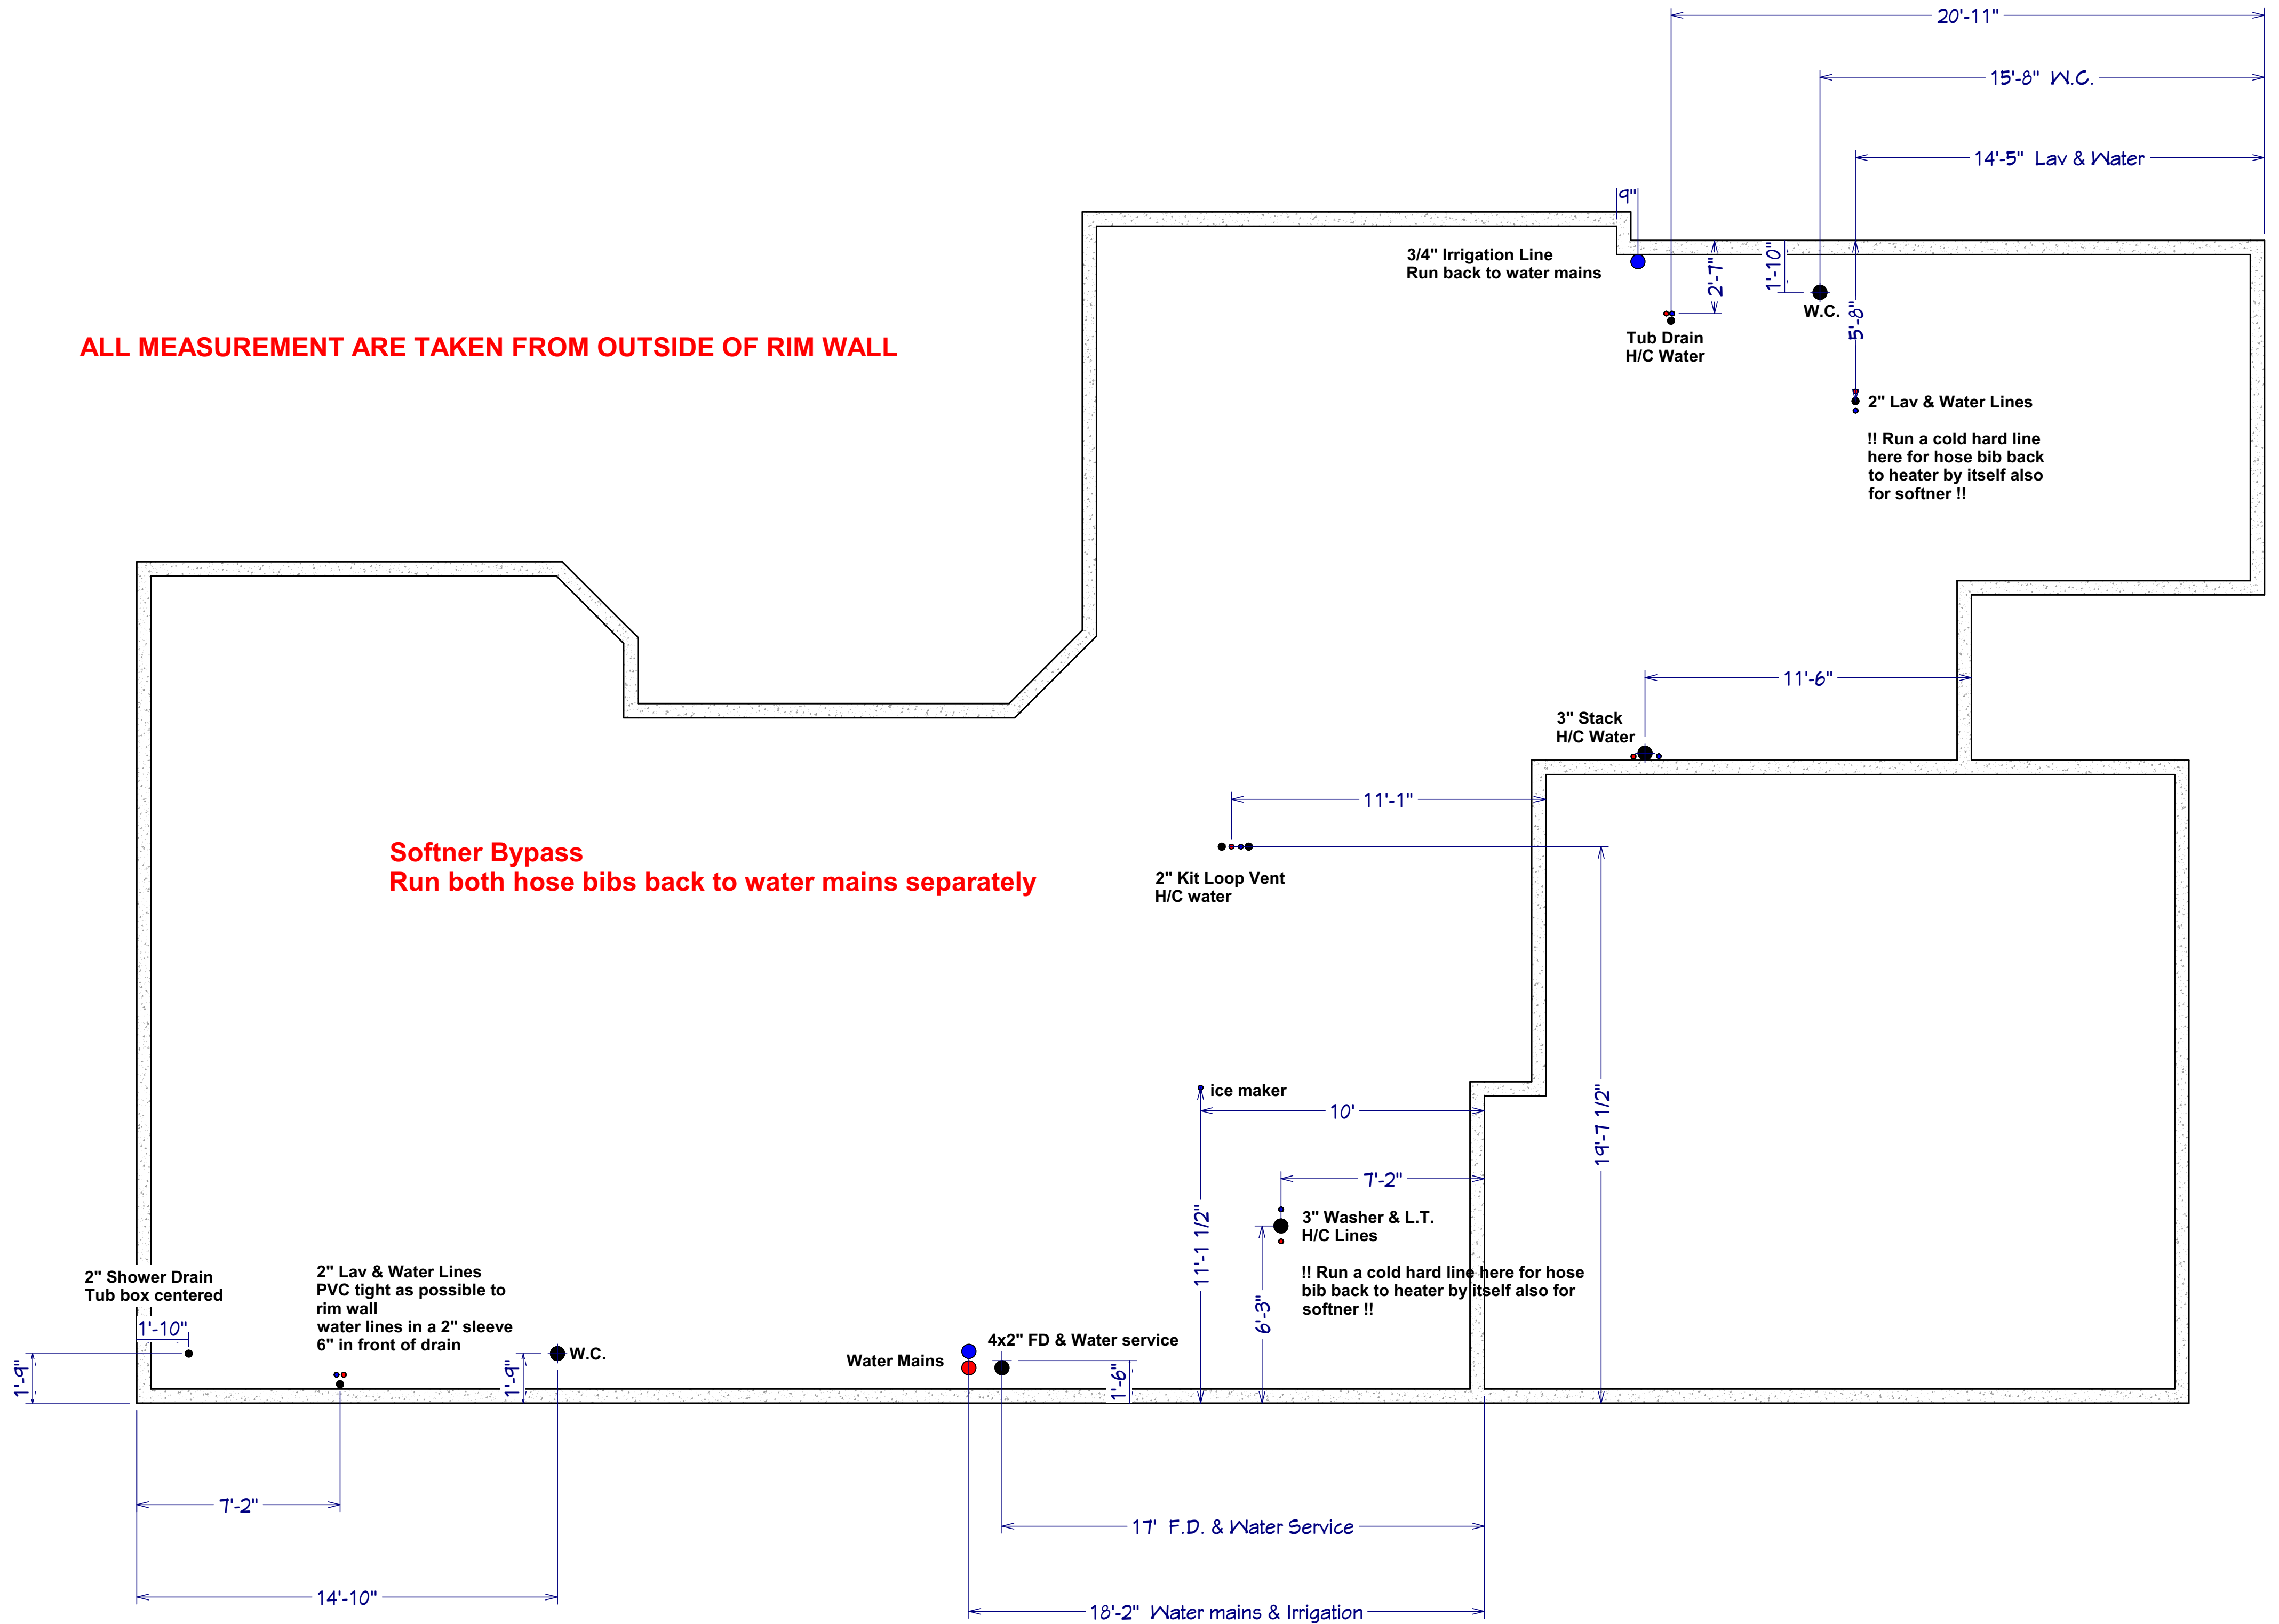

**Softner Bypass
Run both hose bibs back to water mains separately**