
DY 8431 1127 WHITETAIL DR

2 Story Basementvent floor drainAA on kitchen1 shower1 tub50 gal electric

Gas Furnace



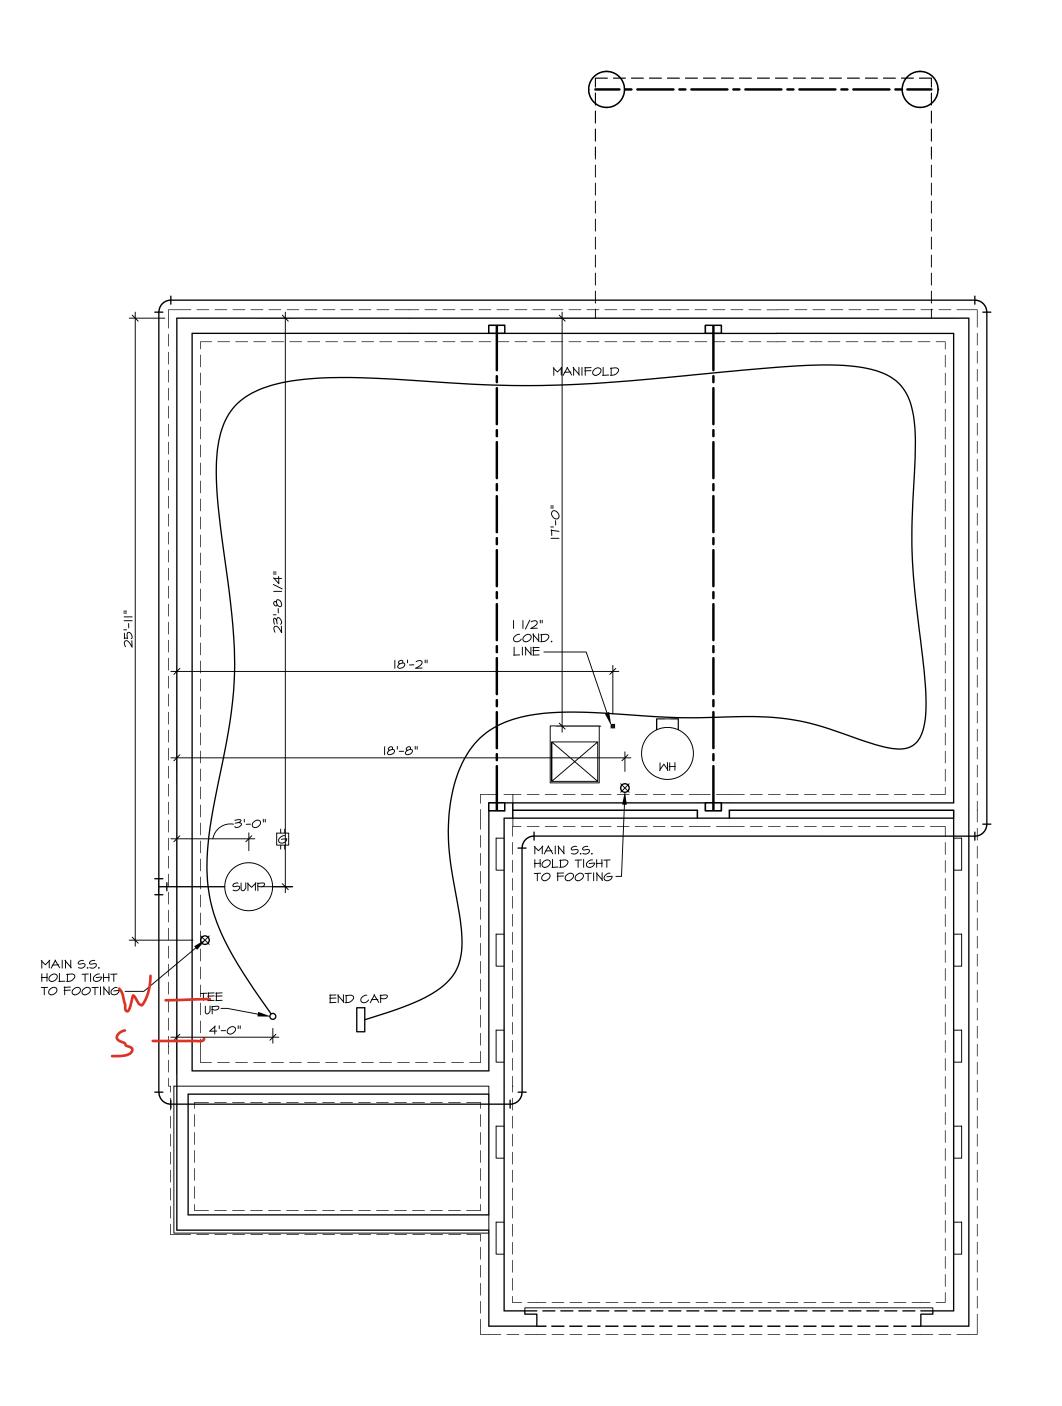

PLUMBING NOTES:

RADON REMEDIATION

RADON LOOP:

- (4") PERFORATED "LOOP"

- MUST BE PLACED IN STONE BED SLIGHTLY HIGHER THAN ANY INTERIOR DRAINTILE

- LOOP TO BE SEPARATE FROM ANY DRAINTILE ELEMENTS


- TO BE CORRUGATED PIPE

- SCREWS TO BE INSTALLED THROUGH LOOP AT TEE UP INTO STACK


STACK REQUIREMENTS:

- 3" PVC STACK (4" IF BASEMENT IS GREATER THAN 2200 SQFT.)

3" PVC STACK (4" IF BASEMENT IS GREATER THAN 2200 SQFT.)
NO PART OF STACK IS TO BE HORIZONTAL (45° ELBOWS PERMITTED AS REQUIRED)
PIPE TO BE PHYSICALLY LABELED IN THE FIELD AS "RADON VENT" OR OTHER JURISDICTIONALLY REQUIRED LANGUAGE (ON EVERY LEVEL OF HOUSE)
ROOF TERMINATION TO BE IN TOP I/3 OF ROOF
SCREEN OR VENT CAP INSTALLED TO KEEP PESTS OUT OF RADON VENT AT ROOF TERMINATION.

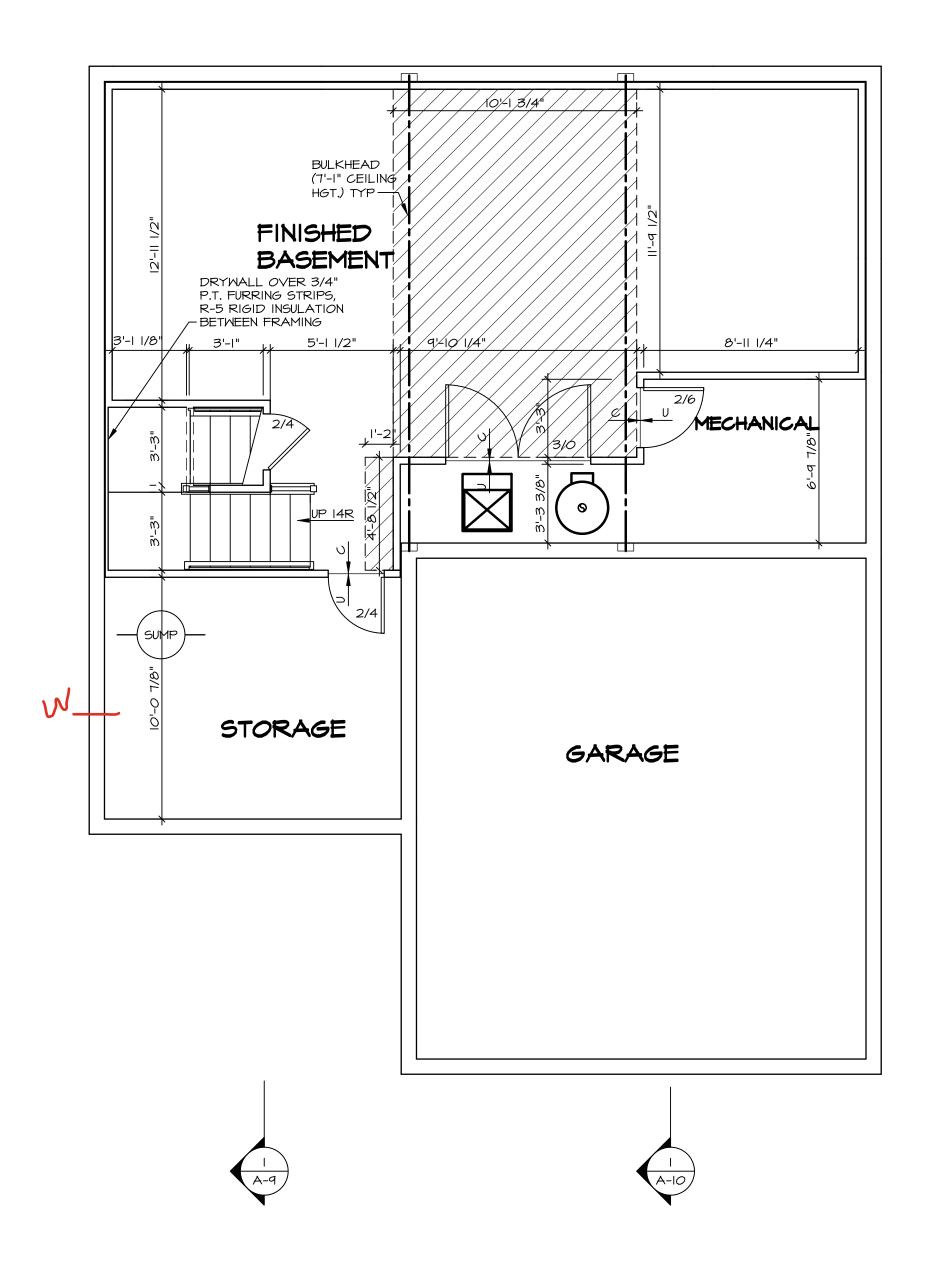



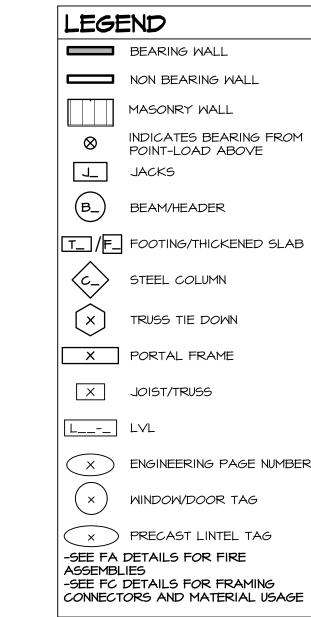

FLOOR PLAN NOTES:

- ALL HEADERS ARE (2) 2x6 w/ 2x4 WALLS OR (3) 2x6 II 2x6 WALLS, UNLESS OTHERWISE NOTED.
 ALL HEADERS TO HAVE (I) 2x4 OR 2x6 JACK AND KIN STUD EACH END, UNLESS OTHERWISE NOTED. MULTI-OPENING HEADERS TO HAVE (2) JACKS AT INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. NO ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOUS LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISE
- 3. ALL EXTERIOR WALLS TO BE 4" OR 6" AND ALL INTERIOR WALLS TO BE 3 I/2", UNLESS OTHERWISE NOTE
 4. HATCHED AREAS INDICATE DROPPED CEILINGS. ALL DROPPED CEILINGS ARE I2" UNLESS OTHERWISE NOTED SEE ARCHITECTURAL DETAIL 8/IT-IB FOR 3/4" FIRE STOPPING AT BULKHEAD / CEILING PANELS
 5. SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIA
- SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECI WALL FRAMING LOCATIONS AND HEADER SIZES, IF APPLICABLE.
 SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR INTERIOR TRIM DETAILS.
- 7. SEE DETAIL SHEET "AD" FOR HOUSE SPECIFIC INTERIOR OPTION TABLE.
- 8. ALL HEADERS IN NON-BEARING WALLS SHALL BE A SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES ABOVE, UNLESS OTHERWISE NOTED.
 9. TANKED WATER HEATER SHOWN AS BASE CONDITION,
- OPTIONAL TANKLESS WATER HEATER IS AVAILABLE
 LIEU OF TANKED WATER HEATER.

 10. INTERIOR HEADER HEIGHT FOR 8' CEILING WILL BE 6
- 9' CEILING WILL BE 7'-II", IO' CEILING WILL BE 8'-3", UNLESS OTHERWISE NOTED.

 II. BASEMENT WALL PANELS SHALL NOT BE HELD TIGHT TO FOUNDATION WALLS.
- 12. ALL INTERIOR BEARING WALLS SHALL HAVE GYPSUM APPLIED TO AT LEAST ONE SIDE OR HAVE MID-HEIGHT BLOCKING INSTALLED.
 13. NON-BEARING WALLS OVER CONCRETE TO BE HELD 1/2" SHORT OF FRAMING ABOVE.

GYPSUM NOTES:

AT GARAGE:

GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL FA-I(b) FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.

AT STAIRS:

I/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS
IN CLOSET

	Н					
-ROM						
5LAB						
IV ADED			~			APT. NO.
JMBER			-843			_
			<u>}</u>			
; 6AGE			ワのイーワ		_	
		L	六		649	
2x6 w/		ND-TO	ñ		, H	SS
KING		IM-LC	-	OT	7	ADDRE
P. NO IUOUS NISE		DIV-COMM-LOT-UNIT		COMM-LOT	DEER VALLEY - 8431	STREET ADDRESS
NOTED. LL DTED. E						
ECIAL						
OR						
RIOR						
5			its to	0 g	- e +	
ON, E IN			erves rty righ 3 are n	nged,	v to	y will
6'-11",			sly res prope	char	e they	xpresse
I T T <i>O</i>			express other	duced,	or ar	the e
JM IGHT		, Inc.,	owner, expressly reserves its ight and other property rights ese plans. These plans are not	e repro	oever, r	obtaining the expressed written of NVR. Inc.

NVR, Inc.
5285 Westview Drive, Suite 100 econ Frederick, MD 21703

RELEASE NO. ---DRAWN BY TN
DATE: OB/O9/2C
OPTION

OOR PLAN


DRAWING TITLE
BASEMENT FLOOR PLAN
OPTION DESCRIPTION

4

	FIRST FLOOR JACK S	SCHEDUL	E
IDENTIFIER	DESCRIPTION	ENG. NUM.	REMARKS
IOIL	JACK - (4) 2X4 SPF STUD GRADE	1004	
JI02	JACK - (4) 2X6 SPF STUD GRADE	1004	
SOIL	JACK - (5) 2X4 SP#I	1008	
JIO4	JACK - (5) 2X4 SP#I	1008	
TOIL	JACK - (3) 2X6 SP#1	1014	
80IL	JACK - (3) 2X4 SPF STUD GRADE	1014	
POIL	JACK - (3) 2X6 SPF STUD GRADE	1016	
OIIL	JACK - (3) 2X4 SPF STUD GRADE	1016	
IIIL	JACK - (2) 2X4 SPF STUD GRADE	1025	
JII2	JACK - (2) 2X4 SPF STUD GRADE	1025	
SIIL	JACK - (2) 2X4 SPF STUD GRADE	1033	
JII4	JACK - (2) 2X4 SPF STUD GRADE	1036	
JII5	JACK - (4) 2X4 SPF STUD GRADE	1006	
JI20	JACK - (2) 2X4 SPF STUD GRADE	1027	
JI2I	JACK - (2) 2X4 SPF STUD GRADE	1027	
Jl22	JACK - (2) 2X4 SPF STUD GRADE	1027	
JI23	JACK - (2) 2X4 SPF STUD GRADE	1036	
JI24	JACK - (2) 2X4 SPF STUD GRADE	1027	

FIELD	INSTALLED FIRST FL	OOR BEAM	HEADER	SCHEDULE
IDENTIFIER	DESCRIPTION	LENGTH	ENG. NUM.	REMARKS
BIOI	BEAM STEEL - WIOX30	20'-6"	1008	
PF107-2	LVL 1.75 - 11-04	19'-9"	1025	PORTAL FRAME I.A

STEEL COLUMN SCHEDULE						
IDENTIFIER	STYLE	HEIGHT	ENG. NUM.	REMARKS		
C107	STANCHION PORCH - 3 IN DIA IIGA ADJ	9'-10 1/8"	1033			

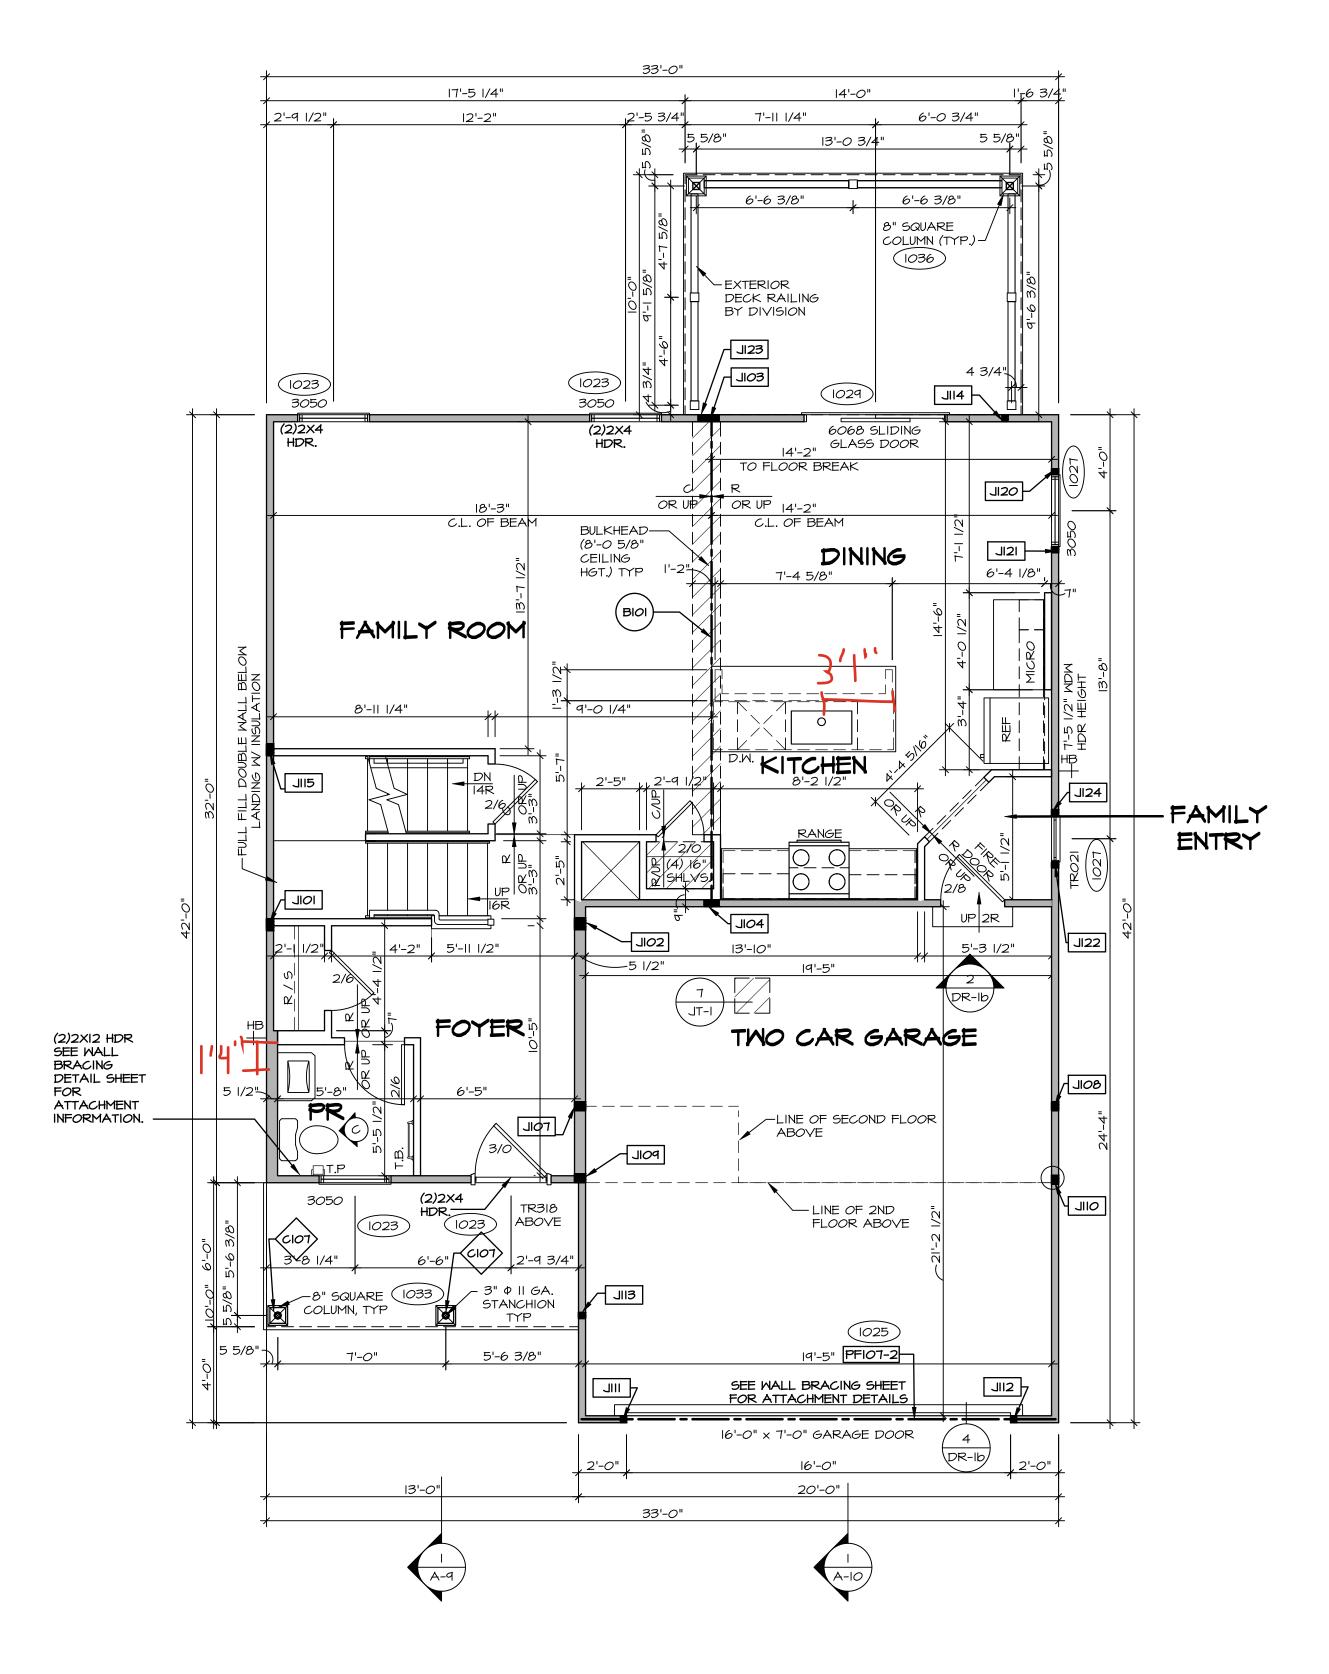



HEIGHT UNLESS OTHERWISE NOTED LEGEND BEARING WALL NON BEARING WALL MASONRY WALL INDICATES BEARING FROM POINT-LOAD ABOVE J_ JACKS (B_ BEAM/HEADER T_ /F_ FOOTING/THICKENED SLAB STEEL COLUMN TRUSS TIE DOWN X PORTAL FRAME X JOIST/TRUSS L__-_ LVL (X) ENGINEERING PAGE NUMBER WINDOW/DOOR TAG × PRECAST LINTEL TAG -SEE FA DETAILS FOR FIRE

> -SEE FC DETAILS FOR FRAMING CONNECTORS AND MATERIAL USAGE

ALL WINDOWS HAVE 7'-0 1/2" HEADER

FLOOR PLAN NOTES:

ALL HEADERS ARE (2) 2x6 W/ 2x4 WALLS OR (3) 2x6 W/ 2x6 WALLS, UNLESS OTHERWISE NOTED. ALL HEADERS TO HAVE (I) 2x4 OR 2x6 JACK AND KING STUD EACH END, UNLESS OTHERWISE NOTED. MULTI-OPENING HEADERS TO HAVE (2) JACKS AT INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. NO ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOUS LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISE ALL EXTERIOR WALLS TO BE 4" OR 6" AND ALL INTERIOR WALLS TO BE 3 I/2", UNLESS OTHERWISE NOTED. HATCHED AREAS INDICATE DROPPED CEILINGS. ALL DROPPED CEILINGS ARE 12" UNLESS OTHERWISE NOTED. SEE ARCHITECTURAL DETAIL 8/IT-IB FOR 3/4" FIRE STOPPING AT BULKHEAD / CEILING PANELS SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIAL WALL FRAMING LOCATIONS AND HEADER SIZES, IF APPLICABLE. SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR INTERIOR TRIM DETAILS. SEE DETAIL SHEET "AD" FOR HOUSE SPECIFIC INTERIOR TRIM OPTION TABLE. ALL HEADERS IN NON-BEARING WALLS SHALL BE A SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES ABOVE, UNLESS OTHERWISE NOTED. TANKED WATER HEATER SHOWN AS BASE CONDITION, OPTIONAL TANKLESS WATER HEATER IS AVAILABLE IN LIEU OF TANKED WATER HEATER. D. INTERIOR HEADER HEIGHT FOR 8' CEILING WILL BE 6'-II", 9' CEILING WILL BE 7'-II", IO' CEILING WILL BE 8'-3", BASEMENT WALL PANELS SHALL NOT BE HELD TIGHT TO FOUNDATION WALLS. ALL INTERIOR BEARING WALLS SHALL HAVE GYPSUM APPLIED TO AT LEAST ONE SIDE OR HAVE MID-HEIGHT BLOCKING INSTALLED. 3. NON-BEARING WALLS OVER CONCRETE TO BE HELD 1/2"

ASSEMBLIES

GYPSUM NOTES:

SHORT OF FRAMING ABOVE.

AT GARAGE:

GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL FA-I(b) FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.

AT STAIRS:

1/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS IN CLOSET

LVL PLY TO PLY FASTENING SCHEDULE: (WHERE APPLICABLE BASED ON LVL USAGE)

I.A - (2) PLY UP TO AND INCLUDING II 7/8" TALL: FASTEN PLIES W (2) ROWS I6D NAILS AT 12" O.C. OR

ALT I 1/2" WIDE LVL FASTEN PLIES W (3) ROWS I2D NAILS AT 12"O.C.

2.A - (2) PLY 14" UP TO AND INCLUDING 18": FASTEN PLIES W/ (3) ROWS 16D NAILS AT 12" O.C. OR

ALT I I/2" WIDE LVL FASTEN PLIES W/ (4) ROWS I2D NAILS AT I2"O.C.

3.A - (2) PLY 20" TALL AND OVER: FASTEN PLIES W/ (4) ROWS I6D NAILS AT I2" O.C. OR ALT I I/2" WIDE LVL FASTEN PLIES W/ (5) ROWS I2D NAILS AT I2"O.C.

4.A - (3) PLY UP TO AND INCLUDING II 7/8" TALL: FASTEN PLIES W/ (2) ROWS 16D NAILS AT 12" O.C.

FROM EACH SIDE OR ALT I I/2" WIDE LVL FASTEN PLIES W/ (3) ROWS 12D NAILS AT 12"O.C. FROM EACH SIDE

EACH SIDE. 5.A - (3) PLY 14" UP TO AND INCLUDING 18": FASTEN PLIES W/ (3) ROWS 16D NAILS AT 12"O.C. FROM EACH SIDE OR ALT I 1/2" WIDE LVL FASTEN PLIES W/(4) ROWS 12D NAILS AT 12"O.C. FROM


EACH SIDE.
6.A - (3) PLY 20" TALL AND OVER: FASTEN PLIES W/ (4) ROWS 16D NAILS AT 12" O.C. FROM EACH SIDE OR ALT 1 1/2" WIDE LVL FASTEN PLIES W/ (5) ROWS 12D NAILS AT 12"O.C. FROM EACH SIDE.

OR ALT 1 1/2" MIDE LVL FASTEN PLIES W/ (5) ROWS 12D NAILS AT 12"O.C. FROM EACH SIDE.


7.A - (4) PLY (ALL SIZES); FASTEN PLIES WITH (3) ROWS OF SDW22634 STRUCTURAL WOOD SCREWS, OR EQUIVALENT, AT 16" O.C. STAGGERED. SEE SHOP DRAWING FOR ADDITIONAL INFORMATION.

DRAWING TITLE
FIRST FLOOR PLAN
OPTION DESCRIPTION

SEC	OND FLOOR JACK SCHEI	DULE
IDENTIFIER	DESCRIPTION	ENG. NUM.

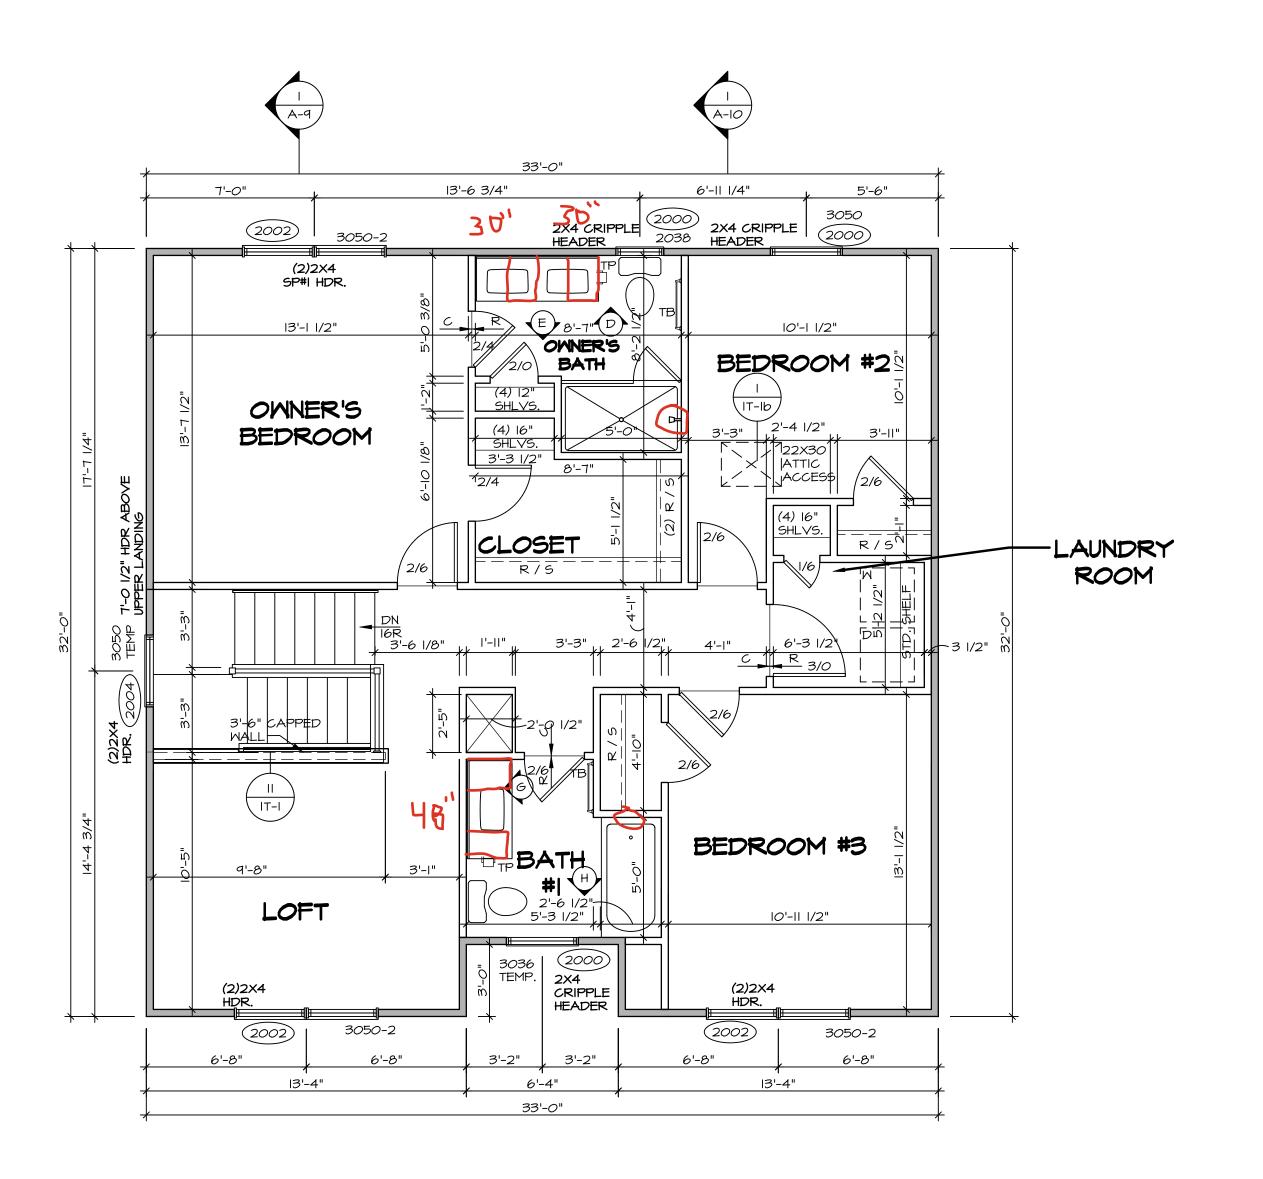



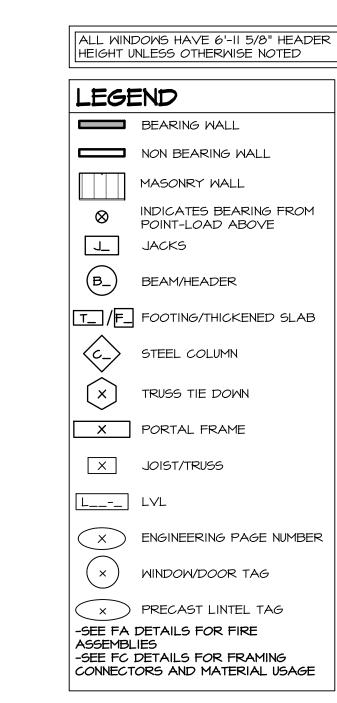

FLOOR PLAN NOTES:

- ALL HEADERS ARE (2) 2x6 w/ 2x4 WALLS OR (3) 2x6 w/ 2x6 WALLS, UNLESS OTHERWISE NOTED. ALL HEADERS TO HAVE (1) 2x4 OR 2x6 JACK AND KING STUD EACH END, UNLESS OTHERWISE NOTED. MULTI-OPENING HEADERS TO HAVE (2) JACKS AT INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. NO ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOUS LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISE
- ALL EXTERIOR WALLS TO BE 4" OR 6" AND ALL INTERIOR WALLS TO BE 3 1/2", UNLESS OTHERWISE NOTED. HATCHED AREAS INDICATE DROPPED CEILINGS. ALL DROPPED CEILINGS ARE 12" UNLESS OTHERWISE NOTED. SEE ARCHITECTURAL DETAIL 8/IT-IB FOR 3/4" FIRE STOPPING AT BULKHEAD / CEILING PANELS
- SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIAL WALL FRAMING LOCATIONS AND HEADER SIZES, IF APPLICABLE. SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR
- INTERIOR TRIM DETAILS.
 SEE DETAIL SHEET "AD" FOR HOUSE SPECIFIC INTERIOR TRIM OPTION TABLE.
- ALL HEADERS IN NON-BEARING WALLS SHALL BE A SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES ABOVE, UNLESS OTHERWISE NOTED.
- TANKED WATER HEATER SHOWN AS BASE CONDITION, OPTIONAL TANKLESS WATER HEATER IS AVAILABLE IN
- LIEU OF TANKED WATER HEATER. 10. INTERIOR HEADER HEIGHT FOR 8' CEILING WILL BE 6'-II", 9' CEILING WILL BE 7'-II", IO' CEILING WILL BE 8'-3", UNLESS OTHERWISE NOTED.
- BASEMENT WALL PANELS SHALL NOT BE HELD TIGHT TO FOUNDATION WALLS. 12. ALL INTERIOR BEARING WALLS SHALL HAVE GYPSUM
- APPLIED TO AT LEAST ONE SIDE OR HAVE MID-HEIGHT BLOCKING INSTALLED.
- 13. NON-BEARING WALLS OVER CONCRETE TO BE HELD 1/2" SHORT OF FRAMING ABOVE.

GYPSUM NOTES:

AT GARAGE:

GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL **FA-I(b)** FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.

AT STAIRS:

IN CLOSET

1/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS

The water, expressly reserves its copyright and other property rights in these plans. These plans are not be reproduced, changed, or copied in any form or manner whatsoever, nor are they to be susstine 100 Frederick, MD 21703 INVR. Inc. In these plans. These plans are not be reproduced, changed, or copied in any form or manner whatsoever, nor are they to be assigned to any third party, without first obtaining the expressed written consent of NVR, Inc. In these plans are not be reproduced, changed, or copied in any form or manner between the property or copied in any form or manner between the property rights are not or copied in any form or manner between the plant or manner between the property rights are not or manner between the property rights are not or manner between the plant or manner between								
© NVR, Inc., The owner, expressly reserves its copyright and other property rights in these plans are not to be reproduced, changed, or copied in any form or manner whatsoever, nor are they to be assigned to any third party, without first obtaining the expressed written consent of NVR, Inc. © NVR, Inc. DIV-COMM-LOT COMM-LOT COMM-LOT DEER VALLEY - 843 STREET ADDRESS WHITETAIL DR CITY MIAMISBURG	$\frac{\omega}{\omega}$			APT. NO.	!	ZIP	45342	
© NVR, Inc., The owner, expressly reserves its copyright and other property rights in these plans. These plans are not to be reproduced, changed, or copied in any form or manner whatsoever, nor are they to be assigned to any third party, without first obtaining the expressed written consent of NVR, Inc. © NVR, Inc. DEER VAL STREET ADDI CITY MIAMISBUR						STATE	\$	
00	DIV-COMM-LOT-UNIT	COMM-LOT	DEER VALLEY - 8431	STREET ADDRESS	WHITETAIL DR	CITY	MIAMISBURG	
e e de	© NVR, Inc., The owner, expressly reserves its copyright and other property rights in these plans. These plans are not	to be reproduced, changed, or copied in any form or manner						2001 S dwg 10/15/25 - 8:05 gm
	SET NO. ALGOO VERSION OI RELEASE NO	\ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \	DATE: 08/10/2017					SI CNId

KITCHEN NOTES:

CABINET LAYOUT (S) ARE BASED ON FINISHED DIMENSIONS TO DRYWALL. 2. IF KITCHEN PLANS/ELEVATIONS CALL-OUT STANDARD MOLDING, REFER TO STANDARD

DETAIL II/KT-I FOR REPLACEMENT BASED ON CABINET STYLE. 3. ALL (UF#) FILLERS ARE TO BE "TRIM TO FIT"


UNLESS OTHERWISE NOTED.

4. CABINET MUST BE SET, SHIMMED, LEVELED


AND PLUMB W/ ADJOINING BASE CABINETS. 5. SET PRE-FINISHED SCRIBE MOLDING AT CABINET BULKHEADS AND AT ENDS (WHERE CABINETS MEET DRYWALL.) PRE-FINISHED SCRIBE MOLDING SHALL BE USED TO PAD OUT CABINET SIDES AT STILE FOR RETURN PIECES OF THE FACE-MOUNTED CABINET CROWN MOLDING.

6. HARDWARE INSTALL NOTE: KNOBS GO ON OPERABLE DOORS AND DRAWERS FOR ALL KITCHEN AND BATH AREAS. DRAWER FRONTS AND DOORS GET (I) KNOB/PULL. NO HARDWARE ON FALSE DRAWER FRONTS. REFER TO STANDARD DETAIL **5/KT-Ib**

CABINETS ARE NOT REPRESENTATIVE OF ALL STYLES AND ARE MEANT AS A GENERAL DEPICTION OF THE INTENDED CABINET LAYOUT

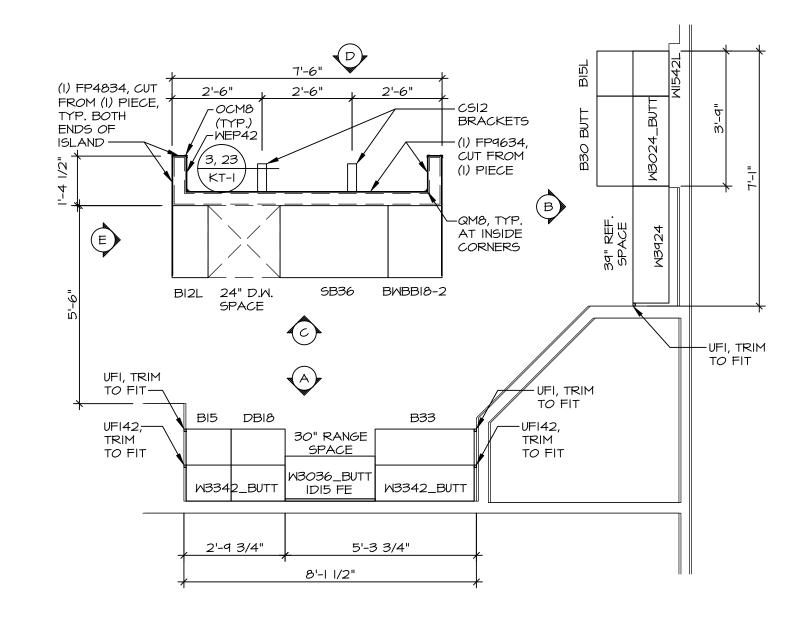



KITCHEN CABINET PLAN KC - 3489TC

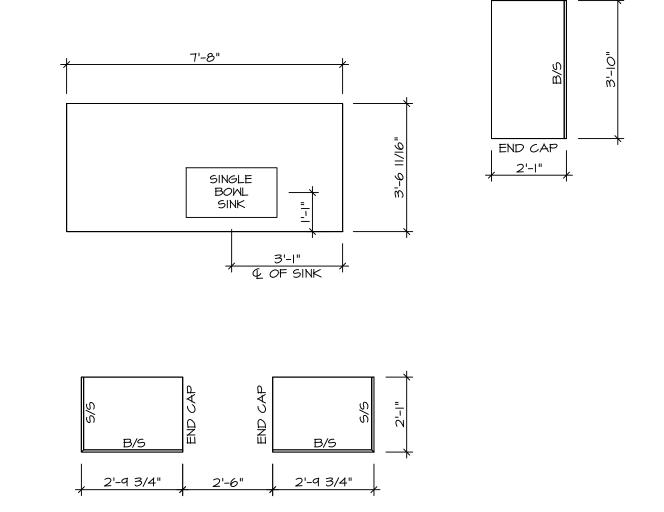


END CAP




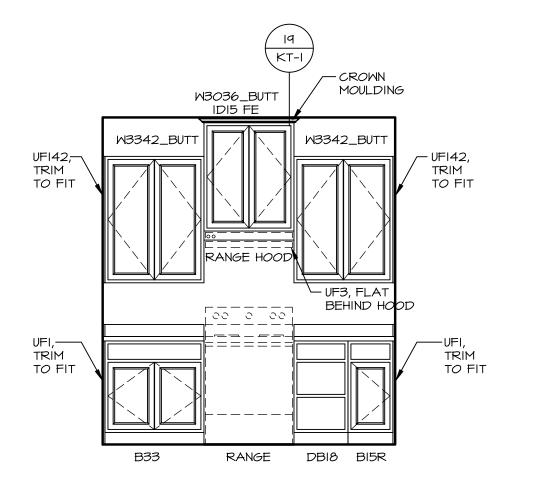


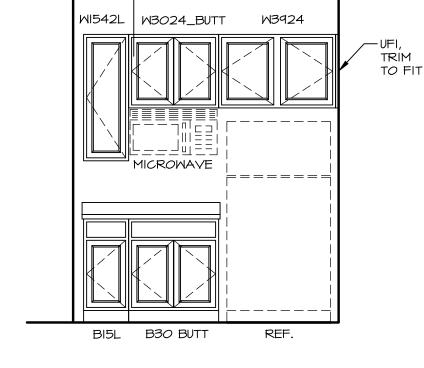

(20) (KT-I)

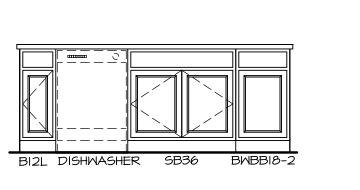

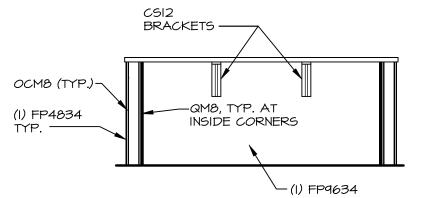

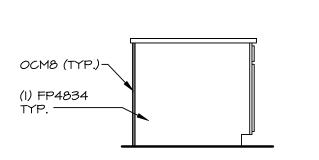














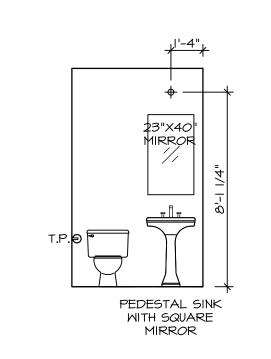


POWDER ROOM SCALE: 1/4" = 1'-0"

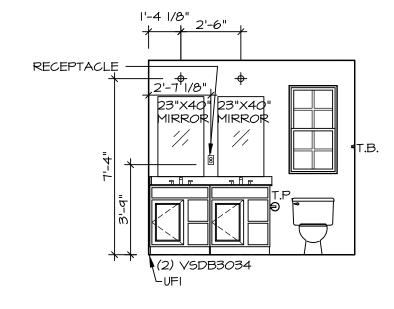





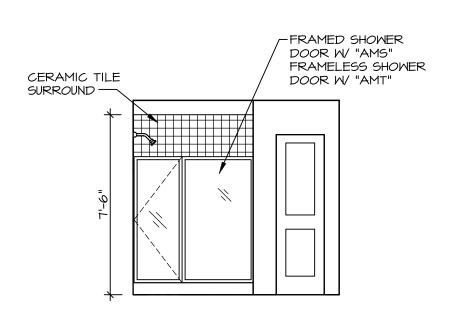







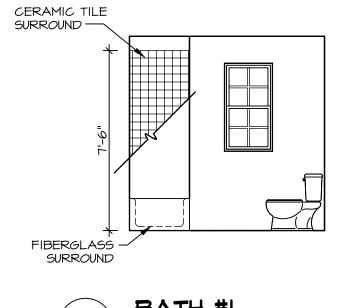

	BATH #I
П	SCALE: 1/4" = 1'-0"

BATH NOTES:

- TEMPERED GLASS SHOWER ENCLOSURE WITH SWING DOOR OR OPTIONAL SLIDING DOOR BY DIVISION.
 TUB ACCESS PANELS PROVIDED AS NEEDED, ALL MATERIALS BY DIVISION.
 REFER TO DETAILS IT- FOR TUB AND SHOWER.
 ALL VANITIES WITH DRAWERS TO BE SET WITH DRAWERS ON RIGHT HAND SIDE.
 BATH ELEVATIONS ARE SHOWN PER PLAN.
 ALL DIMENSIONS SHOWN ON BATH ELEVATIONS ARE ROUGH FRAMING REFERENCES ONLY.