
S2 426 6840 RIVULET DRIVE MIDDLETOWN, OH 45042

2 Story Basement - 3pc rough
2 hose bibs - no valves required
Vent Kitchen
ice maker
1 tub
1 shower
WATER HEATER ELECTRIC 50 GALLON
Inside Water Meter setup

Gas Furnace and range



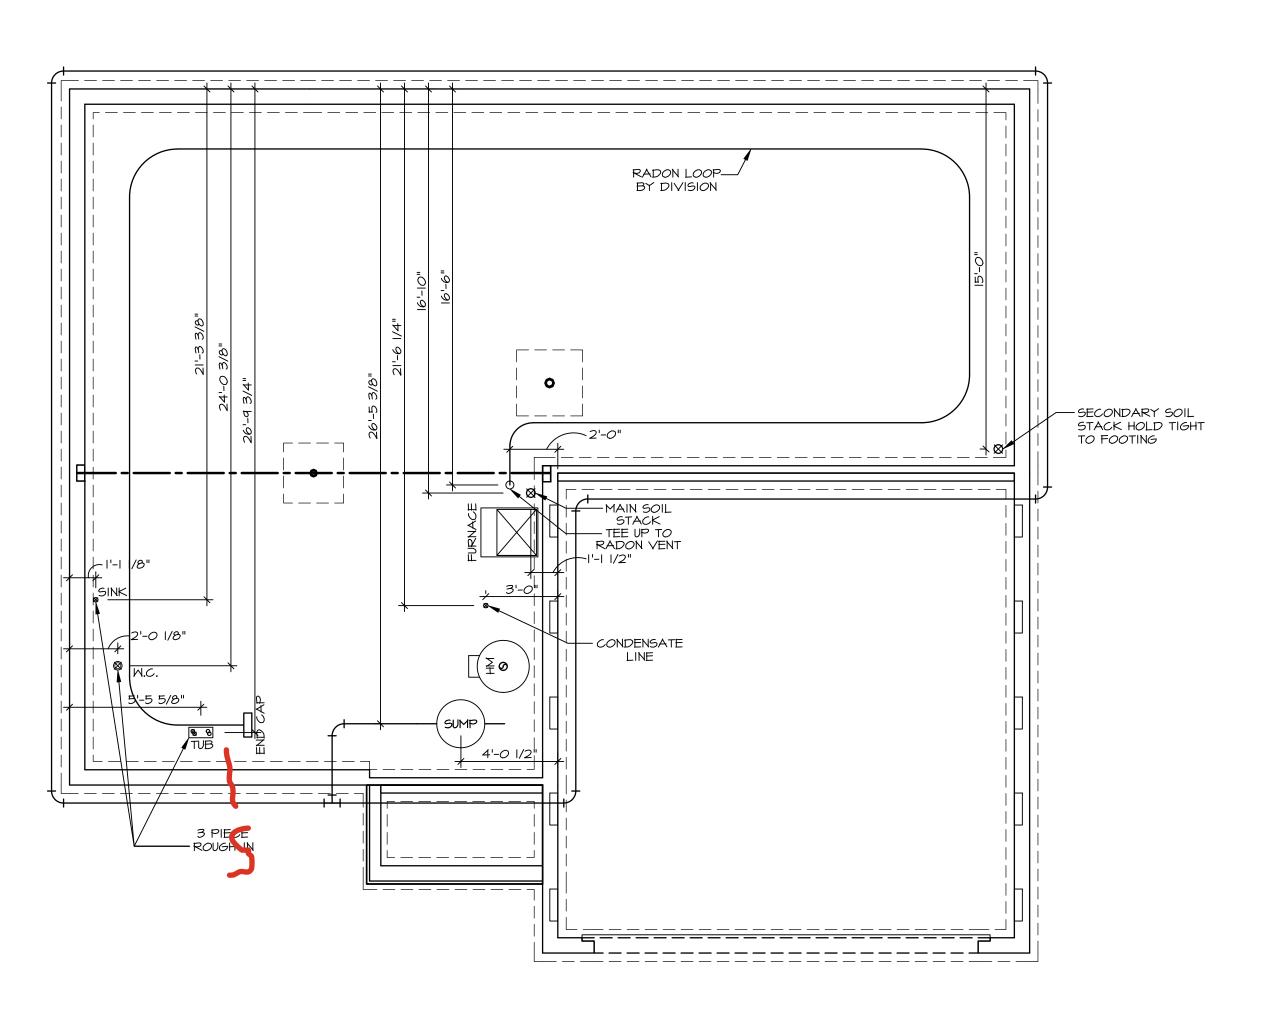

PLUMBING NOTES:

RADON REMEDIATION

RADON LOOP:

- (4") PERFORATED HDPE "LOOP"

- MUST BE PLACED IN STONE BED SLIGHTLY HIGHER THAN ANY INTERIOR DRAINTILE

- LOOP TO BE SEPARATE FROM ANY DRAINTILE ELEMENTS

TO BE CORPUGATED HDDE PIDE


- TO BE CORRUGATED HDPE PIPE - SCREWS TO BE INSTALLED THROUGH LOOP AT TEE UP INTO STACK


- SCREWS TO BE INSTALLED THROUGH LOOP AT THE UP INTO STACK

STACK REQUIREMENTS:
- 3" PVC STACK (4" IF BASEMENT IS GREATER THAN 2200 SQFT.)
- NO PART OF STACK IS TO BE HORIZONTAL (45° ELBOWS PERMITTED AS REQUIRED)
- PIPE TO BE PHYSICALLY LABELED IN THE FIELD AS "RADON VENT" OR OTHER

JURISDICTIONALLY REQUIRED LANGUAGE (ON EVERY LEVEL OF HOUSE)
ROOF TERMINATION TO BE IN TOP 1/3 OF ROOF SCREEN OR VENT CAP INSTALLED TO KEEP PESTS OUT OF RADON VENT AT ROOF TERMINATION.

126		APT. NO.	71P
DCY-52-0426	COMM-LOT SAMYERS MILL - SIMPLY RYAN - 0426	STREET ADDRESS 6840 RIVULET DRIVE	STATE
© NVR, Inc., The owner, expressly reserves its copyright and other property rights in these plans. These plans are not	to be reproduced, changed, or copied in any form or manner whatsoever, nor are they to be	first obtaining the expressed written consent of NVR, Inc.	
		NVR, Inc. 5285 Westview Drive, Suite 100 Frederick, MD 21703	
SET NO. ELDOO VERSION OI RELEASE NO	DRAWN BY DATE:	OPTION	
MODEL ELDER DRAWING TITLE	PLUMBING PLAN	OPTION DESCRIPTION	

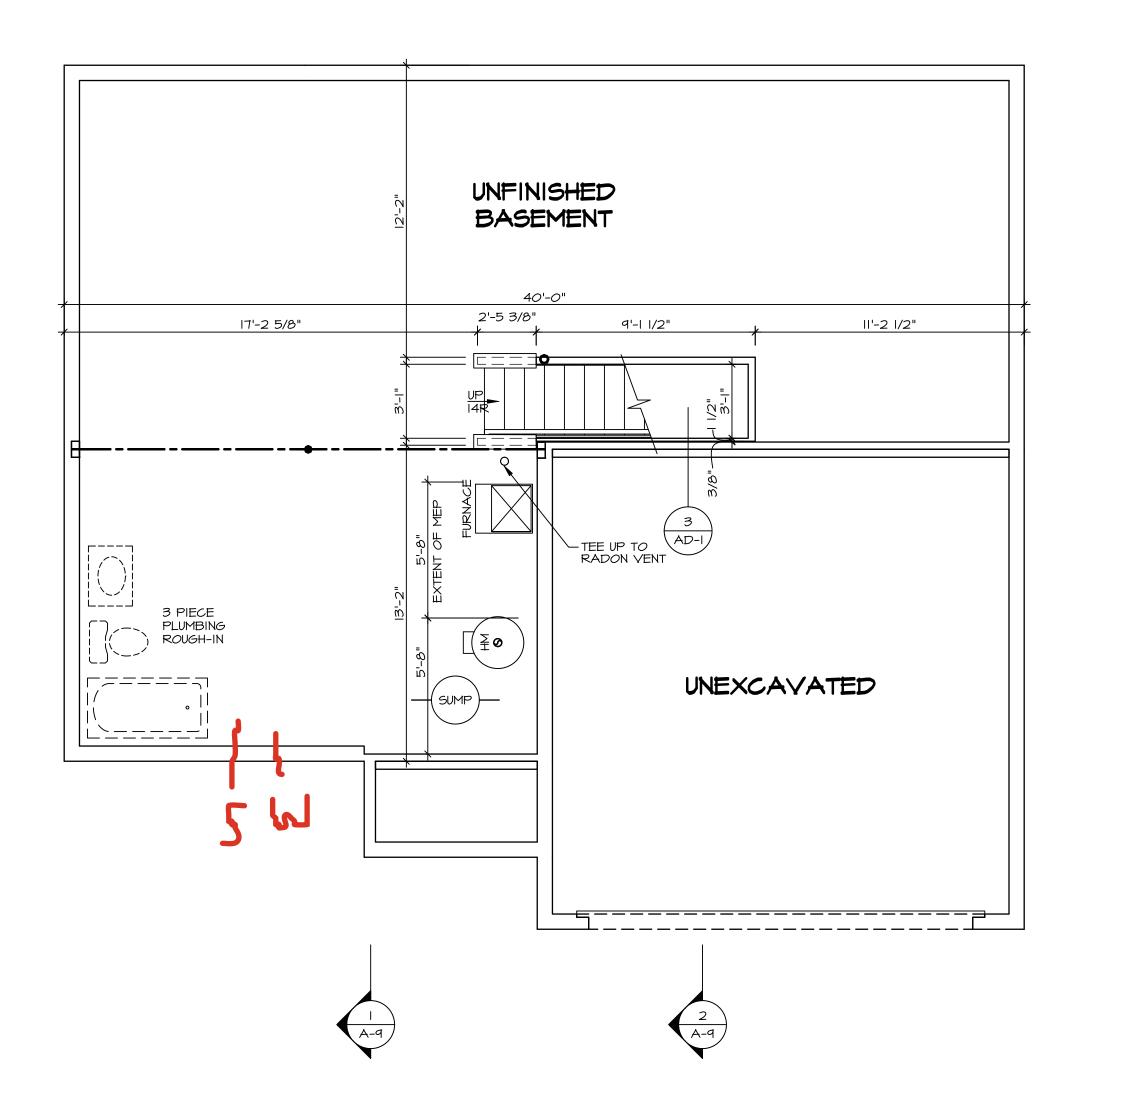

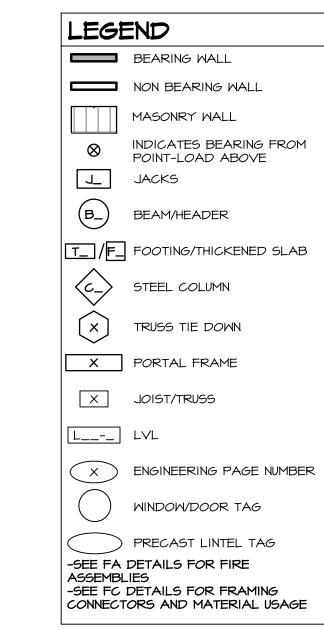

## FLOOR PLAN NOTES:

- ALL HEADERS ARE (2) 2x6 W/ 2x4 WALLS OR (3) 2x6 W/ 2x6 WALLS, UNLESS OTHERWISE NOTED.

  ALL HEADERS TO HAVE (1) 2x4 OR 2x6 JACK AND KING STUD EACH END, UNLESS OTHERWISE NOTED. MULTI-OPENING HEADERS TO HAVE (2) JACKS AT INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. NO ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOUS LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISE NOTED.
- ALL EXTERIOR WALLS TO BE 4" OR 6" AND ALL INTERIOR WALLS TO BE 3 1/2", UNLESS OTHERWISE NOTED. . HATCHED AREAS INDICATE DROPPED CEILINGS. ALL DROPPED CEILINGS ARE 12" UNLESS OTHERWISE NOTED. SEE ARCHITECTURAL DETAIL 8/IT-IB FOR 3/4" FIRE STOPPING AT BULKHEAD / CEILING PANELS
- SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIAL WALL FRAMING LOCATIONS AND HEADER SIZES, IF APPLICABLE.
- SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR INTERIOR TRIM DETAILS. SEE ARCHITECTURAL DETAIL SHEET "AD" FOR HOUSE
- SPECIFIC INTERIOR TRIM OPTION TABLE. ALL HEADERS IN NON-BEARING WALLS SHALL BE A
- SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES ABOVE, UNLESS OTHERWISE NOTED. TANKED WATER HEATER SHOWN AS BASE CONDITION,
- OPTIONAL TANKLESS WATER HEATER IS AVAILABLE IN LIEU OF TANKED WATER HEATER.
- IO. INTERIOR HEADER HEIGHT FOR 8' CEILING WILL BE 6'-II". 9' CEILING WILL BE 7'-II", IO' CEILING WILL BE 8'-3", UNLESS OTHERWISE NOTED.
- BASEMENT FINISH DIMENSIONS ASSUME A 1/2" GAP BETWEEN FRAME WALL AND CONCRETE WALL.

  12. ALL INTERIOR BEARING WALLS SHALL HAVE GYPSUM
  APPLIED TO AT LEAST ONE SIDE OR HAVE MID-HEIGHT BLOCKING INSTALLED.
- 3. NON-BEARING WALLS OVER CONCRETE TO BE HELD 1/2" SHORT OF FRAMING ABOVE.

# GYPSUM NOTES:

AT GARAGE:


GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL FA-I(b) FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.

AT STAIRS:

1/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS

ALL WINDOWS HAVE 8'-0 1/2" HEADER HEIGHT UNLESS OTHERWISE NOTED

BASEMENT FLOOR PLAN SCALE: 1/4" = 1'-0"

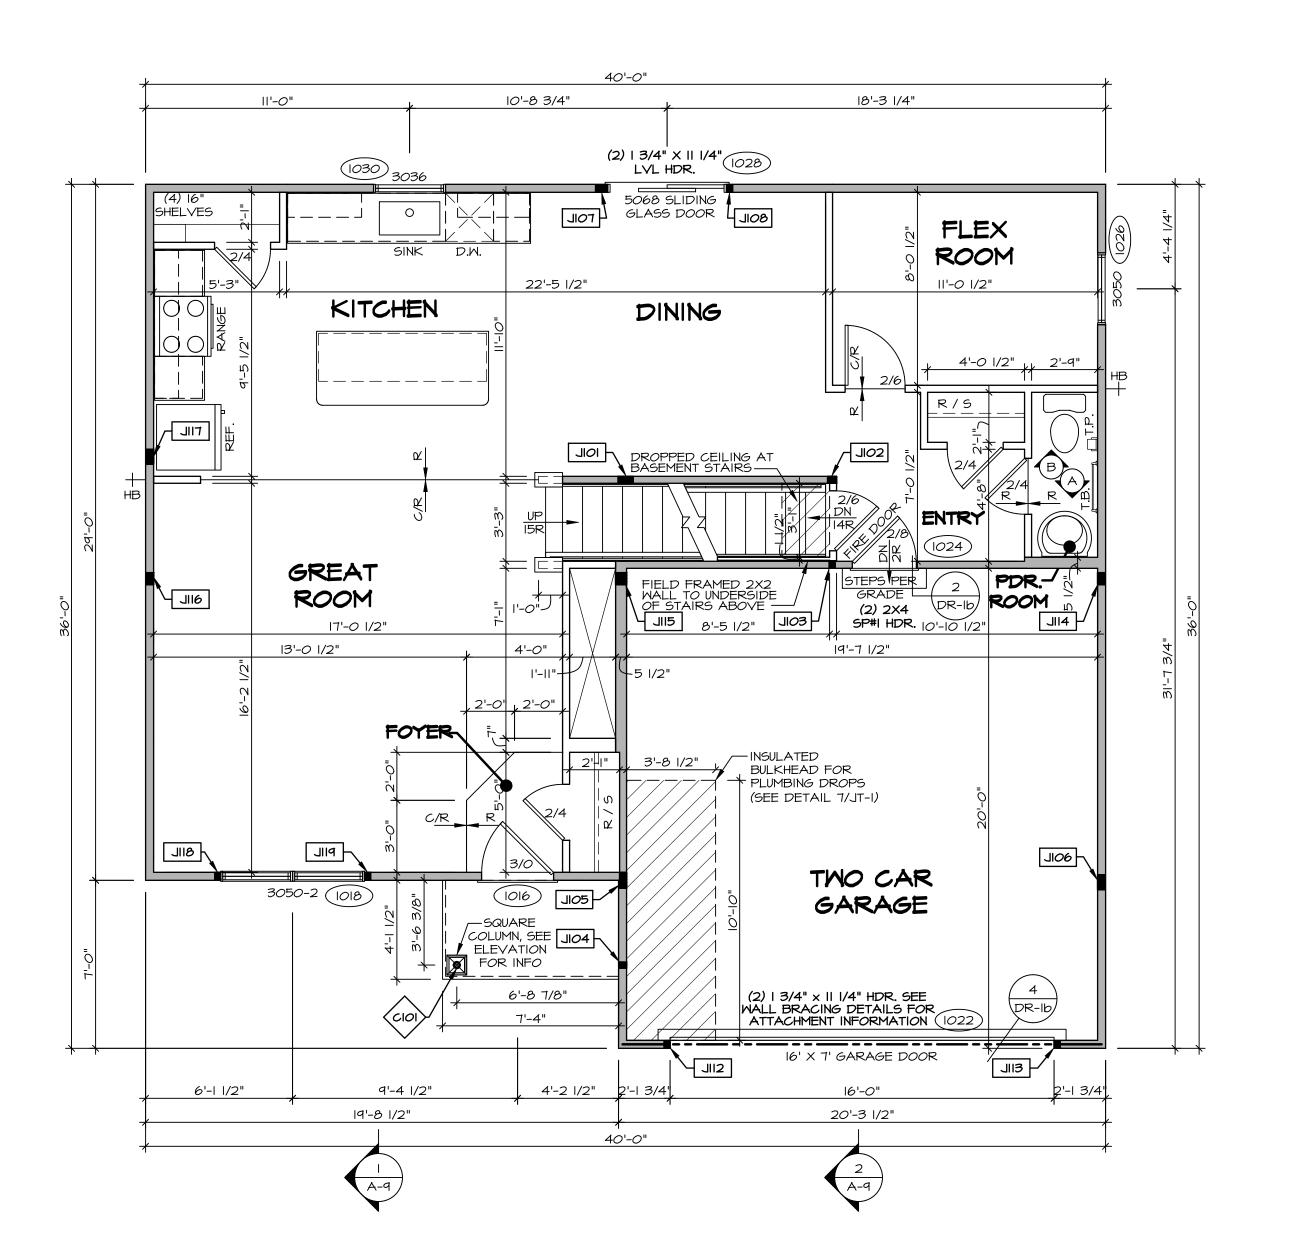



## LYL PLY TO PLY FASTENING SCHEDULE: (WHERE APPLICABLE BASED ON LVL USAGE)

- I.A (2) PLY UP TO AND INCLUDING II 7/8" TALL: FASTEN PLIES W/ (2) ROWS I6D NAILS AT I2" O.C. OR ALT I I/2" WIDE LVL FASTEN PLIES W/ (3) ROWS I2D NAILS AT I2"O.C.
- 2.A (2) PLY 14" UP TO AND INCLUDING 18": FASTEN PLIES W/ (3) ROWS 16D NAILS AT 12" O.C. OR ALT 1 1/2" WIDE LVL FASTEN PLIES W/ (4) ROWS 12D NAILS AT 12"O.C.
- 3.A (2) PLY 20" TALL AND OVER: FASTEN PLIES W/ (4) ROWS 16D NAILS AT 12" O.C. OR ALT 1 1/2" WIDE LVL FASTEN PLIES W/ (5) ROWS 12D NAILS AT 12"O.C.

  4.A (3) PLY UP TO AND INCLUDING II 7/8" TALL: FASTEN PLIES W/ (2) ROWS 16D NAILS AT 12" O.C. FROM FACH SIDE OR ALT LIV2" WIDE LVL FASTEN PLIES W/ (3) ROWS 12D NAILS AT 12"O.C. FROM
- FROM EACH SIDE OR ALT I I/2" WIDE LVL FASTEN PLIES W/ (3) ROWS I2D NAILS AT I2"O.C. FROM EACH SIDE.

  5.A (3) PLY I4" UP TO AND INCLUDING I8": FASTEN PLIES W/ (3) ROWS I6D NAILS AT I2"O.C.
- FROM EACH SIDE OR ALT I I/2" WIDE LVL FASTEN PLIES W/(4) ROWS I2D NAILS AT I2"O.C. FROM EACH SIDE.

  6 A (3) PLY 20" TALL AND OVER, EASTEN PLIES W/ (4) ROWS I6D NAILS AT I2" O.C. FROM EACH SIDE.
- 6.A (3) PLY 20" TALL AND OVER: FASTEN PLIES W/ (4) ROWS 16D NAILS AT 12" O.C. FROM EACH SIDE OR ALT I 1/2" WIDE LVL FASTEN PLIES W/ (5) ROWS 12D NAILS AT 12"O.C. FROM EACH SIDE.

  7.A (4) PLY (ALL SIZES); FASTEN PLIES WITH (3) ROWS OF SDW22634 STRUCTURAL WOOD SCREWS, OR EQUIVALENT, AT 16" O.C. STAGGERED. SEE SHOP DRAWING FOR ADDITIONAL INFORMATION.
- LEGEND BEARING WALL NON BEARING WALL MASONRY WALL INDICATES BEA  $\otimes$ POINT-LOAD A J\_ JACKS BEAM/HEADER T\_ /F\_ FOOTING/THICK STEEL COLUMN TRUSS TIE DOV X PORTAL FRAM X JOIST/TRUSS L\_\_-\_ LVL ENGINEERING 1 WINDOW/DOOR PRECAST LINTE -SEE FA DETAILS FOR F ASSEMBLIES -SEE FC DETAILS FOR F CONNECTORS AND MATE

ALL WINDOWS HAVE 7'-0 1/2" HEAD HEIGHT UNLESS OTHERWISE NOTED

ALL HEADERS ARE (2) 2x6 w/ 2x4 WALLS OR (3) 2x6
2x6 WALLS, UNLESS OTHERWISE NOTED.
 ALL HEADERS TO HAVE (I) 2x4 OR 2x6 JACK AND KII
STUD EACH END, UNLESS OTHERWISE NOTED.
MULTI-OPENING HEADERS TO HAVE (2) JACKS AT
INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. N
ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOL
LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISH

FLOOR PLAN NOTES:

- ALL EXTERIOR WALLS TO BE 4" OR 6" AND ALL INTERIOR WALLS TO BE 3 I/2", UNLESS OTHERWISE NOTEI.
   HATCHED AREAS INDICATE DROPPED CEILINGS. ALL DROPPED CEILINGS ARE I2" UNLESS OTHERWISE NOTED. SEE ARCHITECTURAL DETAIL 8/IT-IB FOR 3/4" FIRE STOPPING AT BULKHEAD / CEILING PANELS
   SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIAL WALL FRAMING LOCATIONS AND HEADER SIZES, IF APPLICABLE.
- 6. SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR INTERIOR TRIM DETAILS.
  7. SEE ARCHITECTURAL DETAIL SHEET "AD" FOR HOUSE SPECIFIC INTERIOR TRIM OPTION TABLE.
- 8. ALL HEADERS IN NON-BEARING WALLS SHALL BE A SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES ABOVE, UNLESS OTHERWISE NOTED.

  9. TANKED WATER HEATER SHOWN AS BASE CONDITIONAL CONTROL OF THE PROPERTY OF THE PR
- OPTIONAL TANKLESS WATER HEATER IS AVAILABLE IN LIEU OF TANKED WATER HEATER.

  10. INTERIOR HEADER HEIGHT FOR 8' CEILING WILL BE 6'-1
- IO. INTERIOR HEADER HEIGHT FOR 8' CEILING WILL BE 6'-II",
  9' CEILING WILL BE 7'-II", IO' CEILING WILL BE 8'-3",
  UNLESS OTHERWISE NOTED.

  II. BASEMENT FINISH DIMENSIONS ASSUME A 1/2" GAP
- BETWEEN FRAME WALL AND CONCRETE WALL.

  12. ALL INTERIOR BEARING WALLS SHALL HAVE GYPSUM
  APPLIED TO AT LEAST ONE SIDE OR HAVE MID-HEIGH
  BLOCKING INSTALLED.

  13. NON-BEARING WALLS OVER CONCRETE TO BE HELD.

3. NON-BEARING WALLS OVER CONCRETE TO BE HELD SHORT OF FRAMING ABOVE.

# GYPSUM NOTES:

AT GARAGE:

GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL FA-I(b) FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.

AT STAIRS:

1/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS

FIRST FLOOR JACK SCHEDULE			E
IDENTIFIER	DESCRIPTION	ENG. NUM.	REMARKS
IOIL	JACK - (5) 2X4 SPF STUD GRADE	1008, 1012	
JI02	JACK - (3) 2X4 SPF STUD GRADE	1006	
EOIL	JACK - (2) 2X4 SPF STUD GRADE	1006	
JIO4	JACK - (2) 2X4 SPF STUD GRADE	1020	
JI <i>0</i> 5	JACK - (5) 2X4 SPF STUD GRADE	2006	
JI06	JACK - (5) 2X4 SPF STUD GRADE	2006	
TOIL	JACK - (4) 2X4 SPF STUD GRADE	1028	
80IL	JACK - (2) 2X4 SPF STUD GRADE	1028	
JII2	JACK - (2) 2X4 SPF STUD GRADE	1022	
EIIL	JACK - (2) 2X4 SPF STUD GRADE	1022	
<b>4</b>	JACK - (4) 2X4 SPF STUD GRADE	1010	
JII5	JACK - (4) 2X6 SPF STUD GRADE	1010	
JII6	JACK - (4) 2X4 SPF STUD GRADE	1010	
TIL	JACK - (5) 2X4 SPF STUD GRADE	1010	
BIIL	JACK - (2) 2X4 SPF STUD GRADE	1018	
PIIL	JACK - (2) 2X4 SPF STUD GRADE	1018	

STEEL COLUMN SCHEDULE				
DENTIFIER	STYLE	HEIGHT	ENG. NUM.	REMARKS
CIOI	STANCHION PORCH - 3 IN DIA IIGA ADJ	7'-10 5/8"	1020	FBA, FCA


LL		
ARING FROM ABOVE		
₹		
KENED SLAB		
N		
PMN		
ME		
PAGE NUMBER		
R TAG	a	
	Ü	
TEL TAG FIRE	<b>4</b>	25
FRAMING ERIAL USAGE	Q	SIMPLY RYAN - 0426
D I/2" HEADER	Ŭ	\
SE NOTED	$\dot{\omega}$	\ \
	\ \_	$\frac{\overline{\Sigma}}{\overline{\Sigma}}$
OR (3) 2x6 w/		1
CK AND KING		Σ Ξ
KS AT	N W W	101 FR 501
E NOTED. NO R CONTINUOUS OTHERWISE		COMM-LOT SAMYERS MILL
O ALL ERWISE NOTED.		
INGS. ALL RWISE NOTED. 3/4" FIRE		
FOR SPECIAL BIZES, IF		
EET(S) FOR		
OR HOUSE		
ALL BE A CRIPPLES	ths to	be o
CONDITION, /AILABLE IN	©NVR, Inc., The owner, expressly reserves its copyright and other property rights in these plans. These plans are not	to be reproduced, changed, or copied in any form or manner whatsoever, nor are they to be
NILL BE 6'-11", 3E 8'-3",	sly res prope	ed, char form or are the
/2" GAP LL.	expressother Thes	duced by fo lor a
E GYPSUM MID-HEIGHT	nc., ner, e	repro in ar er, n
BE HELD I/2"	© NVR, Inc., The owner, copyright an in these plai	to be reproduce copied in any whatsoever, nor
	P A P S ii	t o y


NVR, Inc. 5285 Westview Drive, Suite 100 Frederick, MD 21703

VERSION OI
RELEASE NO. ---DRAWN BY
DATE:
OPTION

DRAWING TITLE
FIRST FLOOR PL
OPTION DESCRIPTION

**1** − **4** 

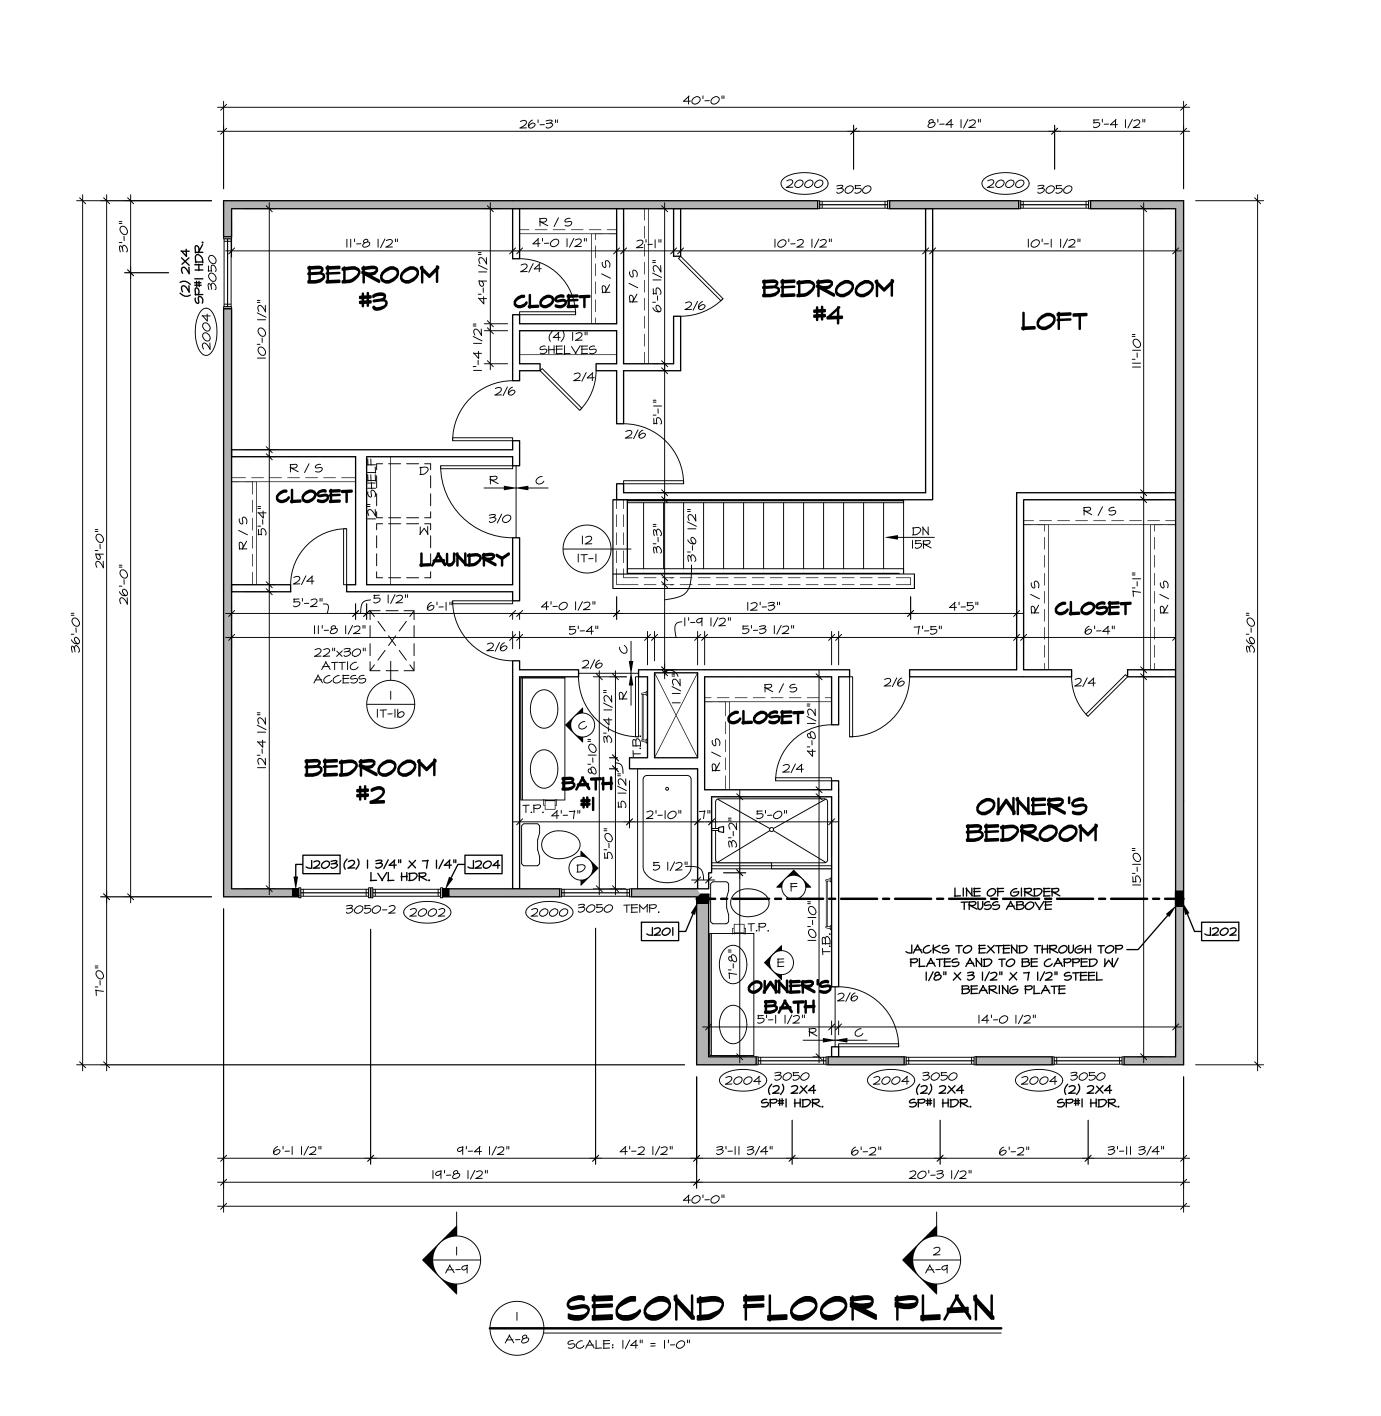

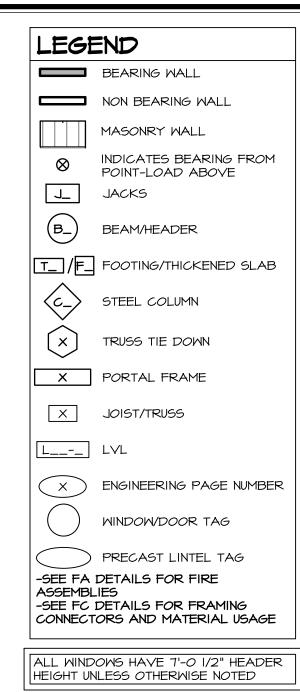

## FLOOR PLAN NOTES:

- ALL HEADERS ARE (2) 2x6 w/ 2x4 WALLS OR (3) 2x6 w/ 2x6 WALLS, UNLESS OTHERWISE NOTED.
   ALL HEADERS TO HAVE (I) 2x4 OR 2x6 JACK AND KING STUD EACH END, UNLESS OTHERWISE NOTED.
   MULTI-OPENING HEADERS TO HAVE (2) JACKS AT INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. NO ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOUS LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISE NOTED.
- ALL EXTERIOR WALLS TO BE 4" OR 6" AND ALL INTERIOR WALLS TO BE 3 I/2", UNLESS OTHERWISE NOTED.
   HATCHED AREAS INDICATE DROPPED CEILINGS. ALL DROPPED CEILINGS ARE I2" UNLESS OTHERWISE NOTED. SEE ARCHITECTURAL DETAIL 8/IT-IB FOR 3/4" FIRE STOPPING AT BULKHEAD / CEILING PANELS
   SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIAL WALL FRAMING LOCATIONS AND HEADER SIZES, IF
- APPLICABLE.

  6. SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR
- INTERIOR TRIM DETAILS.

  7. SEE ARCHITECTURAL DETAIL SHEET "AD" FOR HOUSE SPECIFIC INTERIOR TRIM OPTION TABLE.

  8. ALL HEADERS IN NON-BEARING WALLS SHALL BE A SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES
- ABOVE, UNLESS OTHERWISE NOTED.

  9. TANKED WATER HEATER SHOWN AS BASE CONDITION, OPTIONAL TANKLESS WATER HEATER IS AVAILABLE IN
- LIEU OF TANKED WATER HEATER.

  O. INTERIOR HEADER HEIGHT FOR 8' CEILING WILL BE 6'-II",

  9' CEILING WILL BE 7'-II", IO' CEILING WILL BE 8'-3",
- 9' CEILING WILL BE 1'-II", IO' CEILING WILL BE 8'-3",
  UNLESS OTHERWISE NOTED.

  1. BASEMENT FINISH DIMENSIONS ASSUME A I/2" GAP
  BETWEEN FRAME WALL AND CONCRETE WALL.

  2. ALL INTERIOR BEARING WALLS SHALL HAVE GYPSUM
  APPLIED TO AT LEAST ONE SIDE OR HAVE MID-HEIGHT
- APPLIED TO AT LEAST ONE SIDE OR HAVE MID-HEIGHT BLOCKING INSTALLED.

  3. NON-BEARING WALLS OVER CONCRETE TO BE HELD 1/2" SHORT OF FRAMING ABOVE.

# GYPSUM NOTES:

AT GARAGE:

GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL FA-I(b) FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.

AT STAIRS:

1/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS

SECOND FLOOR JACK SCHEDULE			ILE
IDENTIFIER	DESCRIPTION	ENG. NUM.	REMARKS
J20I	JACK - (3) 2X6 SPF STUD GRADE	2006	
J202	JACK - (5) 2X4 SPF STUD GRADE	2006	
J203	JACK - (2) 2X4 SPF STUD GRADE	2002	
J204	JACK - (2) 2X4 SPF STUD GRADE	2002	


DDEL


LDER

RAWING TITLE


SECOND FLOOR PLAN
PTION DESCRIPTION

**4** 

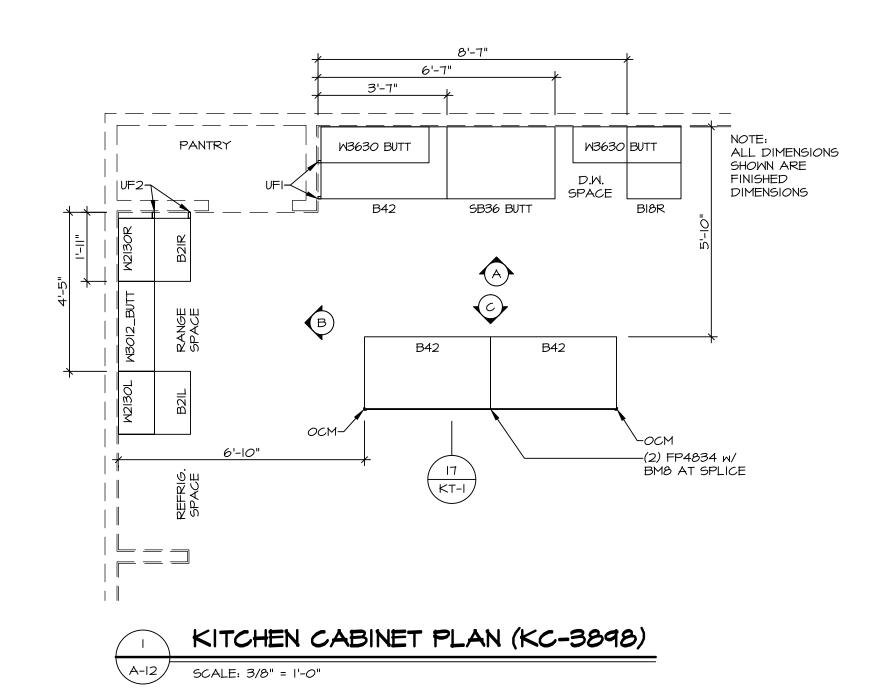


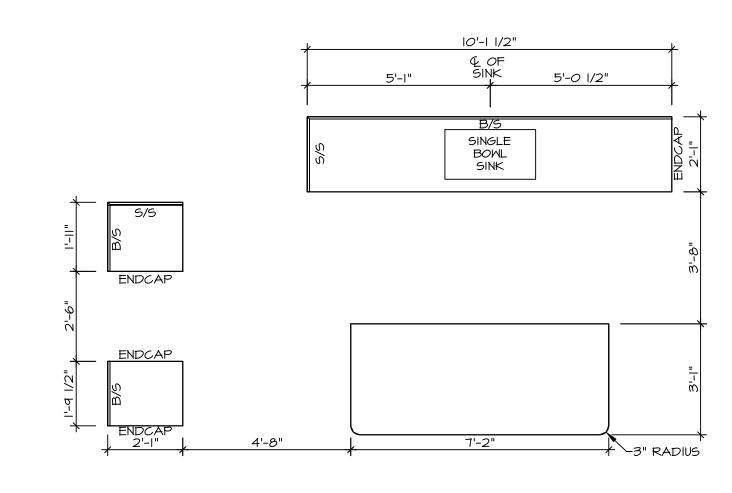


KITCHEN COUNTERTOP PLAN (KT-3898) SCALE: 3/8" = 1'-0"

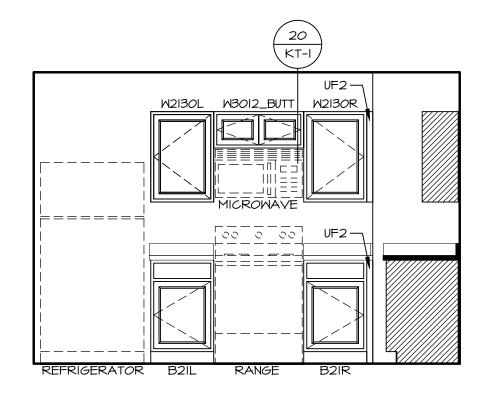



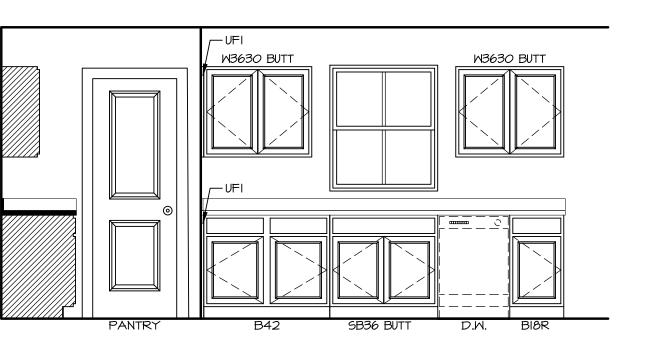



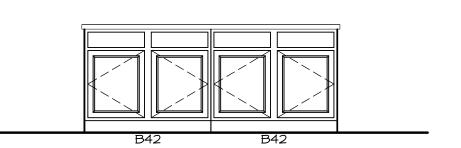

SCALE: 3/8" = 1'-0"

## KITCHEN NOTES:

- I. CABINET LAYOUT (S) ARE BASED ON FINISHED DIMENSIONS TO DRYWALL.

  2. IF KITCHEN PLANS/ELEVATIONS CALL-OUT STANDARD MOLDING, REFER TO STANDARD DETAIL II/KT-I FOR REPLACEMENT BASED ON CABINET STYLE.
- ON CABINET STYLE.

  3. ALL (UF#) FILLERS ARE TO BE "TRIM TO FIT" UNLESS OTHERWISE NOTED.

  4. CABINET MUST BE SET, SHIMMED, LEVELED AND PLUMB W/ ADJOINING BASE CABINETS.


  5. SET PRE-FINISHED SCRIBE MOLDING AT CABINET BULKHEADS AND AT ENDS (WHERE CABINETS MEET DRYWALL.) PRE-FINISHED SCRIBE MOLDING SHALL BE USED TO PAD OUT CABINET SIDES AT STILE FOR RETURN PIECES OF THE FACE-MOUNTED CABINET CROWN MOLDING.

  6. HARDWARE INSTALL NOTE: KNOBS GO ON OPERABLE DOORS AND DRAWERS FOR ALL KITCHEN AND BATH AREAS. DRAWER FRONTS AND DOORS GET (I) KNOB/PULL. NO HARDWARE ON FALSE DRAWER FRONTS. REFER TO STANDARD DETAIL 5/KT-Ib


NOTES:

CABINETS ARE NOT REPRESENTATIVE OF ALL STYLES AND ARE MEANT AS A GENERAL

DEPICTION
OF THE INTENDED CABINET LAYOUT

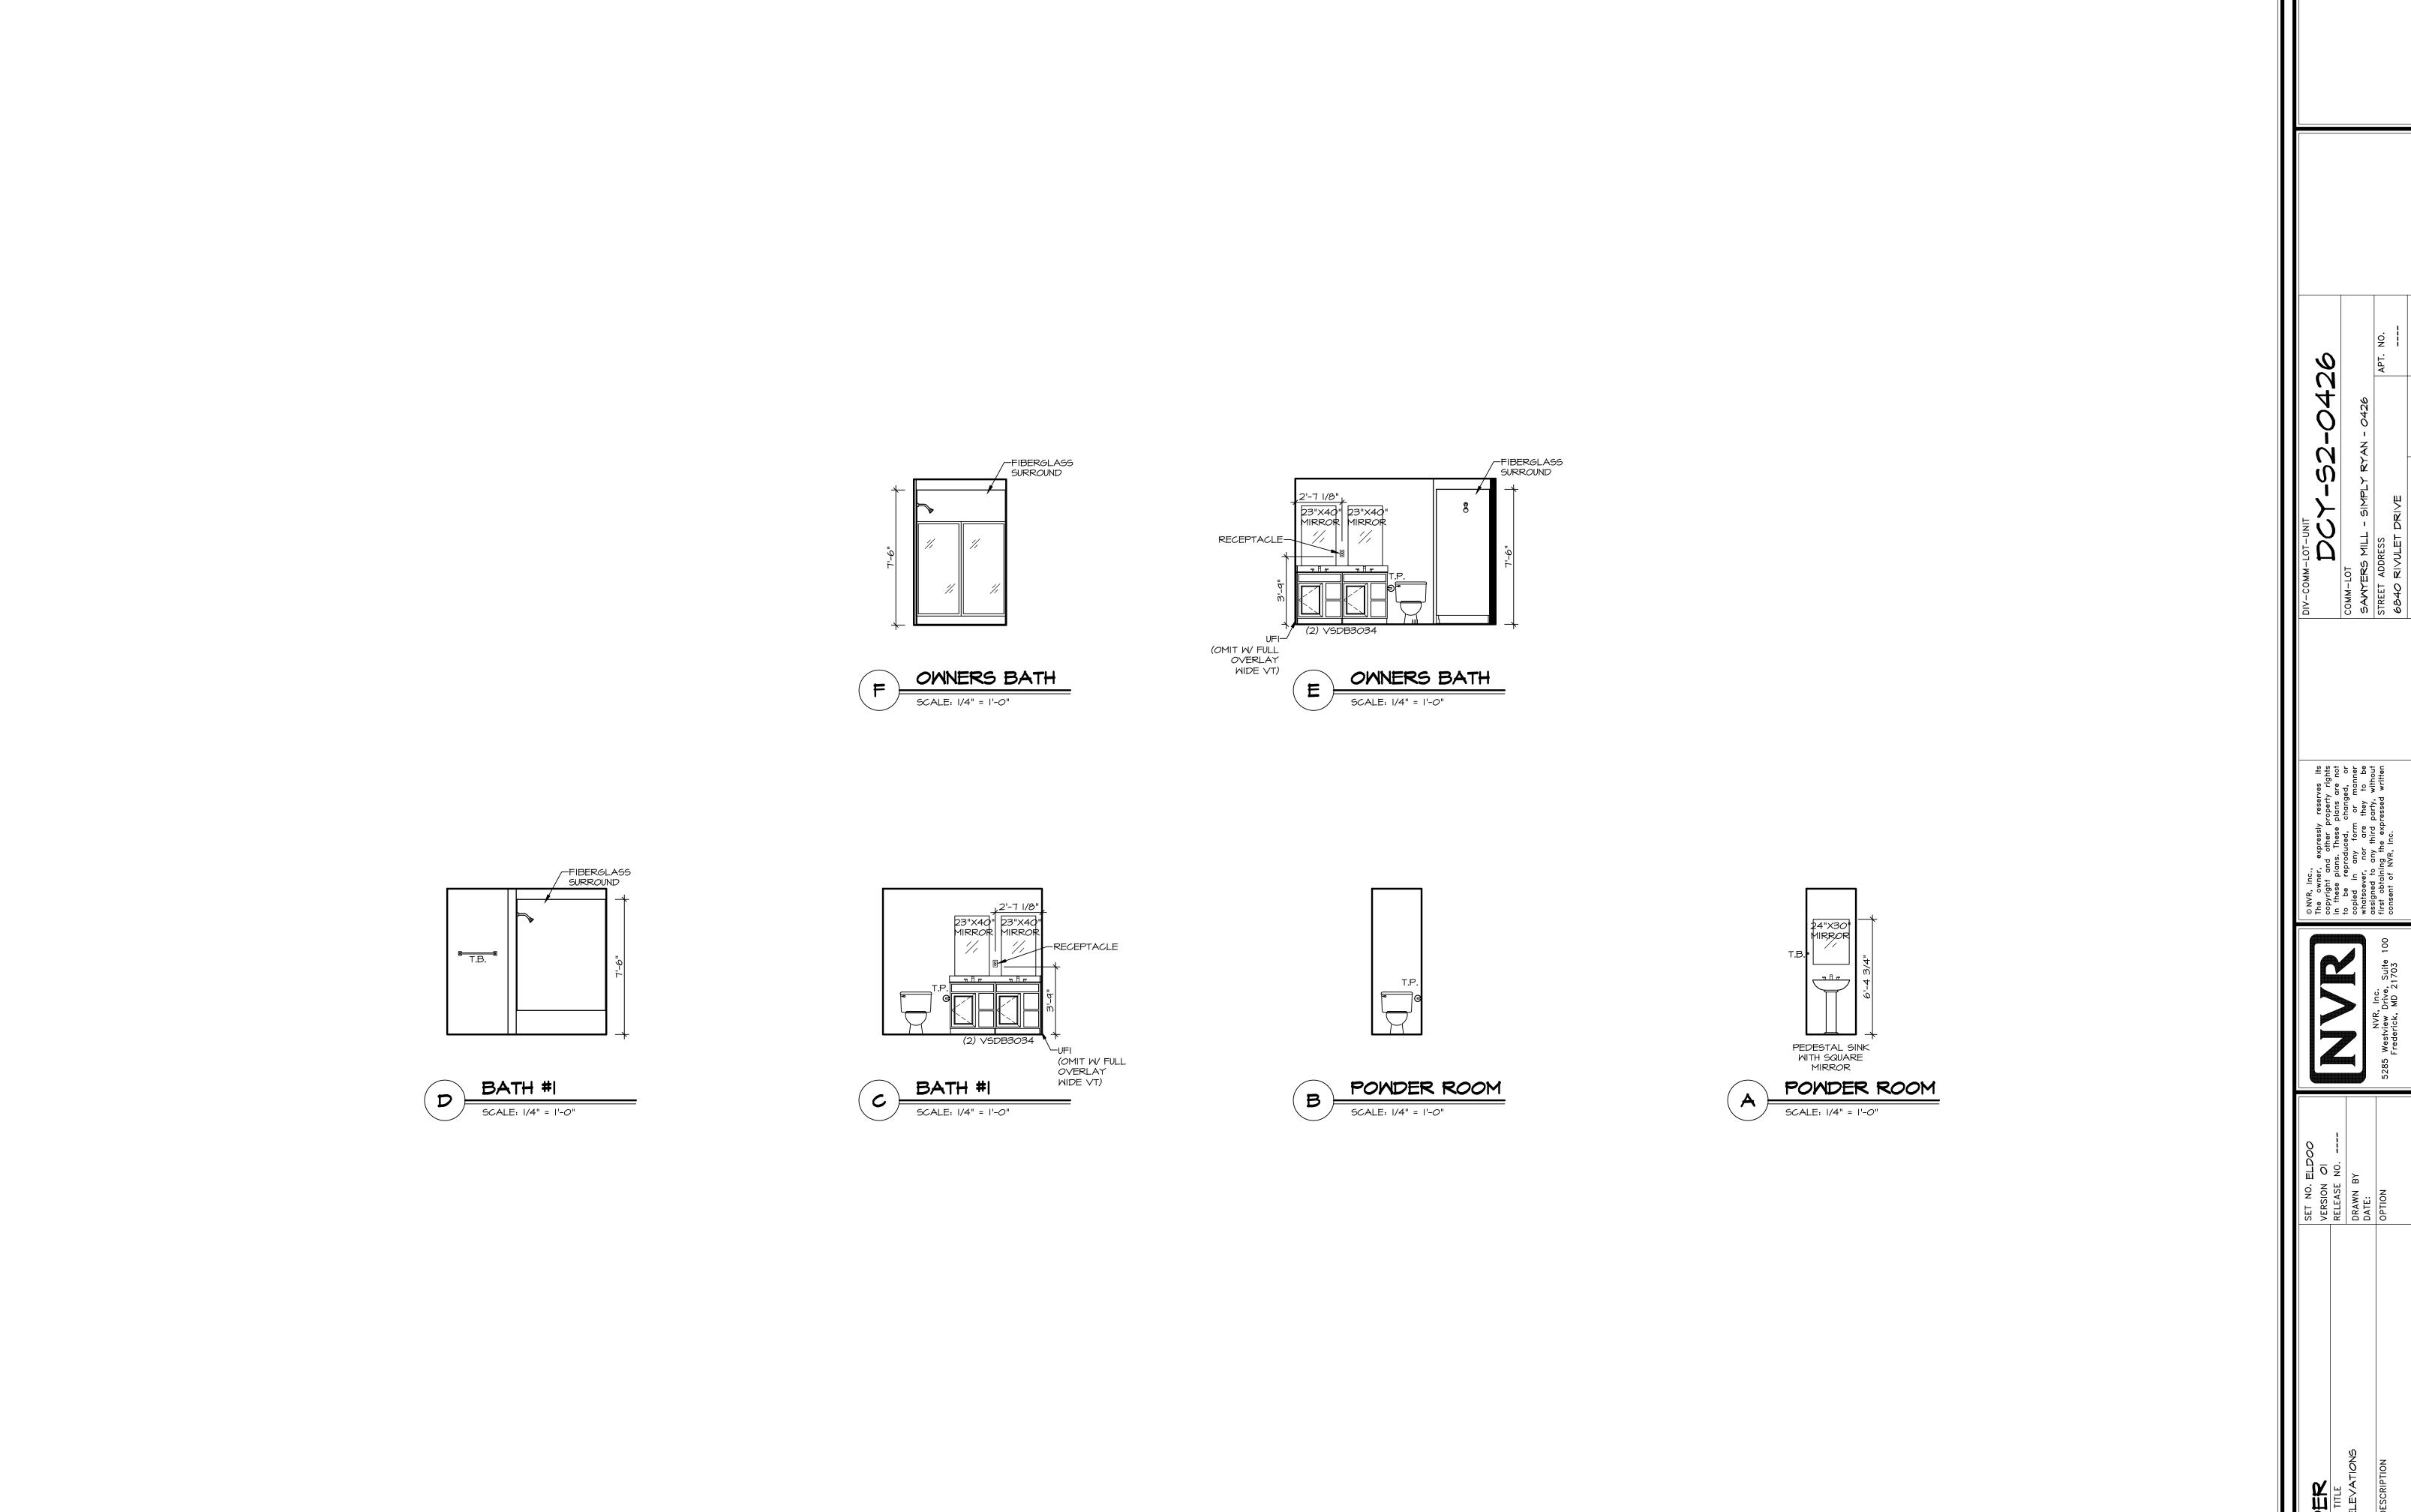

 $\frac{1}{\omega}$ 

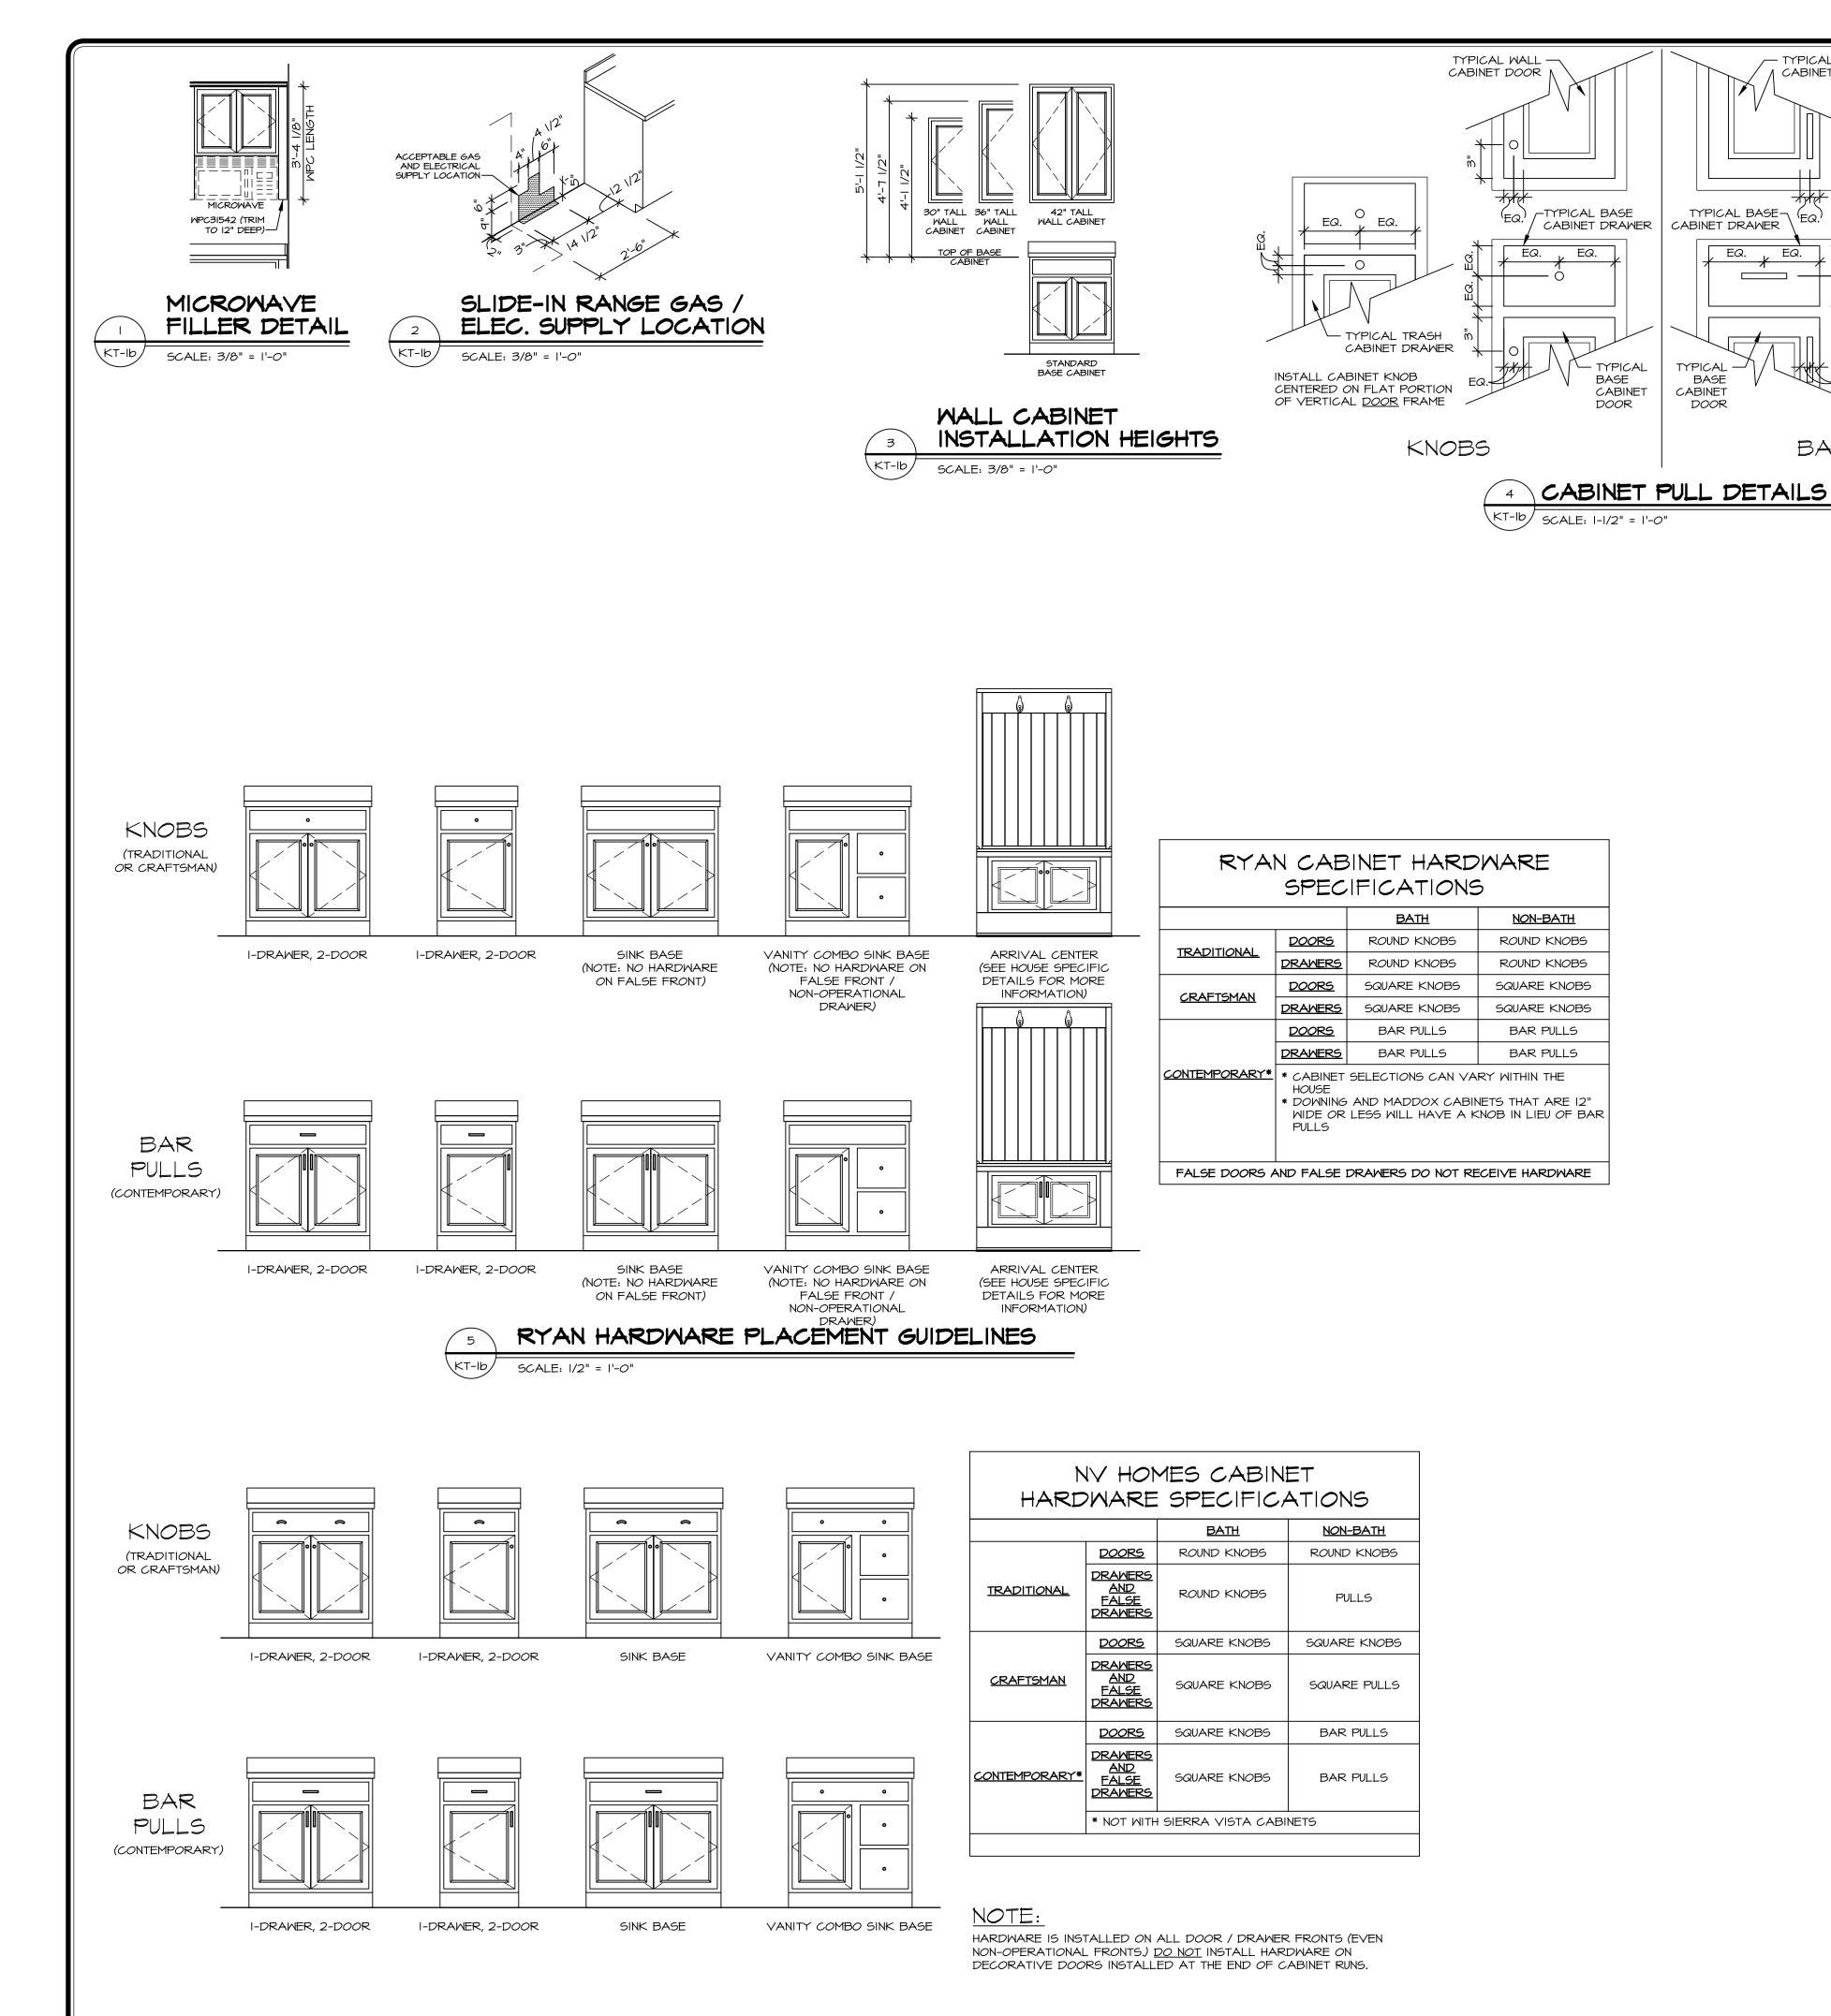

— TYPICAL WALL / CABINET DOOR

> TYPICAL TRASH — CABINET DRAWER

BAR PULLS

INSTALL CABINET BAR PULL CENTERED ON FLAT PORTION OF VERTICAL <u>DOOR</u> FRAME

REV. NO.       DATE       REMARKS         1       3/6/20       SPW - CREATED DETAILS 21 (αC #6415) AND 28 (αC #6411)         2       5/26/21       SPW - ADDED DETAILS 4, 5 ¢ 6/ KT-Ib (Cα #1018)	
© NVR, Inc.  NVR, Inc.  S285 Westview Drive, Suite 100 Frederick, MD 21703	
SET NO. NVR VERSION DRAWN BY DATE: OPTION 5285 W	
SHEET NO.  STANDARD DETAILS  BRAWING TITLE  KITCHEN TRIM DETAILS  GENERAL  OPTION DESCRIPTION	IV PROJECTS/ DETAILS/ NVR Kitchen/ KT1 dwg 02/10/25 = 11:10 am

SCALE: 1/2" = 1'-0"