
S2 430 5890 AUTUMN DRIVE MIDDLETOWN, OH 45042

2 Story Basement
2 hose bibs - no valves required
Vent Kitchen
ice maker
2 tubs
WATER HEATER ELECTRIC 40 GALLON
Inside Water Meter setup

Gas Furnace

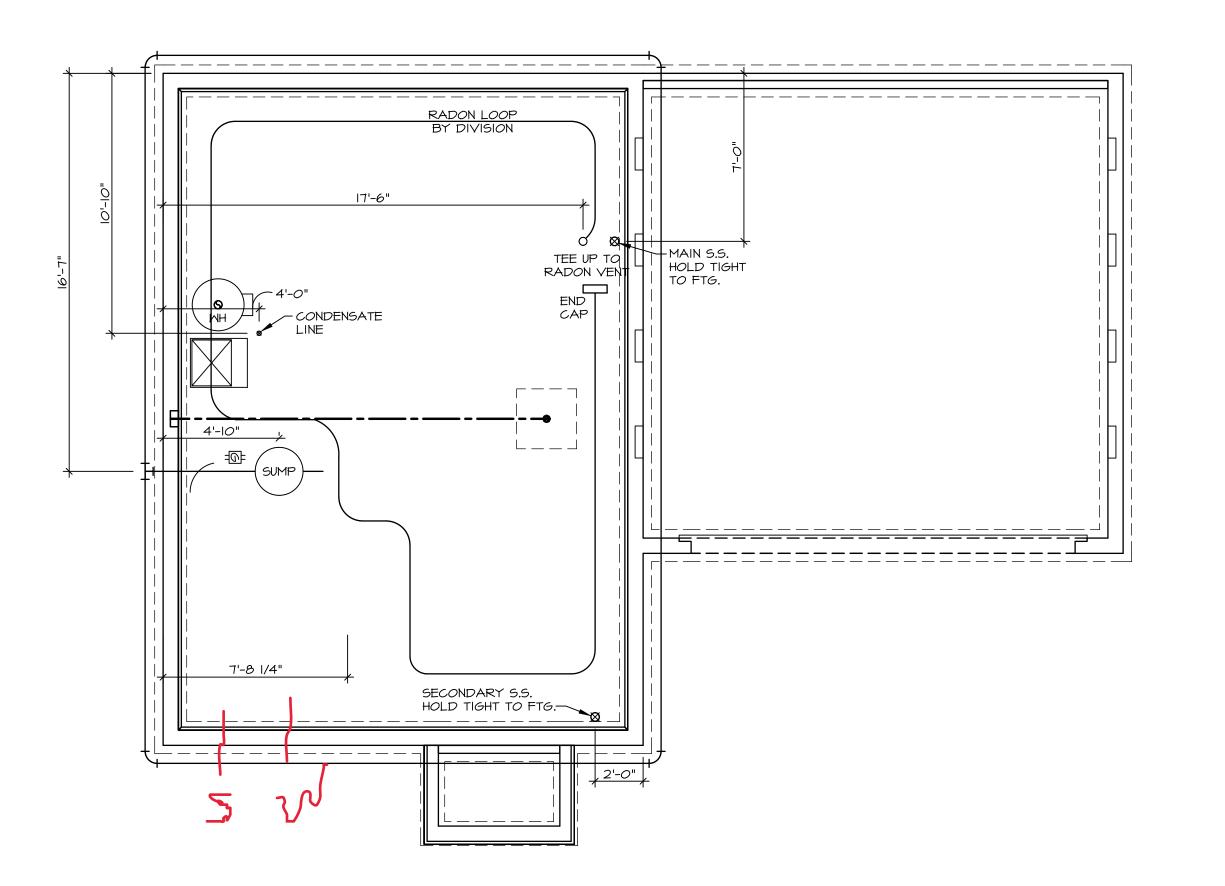

NOTE
RADON REMEDIATION
RADON LOOP:

- (4") PERFORATED HDPE "LOOP"

- MUST BE PLACED IN STONE BED SLIGHTLY HIGHER THAN ANY INTERIOR DRAINTILE

- LOOP TO BE SEPARATE FROM ANY DRAINTILE ELEMENTS

- TO BE CORRUGATED HDPE PIPE

- SCREWS TO BE INSTALLED THROUGH LOOP AT TEE UP INTO STACK
STACK REQUIREMENTS:

- 3" PVC STACK (4" IF BASEMENT IS GREATER THAN 2200 SQFT.)

- NO PART OF STACK IS TO BE HORIZONTAL (45" ELBONS PERMITTED AS REQUIRED)


- PIPE TO BE PHYSICALLY LABELED IN THE FIELD AS "RADON VENT" OR OTHER
JURISDICTIONALLY REQUIRED LANGUAGE (ON EVERY LEVEL OF HOUSE)

- ROOF TERMINATION TO BE IN TOP 1/3 OF ROOF


- SCREEN OR VENT CAP INSTALLED TO KEEP PESTS OUT OF RADON VENT AT ROOF TERMINATION.

PLUMBING PLAN

SCALE: 1/4" = 1'-0"

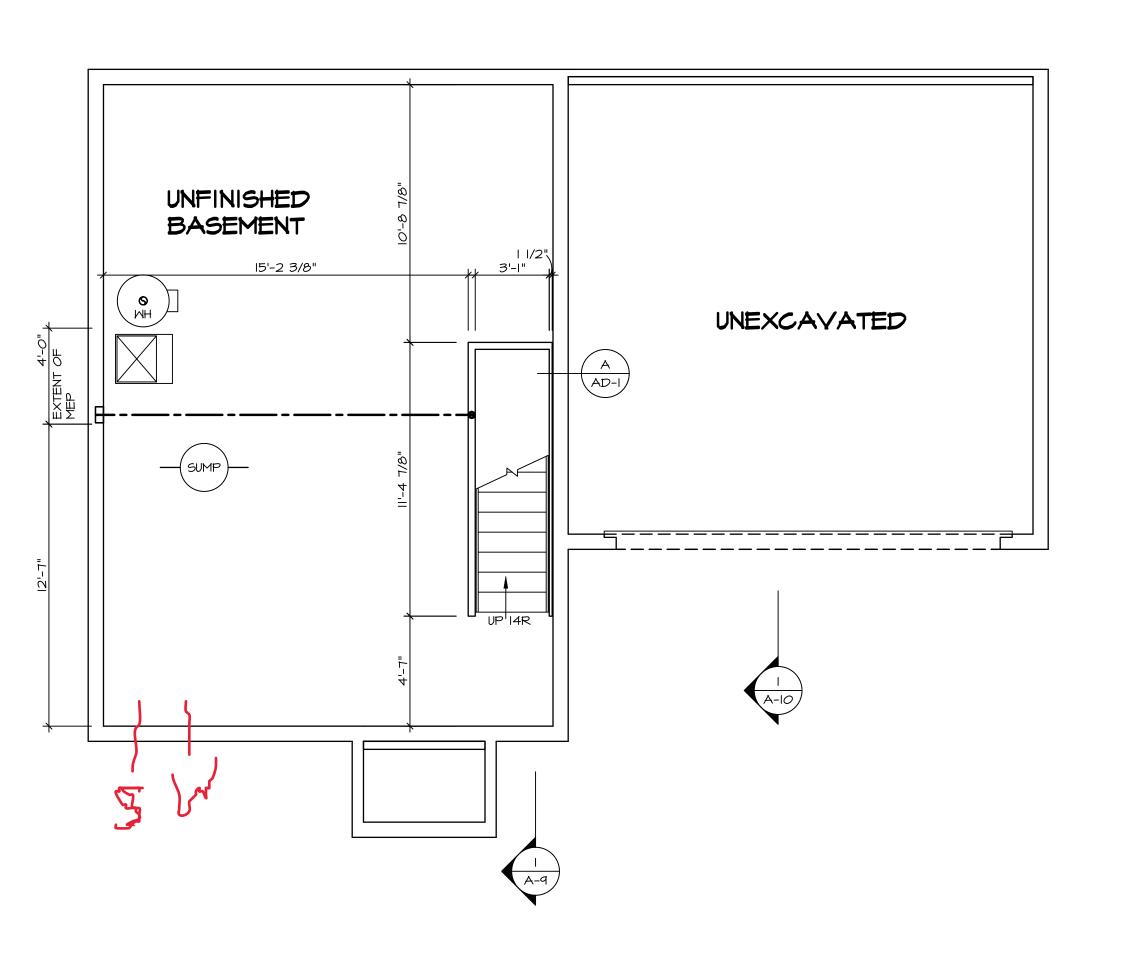



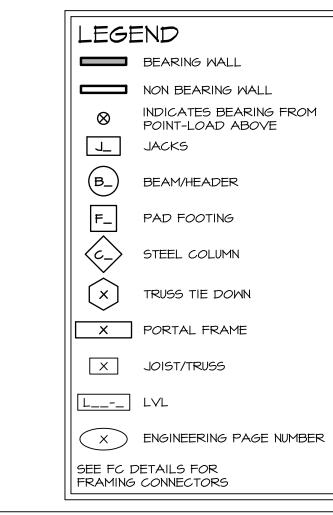

FLOOR PLAN NOTES

ALL HEADERS ARE (2) 2x6 w/ 2x4 WALLS OR (3) 2x6 w/ 2x6 WALLS, UNLESS OTHERWISE NOTED.

2. ALL HEADERS TO HAVE (1) 2x4 OR 2x6 JACK AND KING

INTERIOR WALLS TO BE 3 1/2", UNLESS OTHERWISE NOTED.

STUD EACH END, UNLESS OTHERWISE NOTED.
MULTI-OPENING HEADERS TO HAVE (2) JACKS AT INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. NO ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOUS LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISE

NOTED. 3. ALL EXTERIOR WALLS TO BE 4" W/ OSB OR 3 1/2" W/ LAMINATED FIBROUS STRUCTURAL SHEATHING, ALL

. HATCHED AREAS INDICATE DROPPED CEILINGS. ALL DROPPED CEILINGS ARE 12" UNLESS OTHERWISE NOTED. . SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIAL WALL FRAMING LOCATIONS AND HEADER SIZES, IF APPLICABLE.

. SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR INTERIOR TRIM DETAILS. . SEE ARCHITECTURAL DETAIL SHEET "AD" FOR HOUSE SPECIFIC INTERIOR TRIM OPTION TABLE.

3. ALL WINDOWS HAVE 7'-0 1/2" HEADER HEIGHT UNLESS OTHERWISE NOTED.

1. ALL HEADERS IN NON-BEARING WALLS SHALL BE A SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES

ABOVE, UNLESS OTHERWISE NOTED.

10. TANKED WATER HEATER SHOWN AS BASE CONDITION, OPTIONAL TANKLESS WATER HEATER IS AVAILABLE IN LIEU OF TANKED WATER HEATER.

GYPSUM NOTES


AT GARAGE:

GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL **FA-I(b)** FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.


AT STAIRS:

1/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS

	BASEMENT JACK SCHEDULE						
IDENT	IFIER	DESCRIPTION	ENG. NUM.	REMARKS			

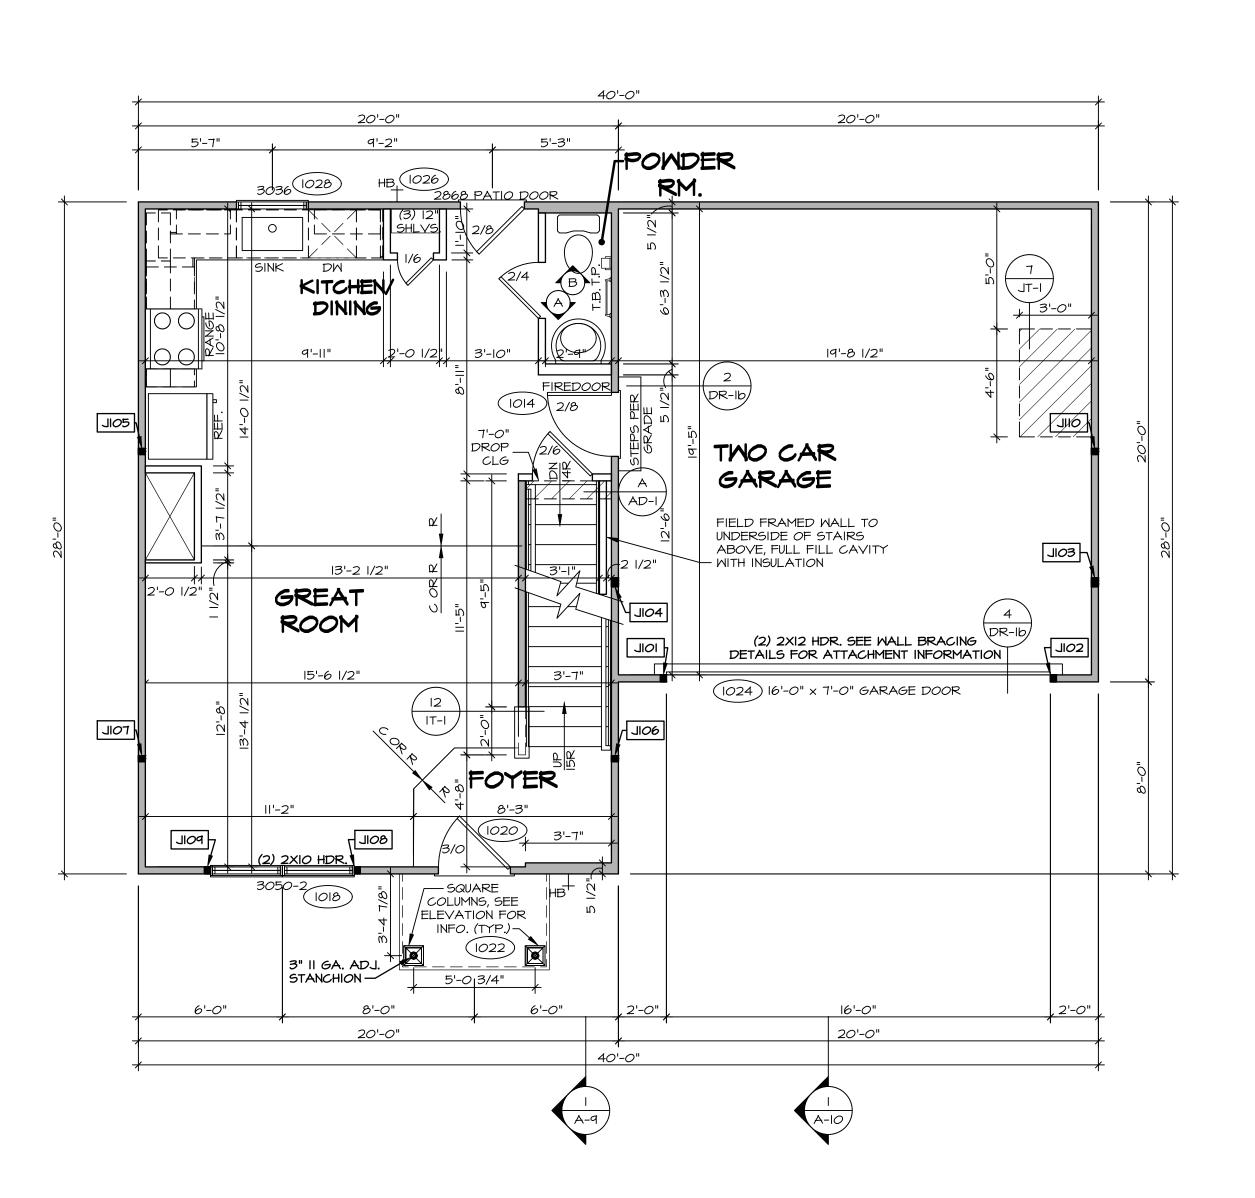



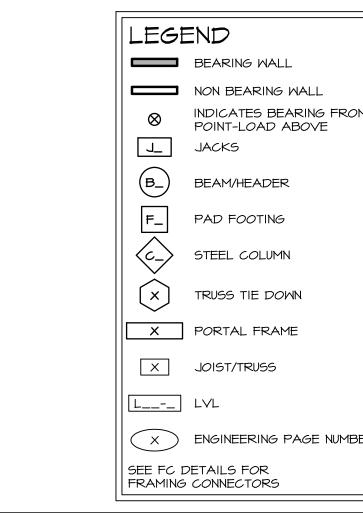

FLOOR PLAN NOTES

ALL HEADERS ARE (2) 2x6 w/ 2x4 MALLS OR (3) 2x6 2x6 WALLS, UNLESS OTHERWISE NOTED. 2. ALL HEADERS TO HAVE (1) 2x4 OR 2x6 JACK AND K STUD EACH END, UNLESS OTHERWISE NOTED.

MULTI-OPENING HEADERS TO HAVE (2) JACKS AT INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUO LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWIS NOTED.

3. ALL EXTERIOR WALLS TO BE 4" W/ OSB OR 3 1/2" W/ LAMINATED FIBROUS STRUCTURAL SHEATHING, ALL INTERIOR WALLS TO BE 3 1/2", UNLESS OTHERWISE NO

. HATCHED AREAS INDICATE DROPPED CEILINGS. ALL DROPPED CEILINGS ARE 12" UNLESS OTHERWISE NOTE SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPEC WALL FRAMING LOCATIONS AND HEADER SIZES, IF APPLICABLE. . SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR

INTERIOR TRIM DETAILS. SEE ARCHITECTURAL DETAIL SHEET "AD" FOR HOUSE

SPECIFIC INTERIOR TRIM OPTION TABLE. B. ALL WINDOWS HAVE **7'-0 I/2"** HEADER HEIGHT UNLESS OTHERWISE NOTED. ALL HEADERS IN NON-BEARING WALLS SHALL BE A SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES

ABOVE, UNLESS OTHERWISE NOTED.

10. TANKED WATER HEATER SHOWN AS BASE CONDITION, OPTIONAL TANKLESS WATER HEATER IS AVAILABLE I LIEU OF TANKED WATER HEATER.

GYPSUM NOTES

AT GARAGE:

GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL FA-I(b) FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.


AT STAIRS:

1/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WAL


FIRST FLOOR JACK SCHEDULE						
IDENTIFIER	DESCRIPTION	ENG. NUM.	REMARKS			
IOIL	JACK - (2) 2X4 SPF STUD GRADE	1024				
JI02	JACK - (2) 2X4 SPF STUD GRADE	1024				
SOIL	JACK - (3) 2X4 SP#I	1016				
JI04	JACK <i>- (3)</i> 2X4 SP#I	1016				
JI05	JACK - (2) 2X4 SPF STUD GRADE	1012				
JI06	JACK - (2) 2X4 SPF STUD GRADE	1012				
TOIL	JACK - (2) 2X4 SPF STUD GRADE	1012				
80IC	JACK - (2) 2X4 SPF STUD GRADE	1018				
POIL	JACK - (2) 2X4 SPF STUD GRADE	1018				
<u> </u>	JACK - (2) 2X4 SPF STUD GRADE	1012				

FIELD	FIELD INSTALLED FIRST FLOOR BEAM/HEADER SCHEDULE					
IDENTIFIER	DESCRIPTION	LENGTH	ENG. NUM.	REMARKS		

<i>O</i> M					
IBER	i 442				
	APT. NO. ZIP 45042				
KING NO JOUS ISE	STATE OH OH				
JSE L OTED. L IED. ECIAL DR E	DIV-COMM-LOT-UNIT DCY-S2-O4 COMM-LOT SAMYERS MILL - SIMPLY RYAN - 0430 STREET ADDRESS 5840 AUTUMN DRIVE CITY MIDDLETOWN OH				
N, E IN					
© NVR, Inc., The owner, expressly reserves its copyright and other property rights in these plans. These plans are not to be reproduced, changed, or copied in any form or manner whatsoever, nor are they to be assigned to any third party, without first obtaining the expressed written consent of NVR, Inc.					
	NVR, Inc. 5285 Westview Drive, Suite 100 Frederick, MD 21703				
	SET NO. ASPOO VERSION OI RELEASE NO DRAWN BY DATE: OPTION				

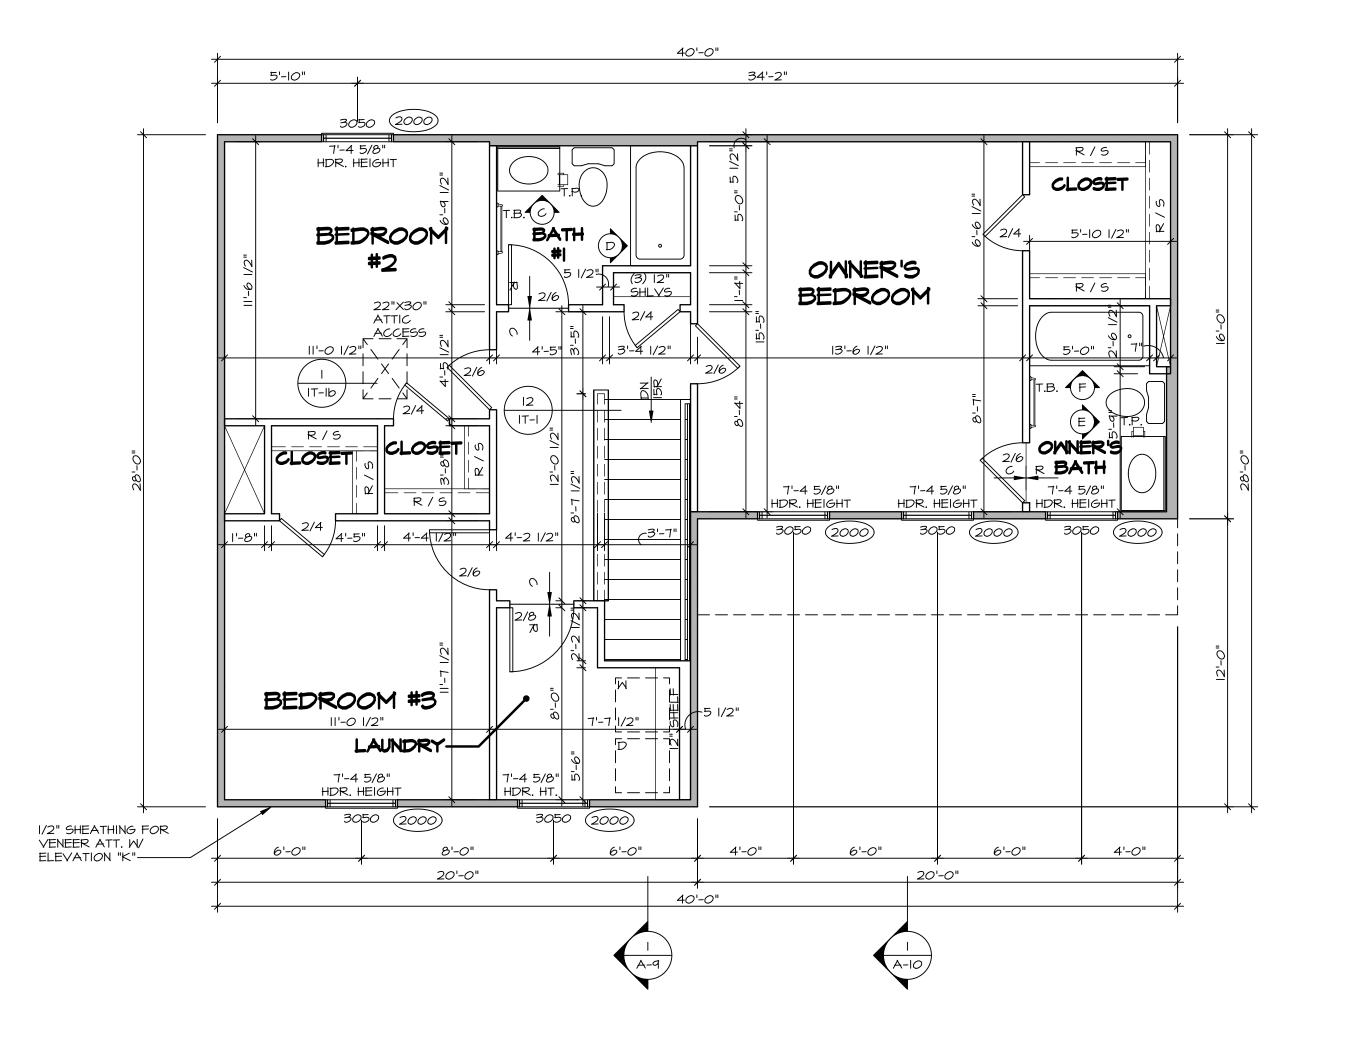



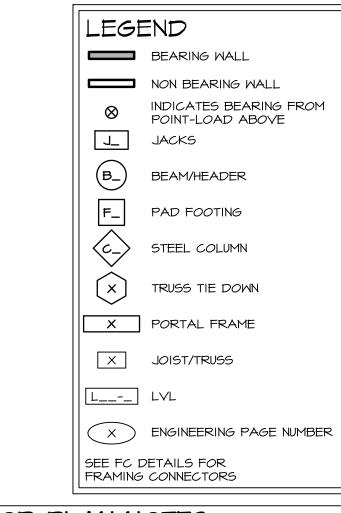

FLOOR PLAN NOTES

ALL HEADERS ARE (2) 2x6 w/ 2x4 WALLS OR (3) 2x6 w/ 2x6 WALLS, UNLESS OTHERWISE NOTED.

2. ALL HEADERS TO HAVE (1) 2x4 OR 2x6 JACK AND KING STUD EACH END, UNLESS OTHERWISE NOTED.
MULTI-OPENING HEADERS TO HAVE (2) JACKS AT INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. NO ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOUS LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISE

NOTED. 3. ALL EXTERIOR WALLS TO BE 4" W/ OSB OR 3 1/2" W/ LAMINATED FIBROUS STRUCTURAL SHEATHING, ALL INTERIOR WALLS TO BE 3 1/2", UNLESS OTHERWISE NOTED.

. HATCHED AREAS INDICATE DROPPED CEILINGS. ALL DROPPED CEILINGS ARE 12" UNLESS OTHERWISE NOTED. SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIAL WALL FRAMING LOCATIONS AND HEADER SIZES, IF APPLICABLE. . SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR

INTERIOR TRIM DETAILS. SEE ARCHITECTURAL DETAIL SHEET "AD" FOR HOUSE SPECIFIC INTERIOR TRIM OPTION TABLE. 3. ALL WINDOWS HAVE 7'-0 1/2" HEADER HEIGHT UNLESS OTHERWISE NOTED.

ALL HEADERS IN NON-BEARING WALLS SHALL BE A

SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES ABOVE, UNLESS OTHERWISE NOTED.
O. TANKED WATER HEATER SHOWN AS BASE CONDITION, OPTIONAL TANKLESS WATER HEATER IS AVAILABLE IN LIEU OF TANKED WATER HEATER.


GYPSUM NOTES

AT GARAGE:


GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL FA-I(b) FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.

AT STAIRS:

1/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS

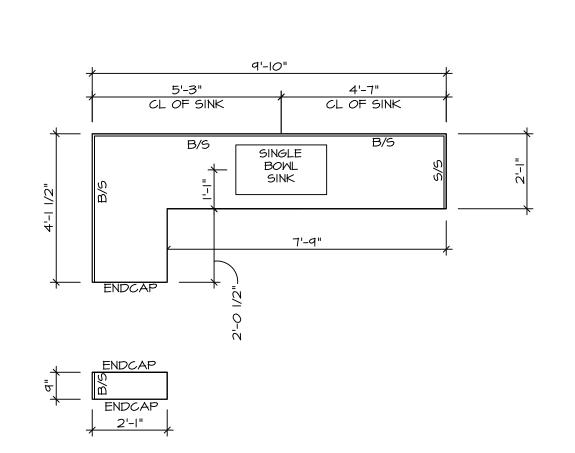


KITCHEN COUNTERTOP PLAN KC - 3639 A-12 SCALE: 3/8" = 1'-0"

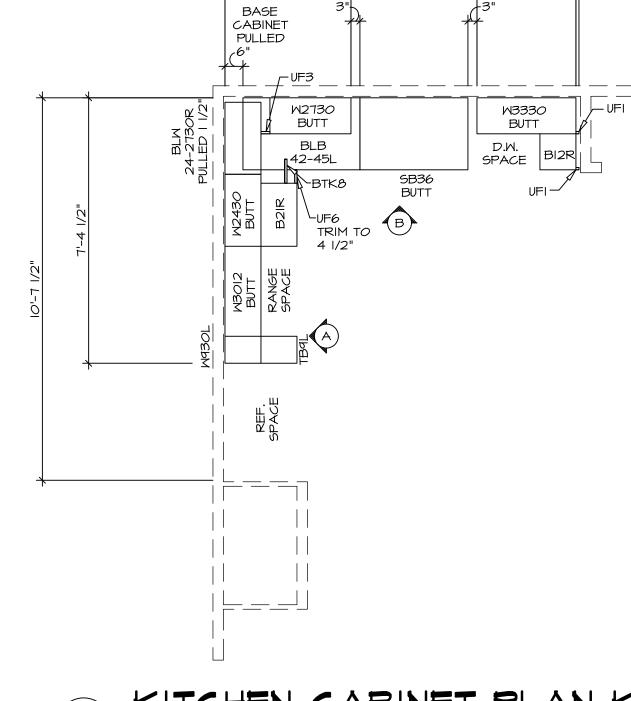


9'-9"

KITCHEN CABINET PLAN KC - 3639 A-12 SCALE: 3/8" = 1'-0"

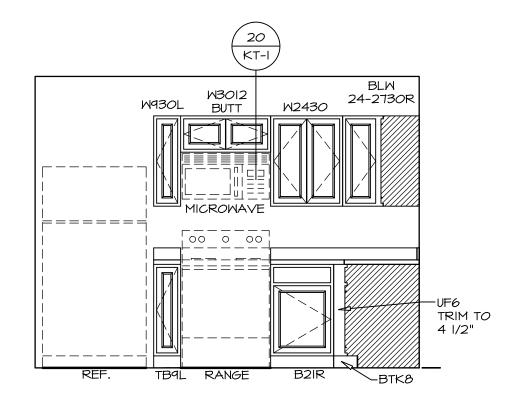



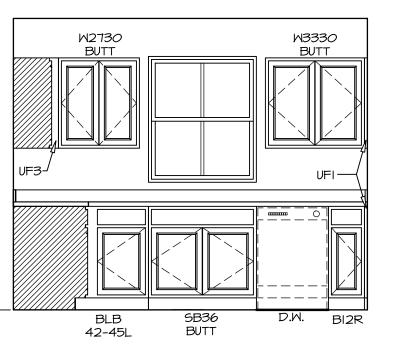



NOTES:
CABINETS ARE NOT REPRESENTATIVE OF ALL
STYLES AND ARE MEANT AS A GENERAL
DEPICTION OF THE INTENDED CABINET LAYOUT

NOTES:

- I. CABINET LAYOUT (S) ARE BASED ON FINISHED DIMENSIONS TO DRYWALL.

 2. IF KITCHEN PLANS/ELEVATIONS CALL-OUT STANDARD MOLDING, REFER TO STANDARD DETAIL (II/KT-I) FOR REPLACEMENT BASED ON CABINET STYLE.

 3. ALL (IE#) FILLERS ARE TO BE "TRIM TO FIT"
- 3. ALL (UF#) FILLERS ARE TO BE "TRIM TO FIT" UNLESS OTHERWISE NOTED.

 4. CABINET MUST BE SET, SHIMMED, LEVELED
- AND PLUMB W/ ADJOINING BASE CABINETS. 5. SET PRE-FINISHED SCRIBE MOLDING AT CABINET BULKHEADS AND AT ENDS (WHERE CABINETS MEET DRYWALL.) PRE-FINISHED= SCRIBE MOLDING SHALL BE USED TO PAD OUT CABINET SIDES AT STILE FOR RETURN PIECES OF THE FACE-MOUNTED CABINET CROWN MOLDING.