


NATE !

**MAKE SURE SUMP INSTALLED
ALL PVC LINES ASIDE OF ONE 2" RISER CAPPED OFF !!**

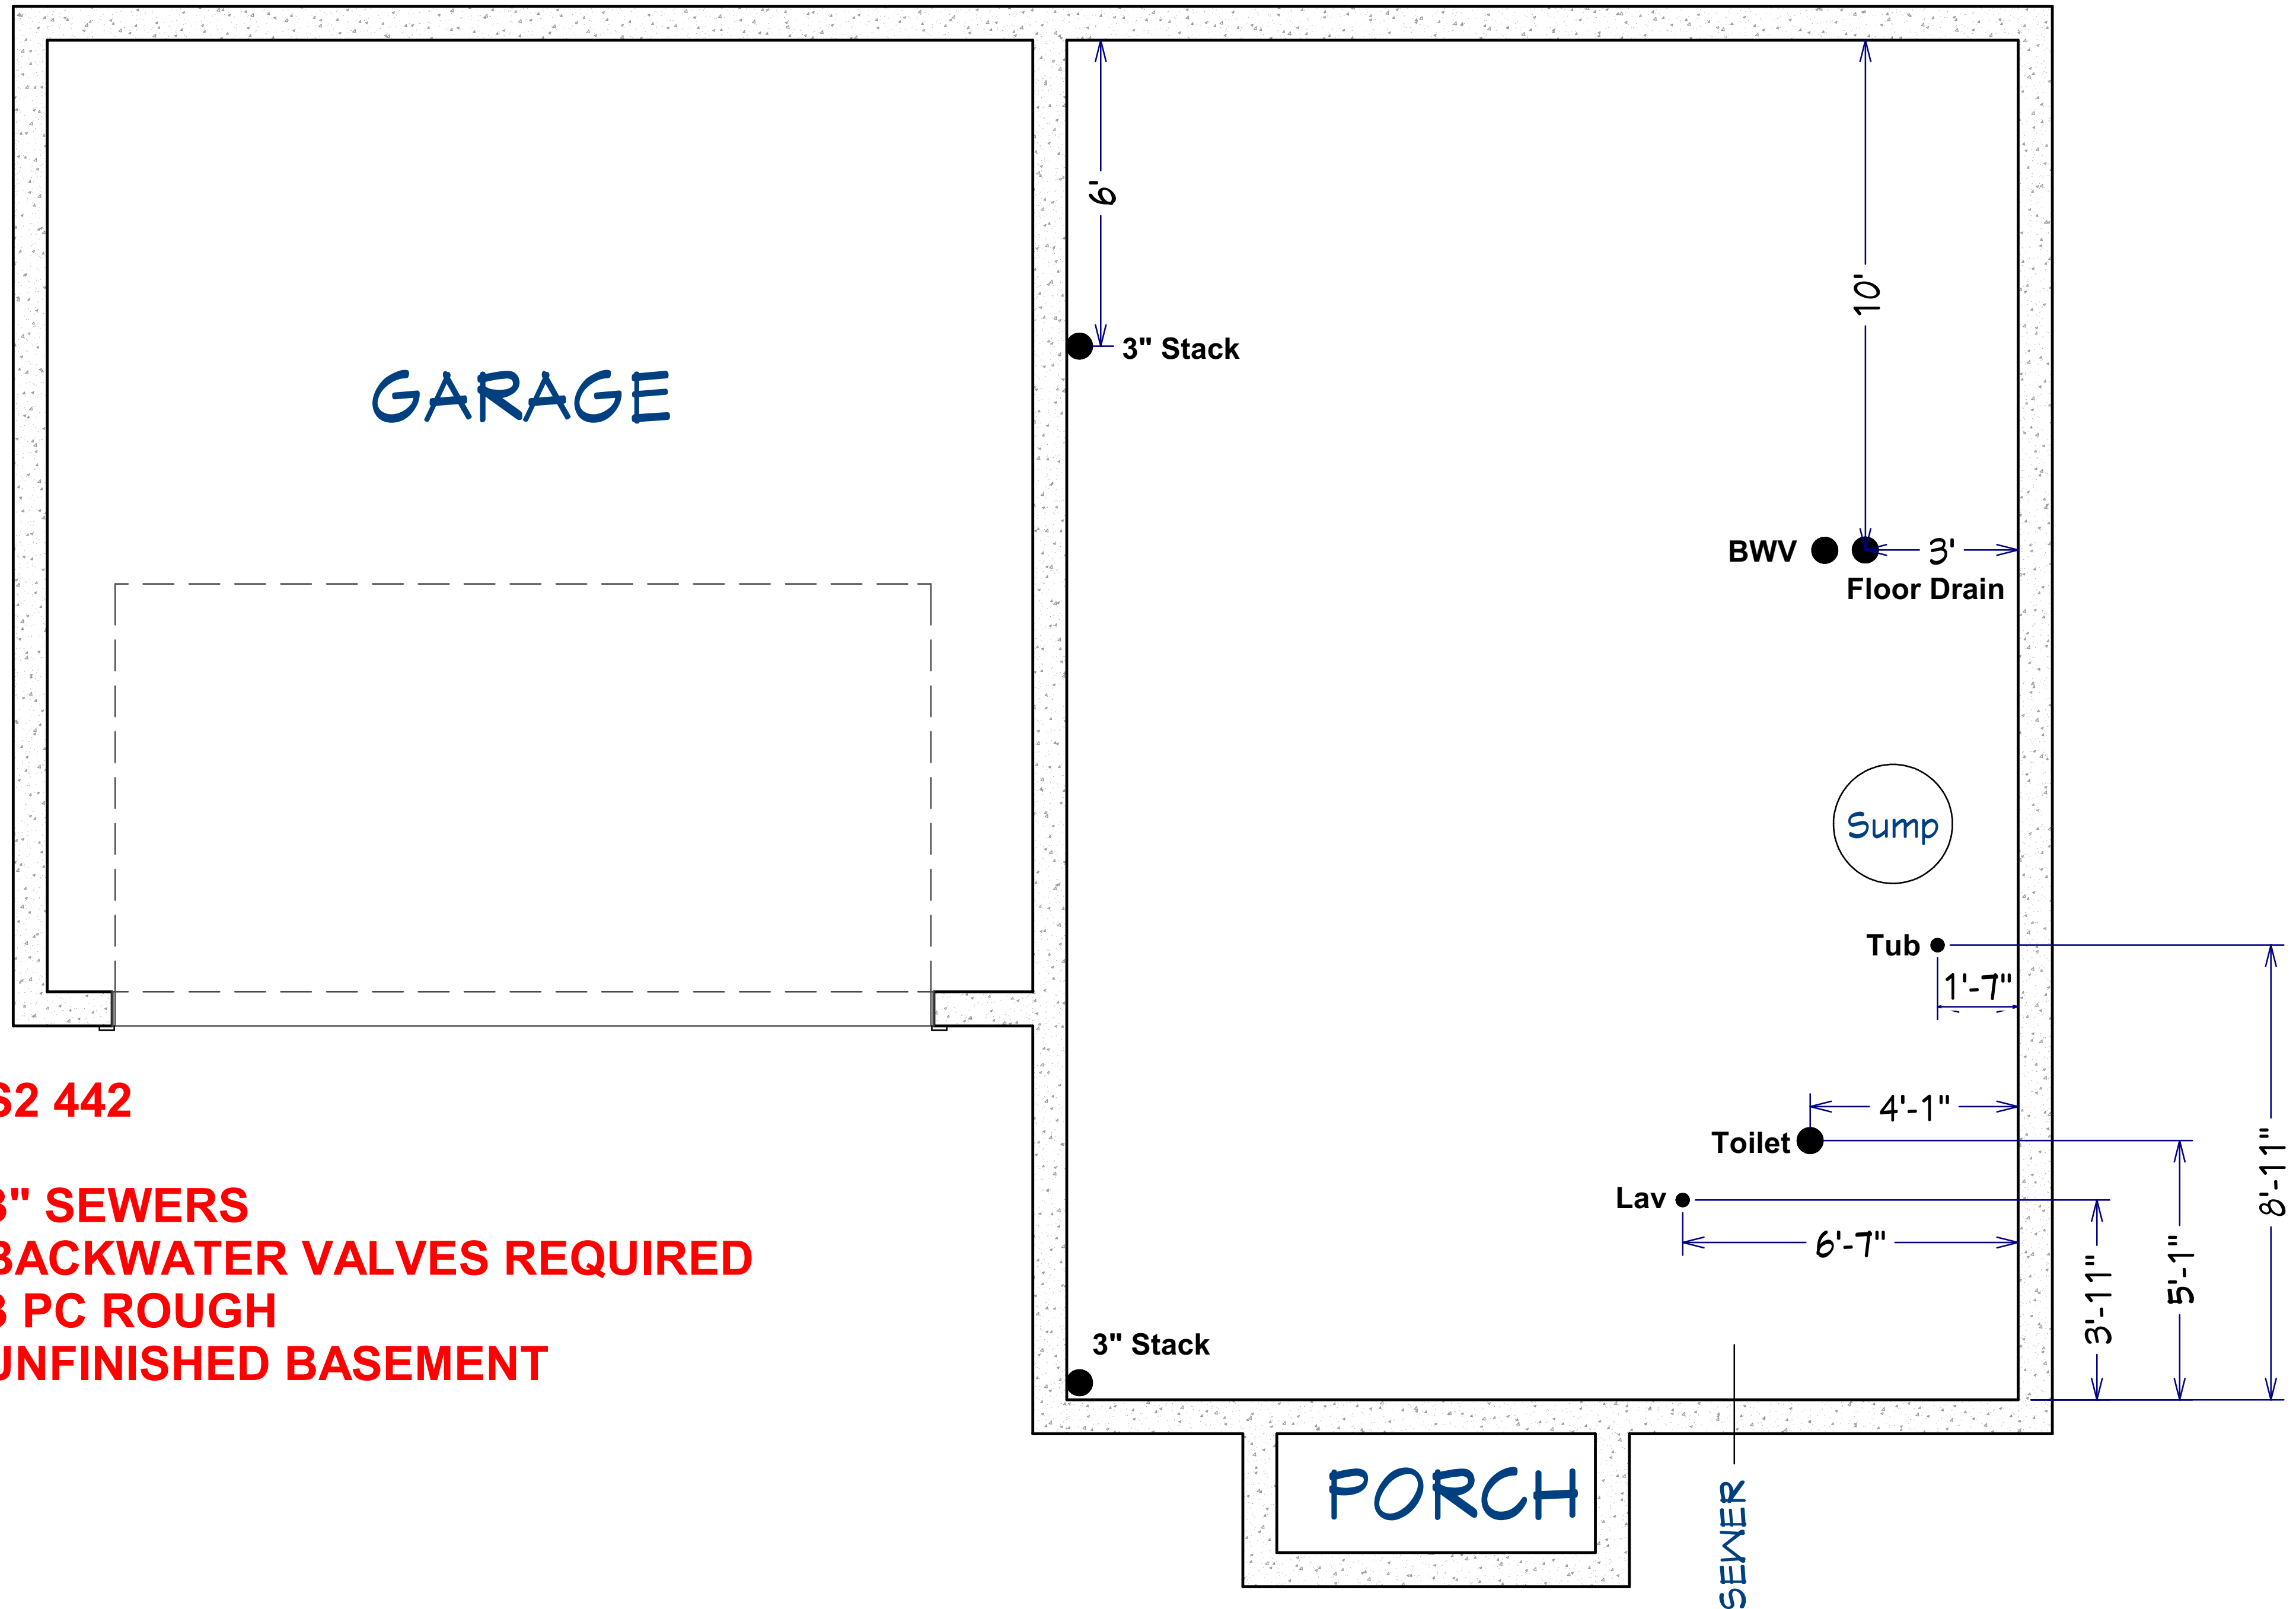

S2 442

**3" SEWERS
BACKWATER VALVES REQUIRED
3 PC ROUGH
UNFINISHED BASEMENT**