
S2 455 6875 RIVULET DRIVE MIDDLETOWN, OH 45042

1 Story Basement
2 hose bibs - no valves required
Vent Kitchen
ice maker
1 tub
1 shower
WATER HEATER ELECTRIC 40 GALLON
Inside Water Meter setup

Gas Furnace and Range

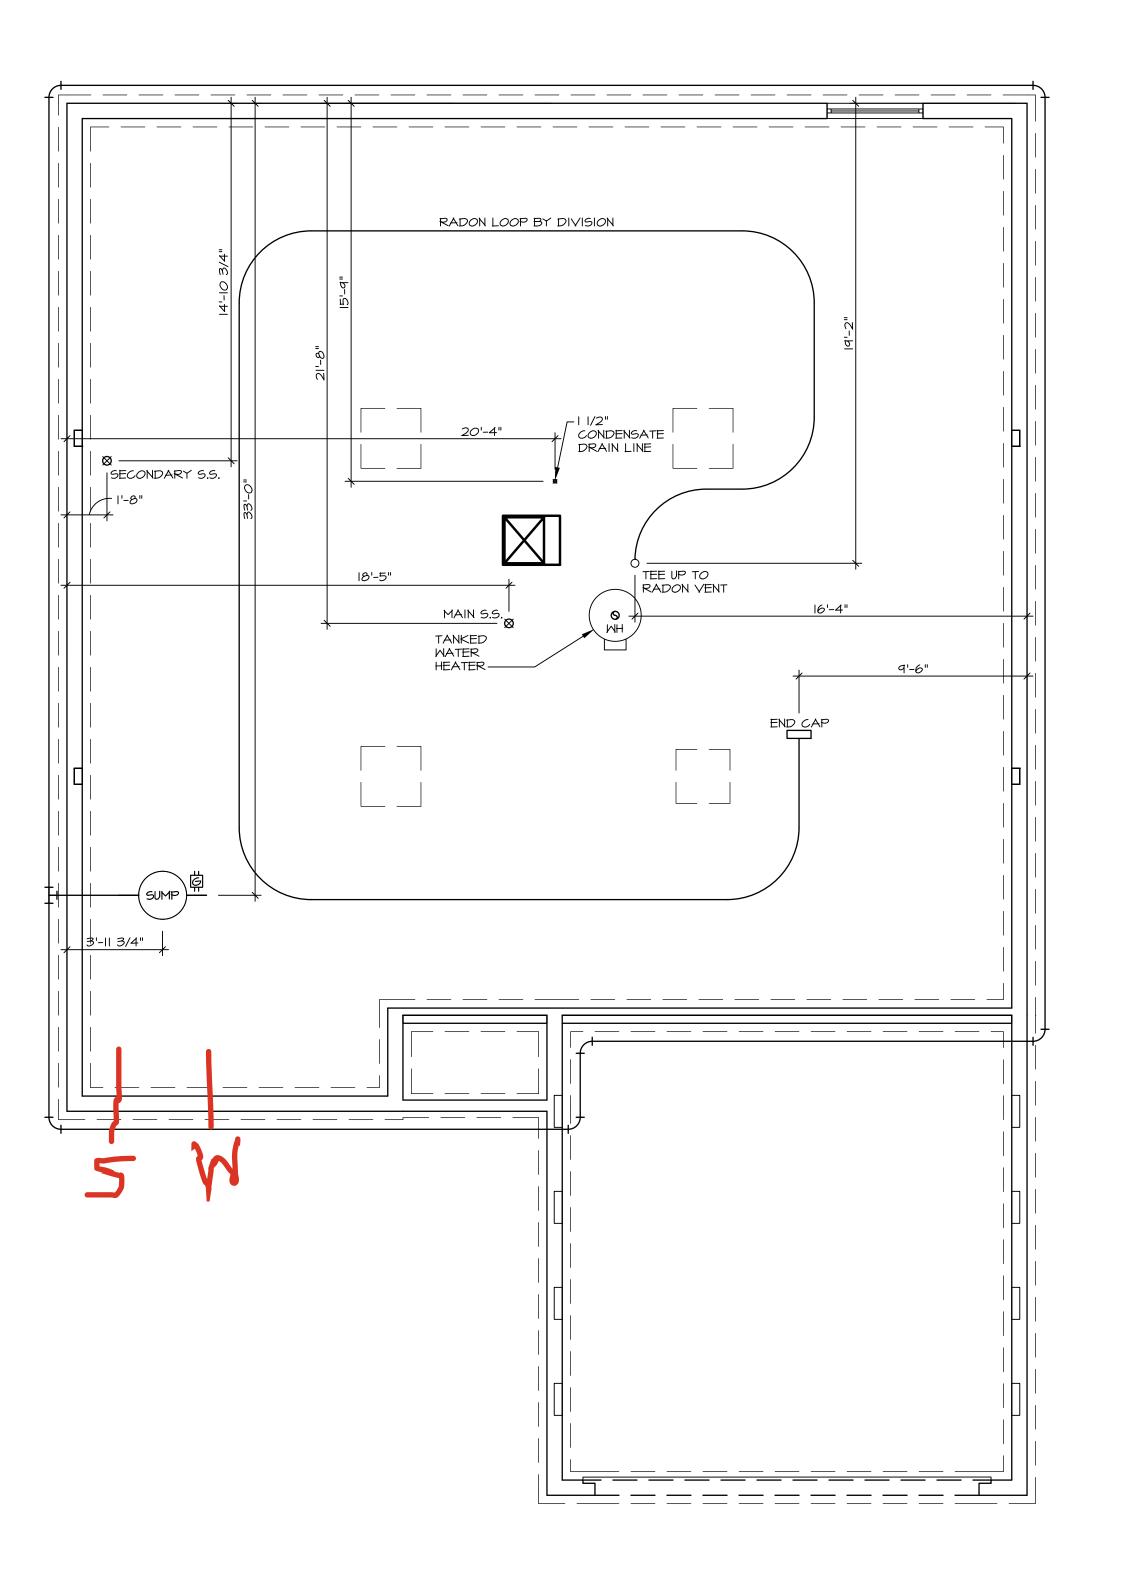


PLUMBING PLAN


SCALE: 1/4" = 1'-0"

RADON REMEDIATION
RADON LOOP:

- (4") PERFORATED HDPE "LOOP"
- MUST BE PLACED IN STONE BED SLIGHTLY HIGHER THAN ANY INTERIOR DRAINTILE
- LOOP TO BE SEPARATE FROM ANY DRAINTILE ELEMENTS
- TO BE CORRUGATED HDPE PIPE
- SCREWS TO BE INSTALLED THROUGH LOOP AT TEE UP INTO STACK
STACK REQUIREMENTS:
- 3" PVC STACK (4" IF BASEMENT IS GREATER THAN 2200 SQFT.)
- NO PART OF STACK IS TO BE HORIZONTAL (45° ELBOWS PERMITTED AS REQUIRED)
- PIPE TO BE PHYSICALLY LABELED IN THE FIELD AS "RADON VENT" OR OTHER
JURISDICTIONALLY REQUIRED LANGUAGE (ON EVERY LEVEL OF HOUSE)
- ROOF TERMINATION TO BE IN TOP 1/3 OF ROOF
- SCREEN OR VENT CAP INSTALLED TO KEEP PESTS OUT OF RADON VENT AT ROOF TERMINATION.

MODEL TOPELO	SET NO. TUPOO VERSION OI BELFASE NO		© NVR, Inc., The owner, expressly reserves its copyright and other property rights in these plans. These plans are not	DIV-COMM-LOT-UNIT	or-unit DCY-52-0455	it)
	DRAWN BY HNP		to be reproduced, changed, or copied in any form or manner whatsoever, nor are they to be	SAMYERS MILL - SIMPLY RYAN - 0455	LY RYAN - 0455	
OPTION DESCRIPTION	OPTION	NVR, Inc. 5285 Westview Drive, Suite 100	assigned to any third party, without first obtaining the expressed written	STREET ADDRESS		APT. NO.
		Frederick, MD 21703	consent of NVK, Inc.	6875 RIVULET DRIVE		!
				CITY	STATE	ZIP
				MIDDLETOWN	<u>Q</u>	45042

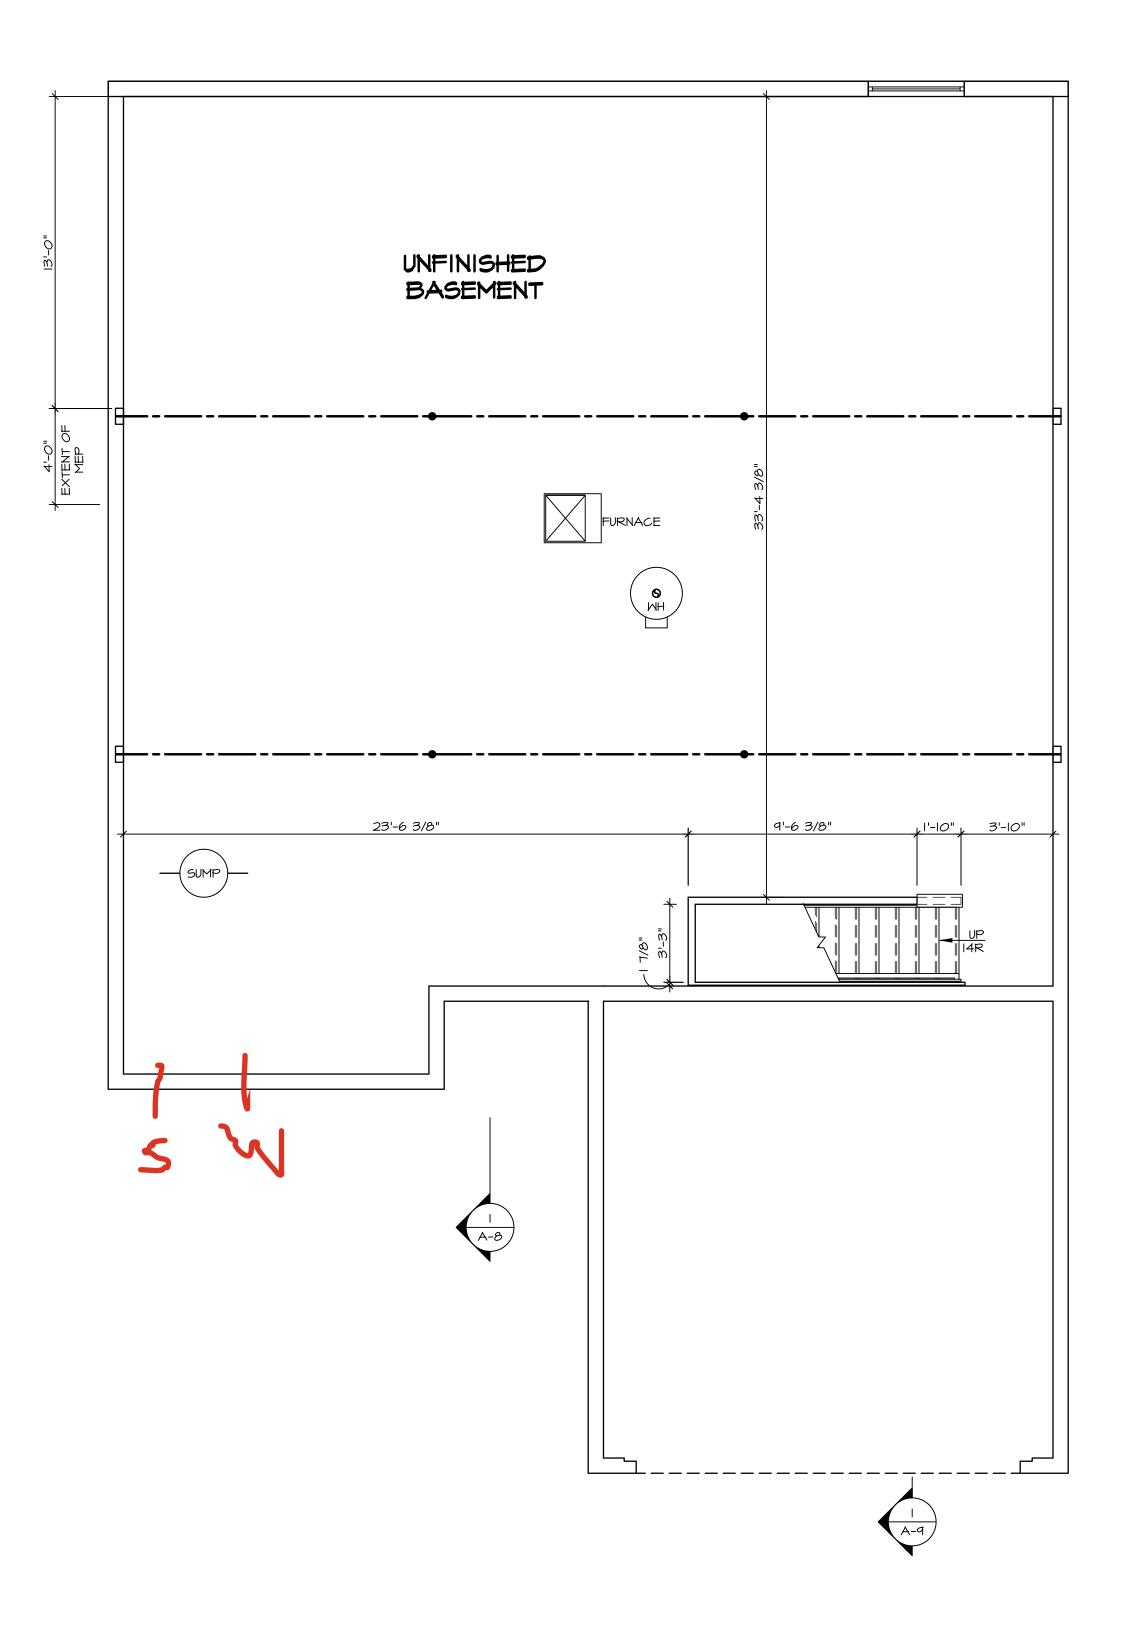

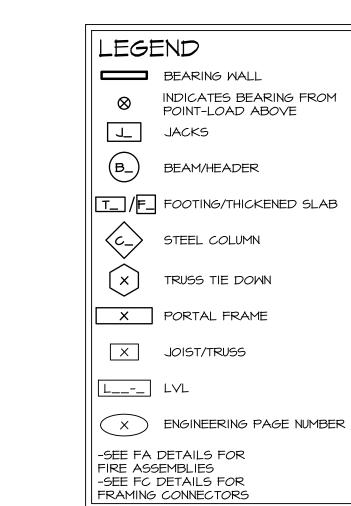

FLOOR PLAN NOTES

RYAN

ALL HEADERS ARE (2) 2x6 w/ 2x4 WALLS OR (3) 2x6 w/ 2x6 WALLS, UNLESS OTHERWISE NOTED.

ALL HEADERS TO HAVE (1) 2x4 OR 2x6 JACK AND KING STUD EACH END, UNLESS OTHERWISE NOTED.

MULTI-OPENING HEADERS TO HAVE (2) JACKS AT INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. NO ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOUS LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISE 3. ALL EXTERIOR WALLS TO BE 4" W/ OSB OR 3 1/2"
W/ LAMINATED FIBROUS STRUCTURAL SHEATHING, ALL

INTERIOR WALLS TO BE 3 1/2", UNLESS OTHERWISE NOTED.

1. HATCHED AREAS INDICATE DROPPED CEILINGS. ALL DROPPED CEILINGS ARE 12" UNLESS OTHERWISE NOTED. SEE ARCHITECTURAL DETAIL 8/IT-IB FOR 3/4" FIRE STOPPING AT BULKHEAD / CEILING PANELS 5. SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIAL WALL FRAMING LOCATIONS AND HEADER SIZES, IF

APPLICABLE. 6. SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR

INTERIOR TRIM DETAILS. . SEE ARCHITECTURAL DETAIL SHEET "AD" FOR HOUSE SPECIFIC INTERIOR TRIM OPTION TABLE.

3. ALL HEADERS IN NON-BEARING WALLS SHALL BE A SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES ABOVE, UNLESS OTHERWISE NOTED. TANKED WATER HEATER SHOWN AS BASE CONDITION,

OPTIONAL TANKLESS WATER HEATER IS AVAILABLE IN LIEU OF TANKED WATER HEATER. 10. INTERIOR HEADER HEIGHT TO BE 6'-II" W/ 8'-0" CEILINGS AND 7'-II" W/ 9'-0" CEILINGS UNLESS OTHERWISE NOTED.
BASEMENT FINISH DIMENSIONS ASSUME A 1/2" GAP

BETWEEN FRAME WALL AND CONCRETE WALL. 12. ALL INTERIOR BEARING WALLS SHALL HAVE GYPSUM
APPLIED TO AT LEAST ONE SIDE OR HAVE MID-HEIGHT
BLOCKING INSTALLED.


GYPSUM NOTES

AT GARAGE:

GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL FA-I(b) FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.


AT STAIRS: 1/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS

BASEMENT FLOOR PLAN SCALE: 1/4" = 1'-0"

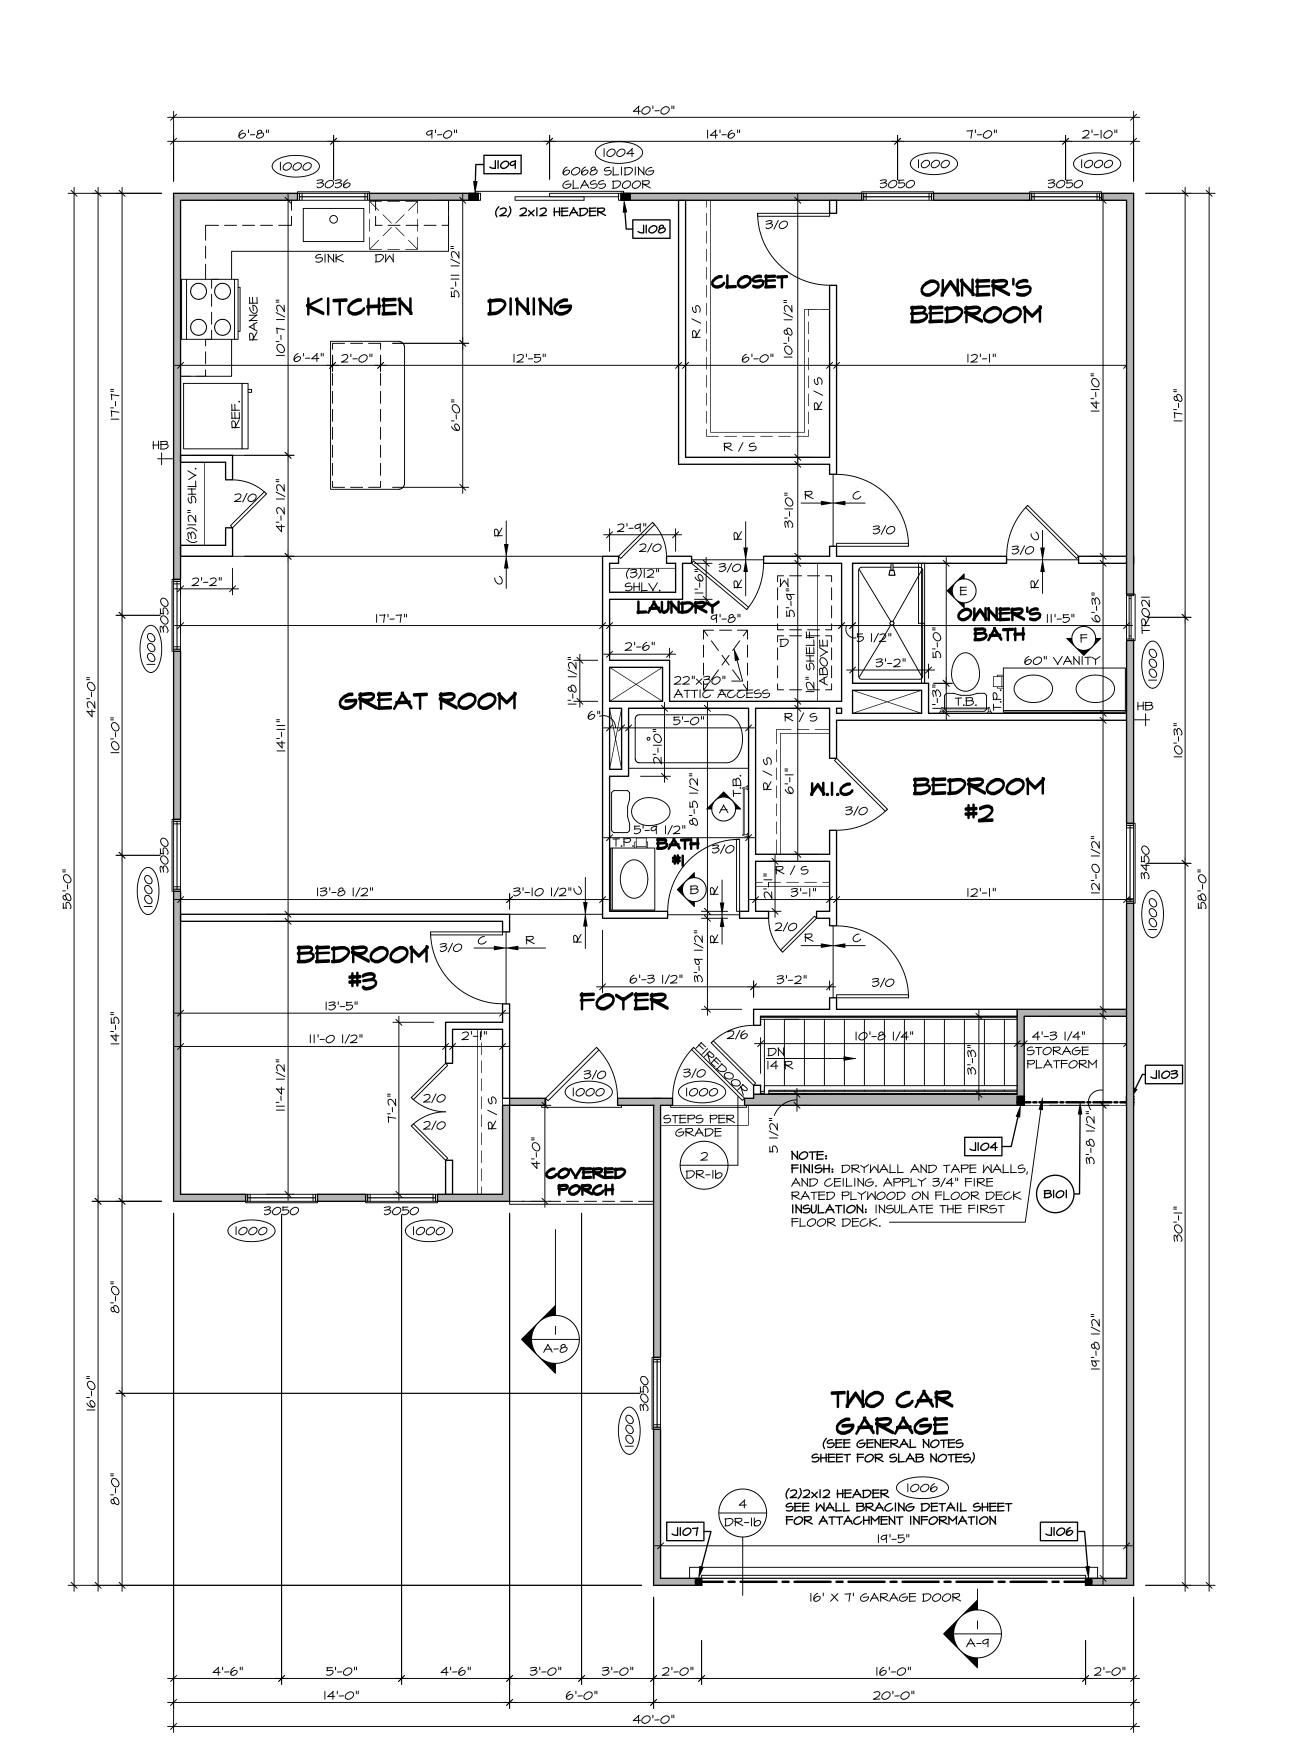

FIRST FLOOR JACK SCHEDULE				
IDENTIFIER	DESCRIPTION	ENG. NUM.	REMARKS	
SOIL	JACK - (3) 2X4 SPF STUD GRADE	1008		
JIO4	JACK - (3) 2X4 SPF STUD GRADE	1008		
JI06	JACK - (2) 2X4 SPF STUD GRADE	1006		
TOIL	JACK - (2) 2X4 SPF STUD GRADE	1006		
80IL	JACK - (3) 2X4 SPF STUD GRADE	1004		
POIL	JACK - (3) 2X4 SPF STUD GRADE	1004		

FIELD	INSTALLED FIRST FL	OOR BEAM	HEADER	SCHEDULE
IDENTIFIER	DESCRIPTION	LENGTH	ENG. NUM.	REMARKS
BIOI	INT HEADER - 2X8 - 2 PLY	4'-10 1/4"	1008	

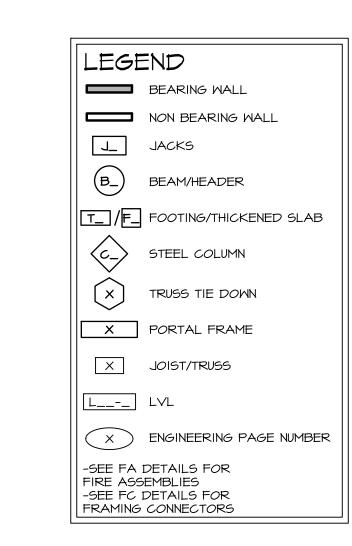

	ALL WINDOWS HAVE 7'-2 I/2" HEADER HEIGHT UNLESS OTHERWISE NOTED
F	LOOR PLAN NOTES RYAN
١.	ALL HEADERS ARE (2) 2x6 w/ 2x4 WALLS OR (3) 2x6 w/
	2x6 WALLS, UNLESS OTHERWISE NOTED.
2.	ALL HEADERS TO HAVE (1) 2x4 OR 2x6 JACK AND KING
	STUD EACH END, UNLESS OTHERWISE NOTED.
	MULTI-OPENING HEADERS TO HAVE (2) JACKS AT
	INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. NO
	ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOUS
	LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISE
_	NOTED.
) 2.	ALL EXTERIOR WALLS TO BE 4" W/ OSB OR 3 1/2"
	W/ LAMINATED FIBROUS STRUCTURAL SHEATHING, ALL
4.	INTERIOR WALLS TO BE 3 1/2", UNLESS OTHERWISE NOTED. HATCHED AREAS INDICATE DROPPED CEILINGS. ALL
4.	DROPPED CEILINGS ARE 12" UNLESS OTHERWISE NOTED.
	SEE ARCHITECTURAL DETAIL 8/IT-IB FOR 3/4" FIRE
	STOPPING AT BULKHEAD / CEILING PANELS
5	SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIAL
	WALL FRAMING LOCATIONS AND HEADER SIZES, IF
	APPLICABLE.
6.	SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR
	INTERIOR TRIM DETAILS.
7.	SEE ARCHITECTURAL DETAIL SHEET "AD" FOR HOUSE
	SPECIFIC INTERIOR TRIM OPTION TABLE.
8.	ALL HEADERS IN NON-BEARING WALLS SHALL BE A
	SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES
l .	ABOVE, UNLESS OTHERWISE NOTED.
9.	TANKED WATER HEATER SHOWN AS BASE CONDITION,

OPTIONAL TANKLESS WATER HEATER IS AVAILABLE IN

O. INTERIOR HEADER HEIGHT TO BE 6'-II" W/ 8'-O" CEILINGS AND 7'-II" W/ 9'-O" CEILINGS UNLESS OTHERWISE NOTED. I. BASEMENT FINISH DIMENSIONS ASSUME A I/2" GAP

12. ALL INTERIOR BEARING WALLS SHALL HAVE GYPSUM APPLIED TO AT LEAST ONE SIDE OR HAVE MID-HEIGHT BLOCKING INSTALLED.

GYPSUM NOTES

LIEU OF TANKED WATER HEATER.

AT GARAGE:


GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL FA-I(b) FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.

BETWEEN FRAME WALL AND CONCRETE WALL.

AT STAIRS:


1/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS
IN CLOSET

	FIRST FLOOR PLAN
A-7	SCALE: 1/4" = 1'-0"

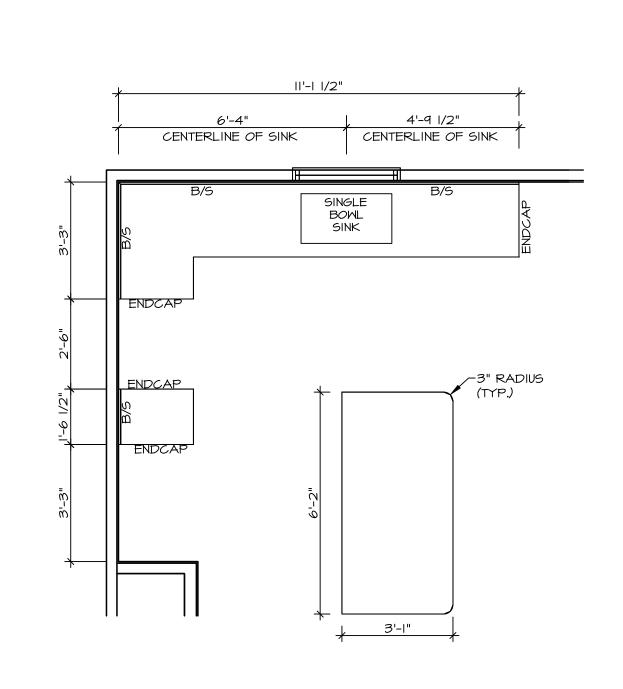


2 KITCHEN COUNTERTOP PLAN- (KC-3933)


A-II SCALE: 3/8" = 1'-0"

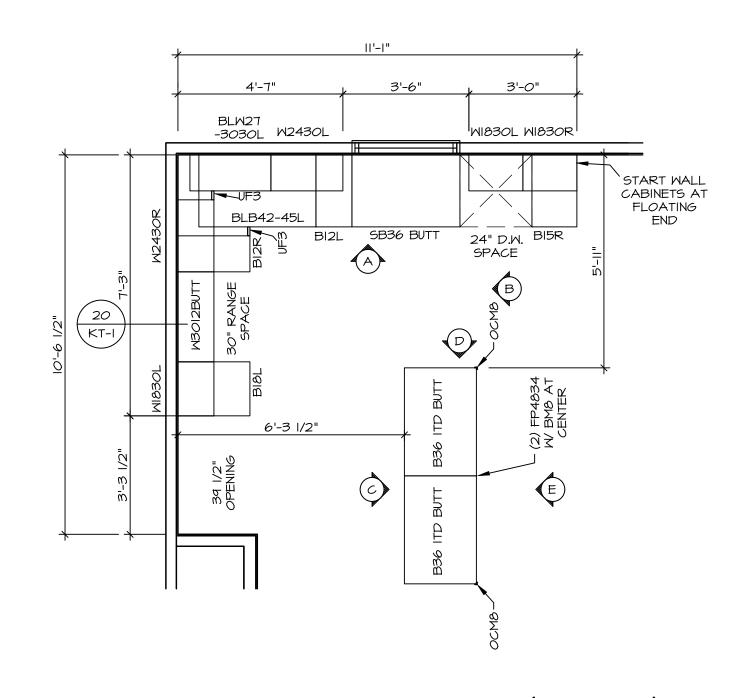


KITCHEN CABINET PLAN- (KC-3933)


SCALE: 3/8" = 1'-0"

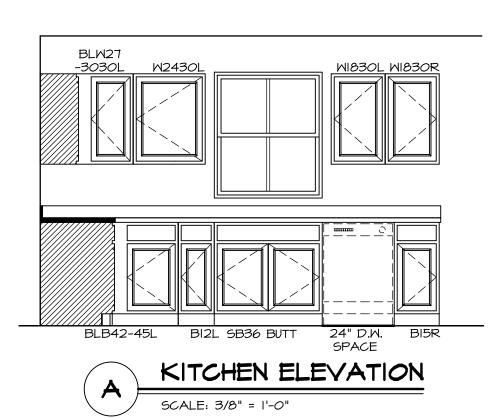


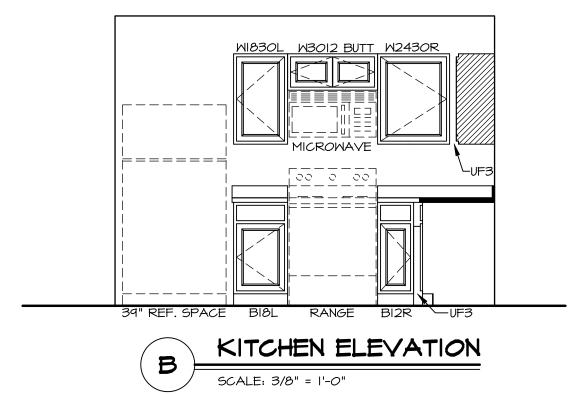

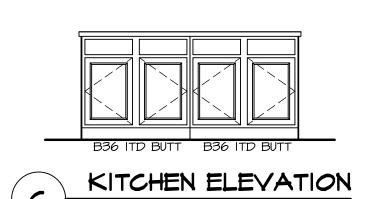



SCALE: 3/8" = 1'-0"

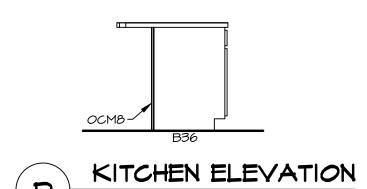


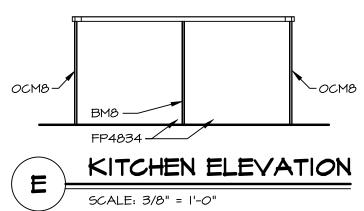


CABINET LAYOUT (S) ARE BASED ON FINISHED DIMENSIONS TO DRYWALL. F KITCHEN PLANS/ELEVATIONS CALL-OUT STANDARD MOLDING, REFER TO STANDARD DETAIL (II/KT-I) FOR REPLACEMENT BASED ON CABINET STYLE. ALL (UF#) FILLERS ARE TO BE "TRIM TO FIT" INLESS OTHERWISE NOTED. CABINET MUST BE SET, SHIMMED, LEVELED AND PLUMB W ADJOINING BASE CABINETS. SET PRE-FINISHED SCRIBE MOLDING AT CABINET BULKHEADS AND AT ENDS (WHERE CABINETS MEET DRYWALL.) PRE-FINISHED SCRIBE MOLDING SHALL BE USED TO PAD OUT CABINET SIDES AT STILE FOR RETURN PIECES OF THE FACE-MOUNTED CABINET CROWN MOLDING. TES: BINETS ARE NOT REPRESENTATIVE OF ALL TLES AND ARE MEANT AS A GENERAL	
PICTION OF THE INTENDED CABINET LAYOUT	DIV-COMM-LOT-UNIT DCY-52-0455 COMM-LOT SAWYERS MILL - SIMPLY RYAN - 0455 STREET ADDRESS 6875 RIVULET DRIVE CITY MIDDLETOWN OH 45042
	© NVR, Inc., The owner, expressly reserves its copyright and other property rights in these plans. These plans are not to be reproduced, changed, or copied in any form or manner whatsoever, nor are they to be assigned to any third party, without first obtaining the expressed written consent of NVR, Inc.
	SET NO. TUPOO VERSION O! RELEASE NO DRAWN BY SGA DATE: OPTION Frederick, MD 21703 Frederick, MD 21703 DCY-S2-0455\3208944\Sheets\Lot Specific\A-11 KIT LS.dwq 09/25/24 - 2:51 am
осмв	

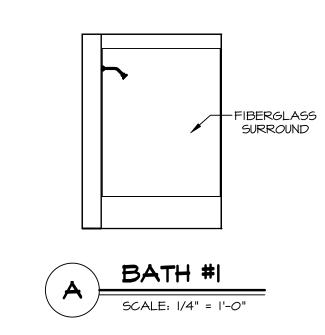

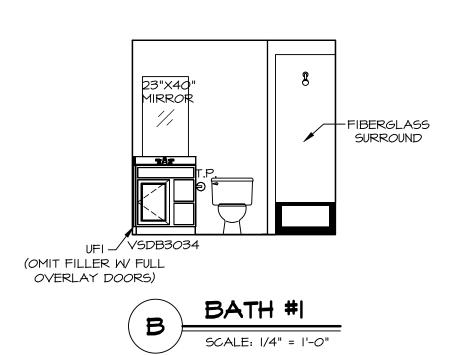


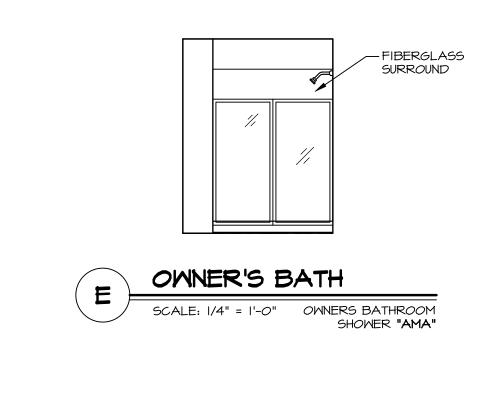


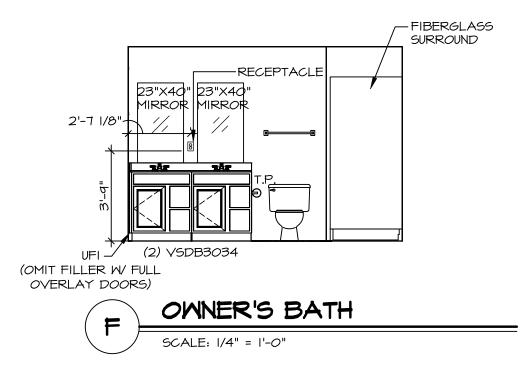


NOTES:

- TEMPERED GLASS SHOWER
 ENCLOSURE WITH SWING DOOR OR
 OPTIONAL SLIDING DOOR BY DIVISION.
 TUB ACCESS PANELS PROVIDED AS
 NEEDED, ALL MATERIALS BY DIVISION.
 ALL BATH ELEVATIONS SHOWN PER PLAN.
 ALL VANITIES WITH DRAWERS TO BE SET
 WITH DRAWERS ON RIGHT HAND SIDE.
 BATH ELEVATIONS ARE SHOWN PER PLAN.
 ALL DIMENSIONS SHOWN ON BATH
 ELEVATIONS ARE ROUGH FRAMING
 REFERENCES ONLY.

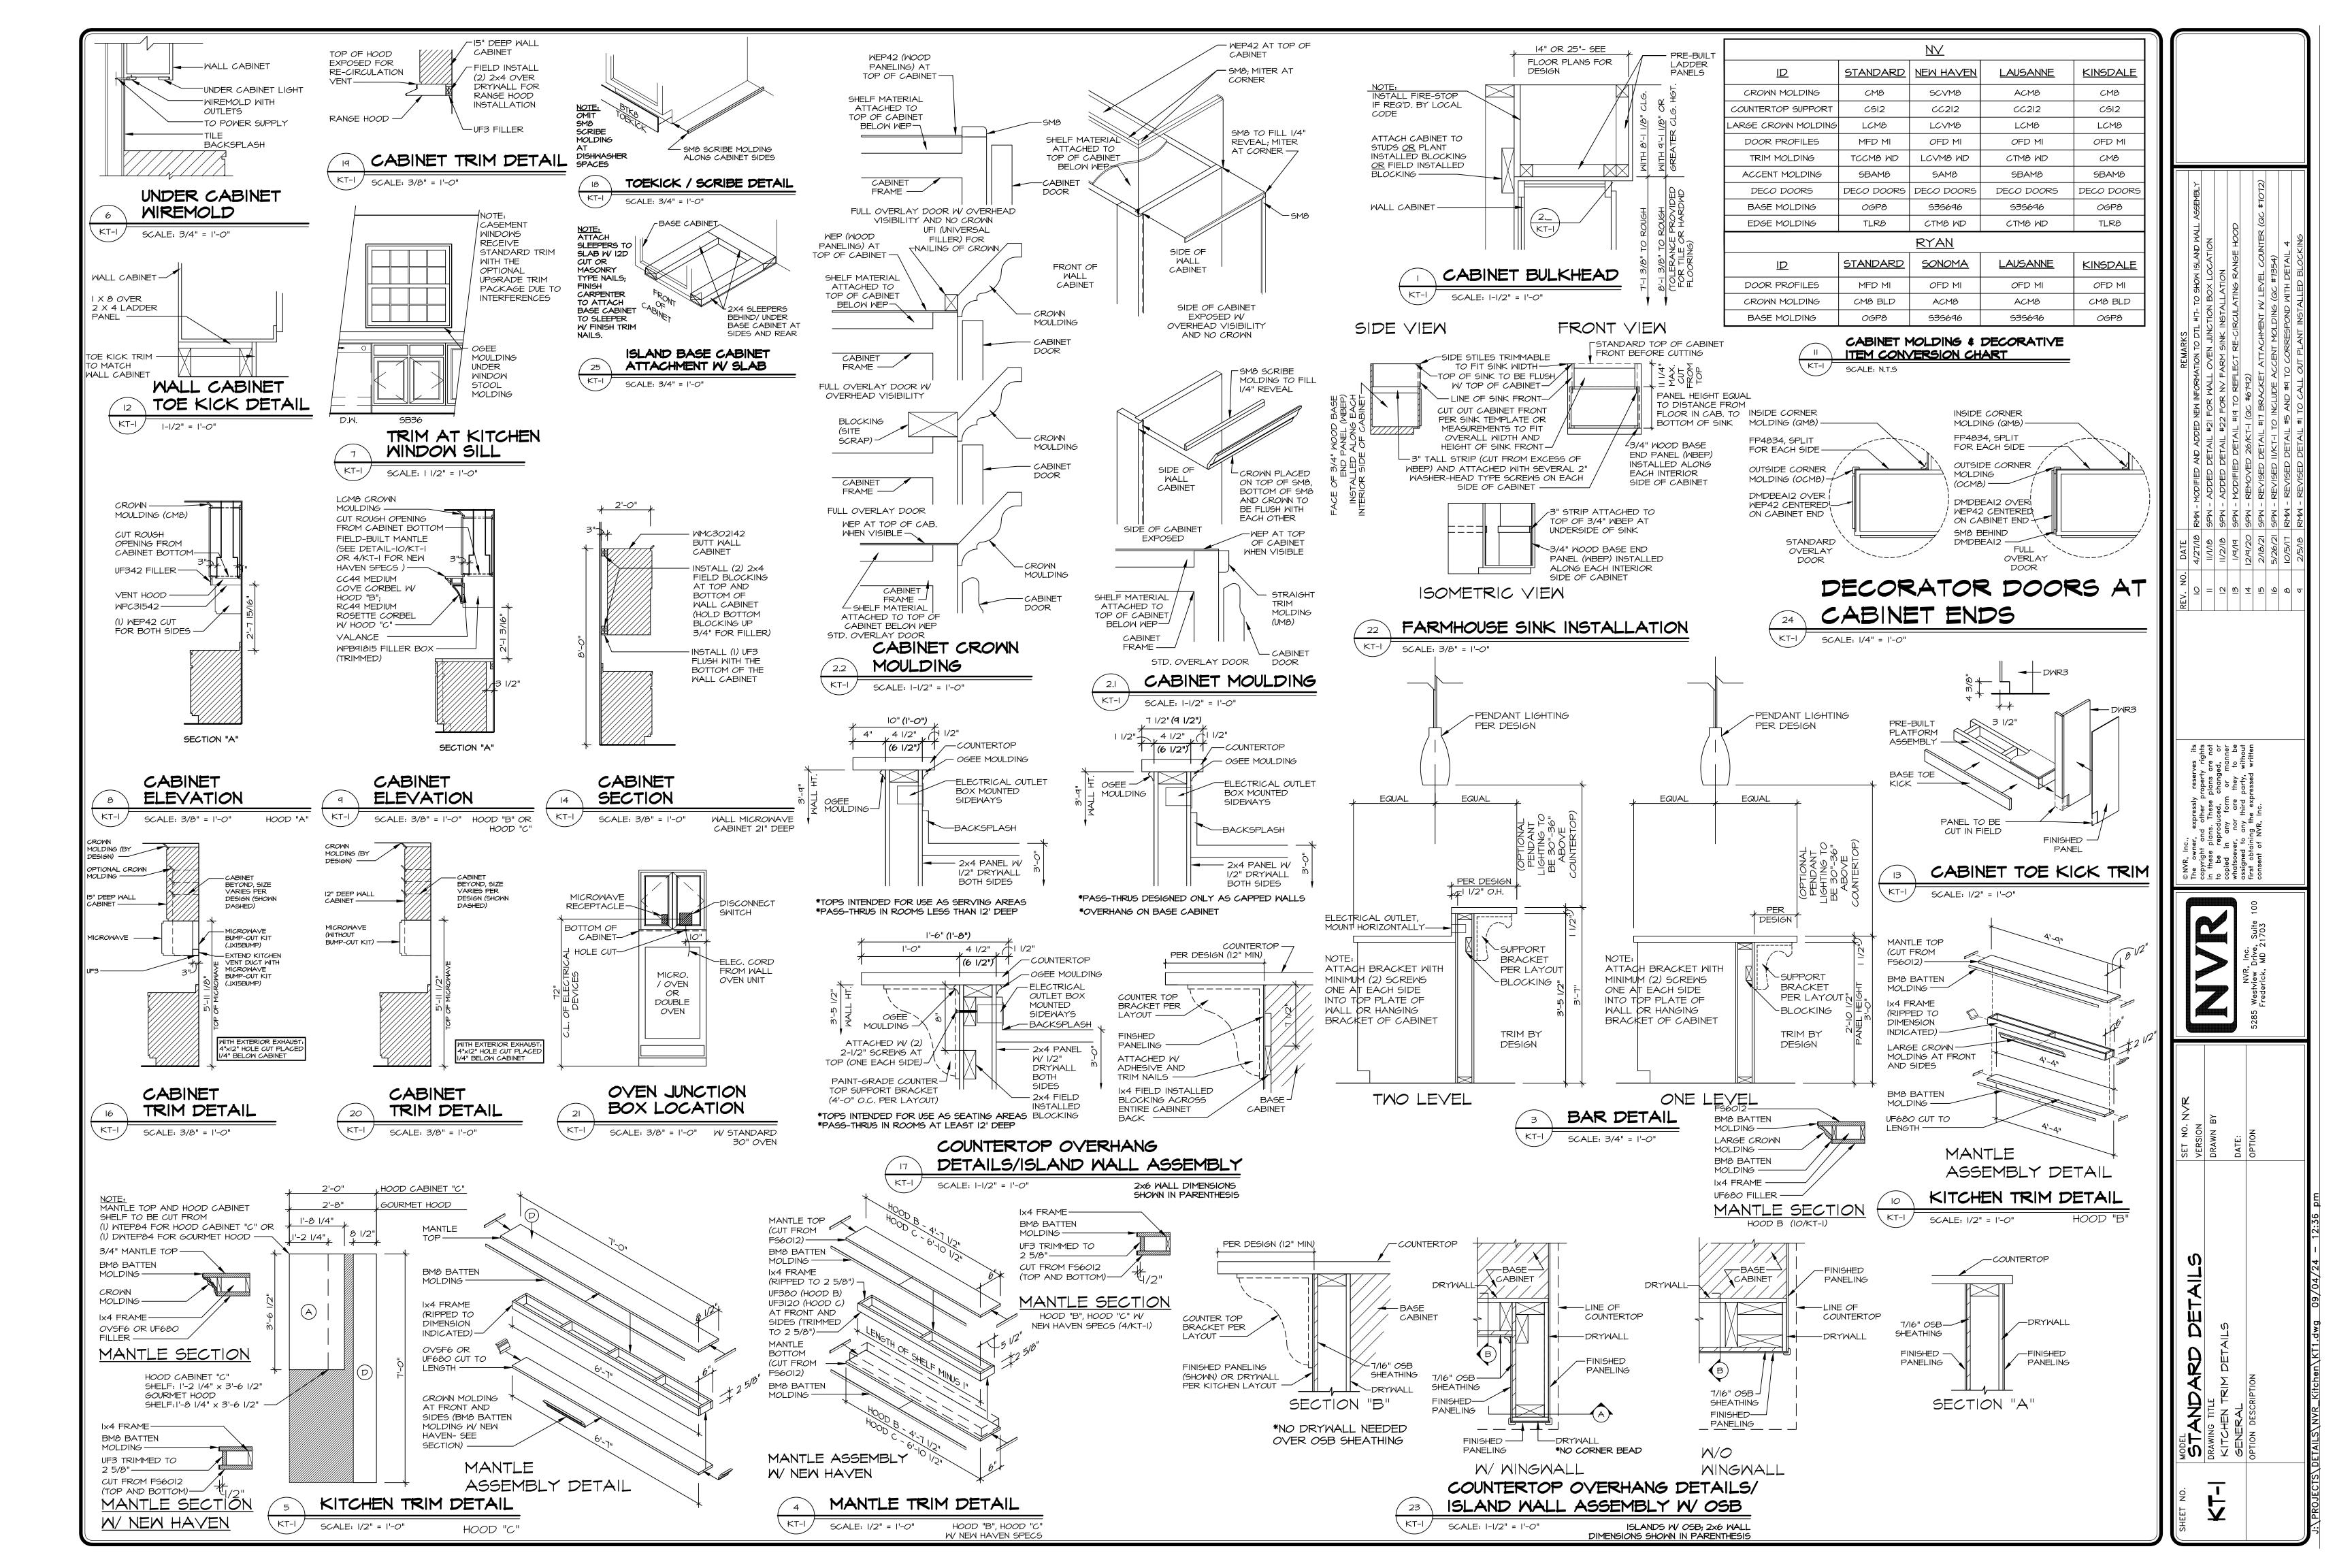

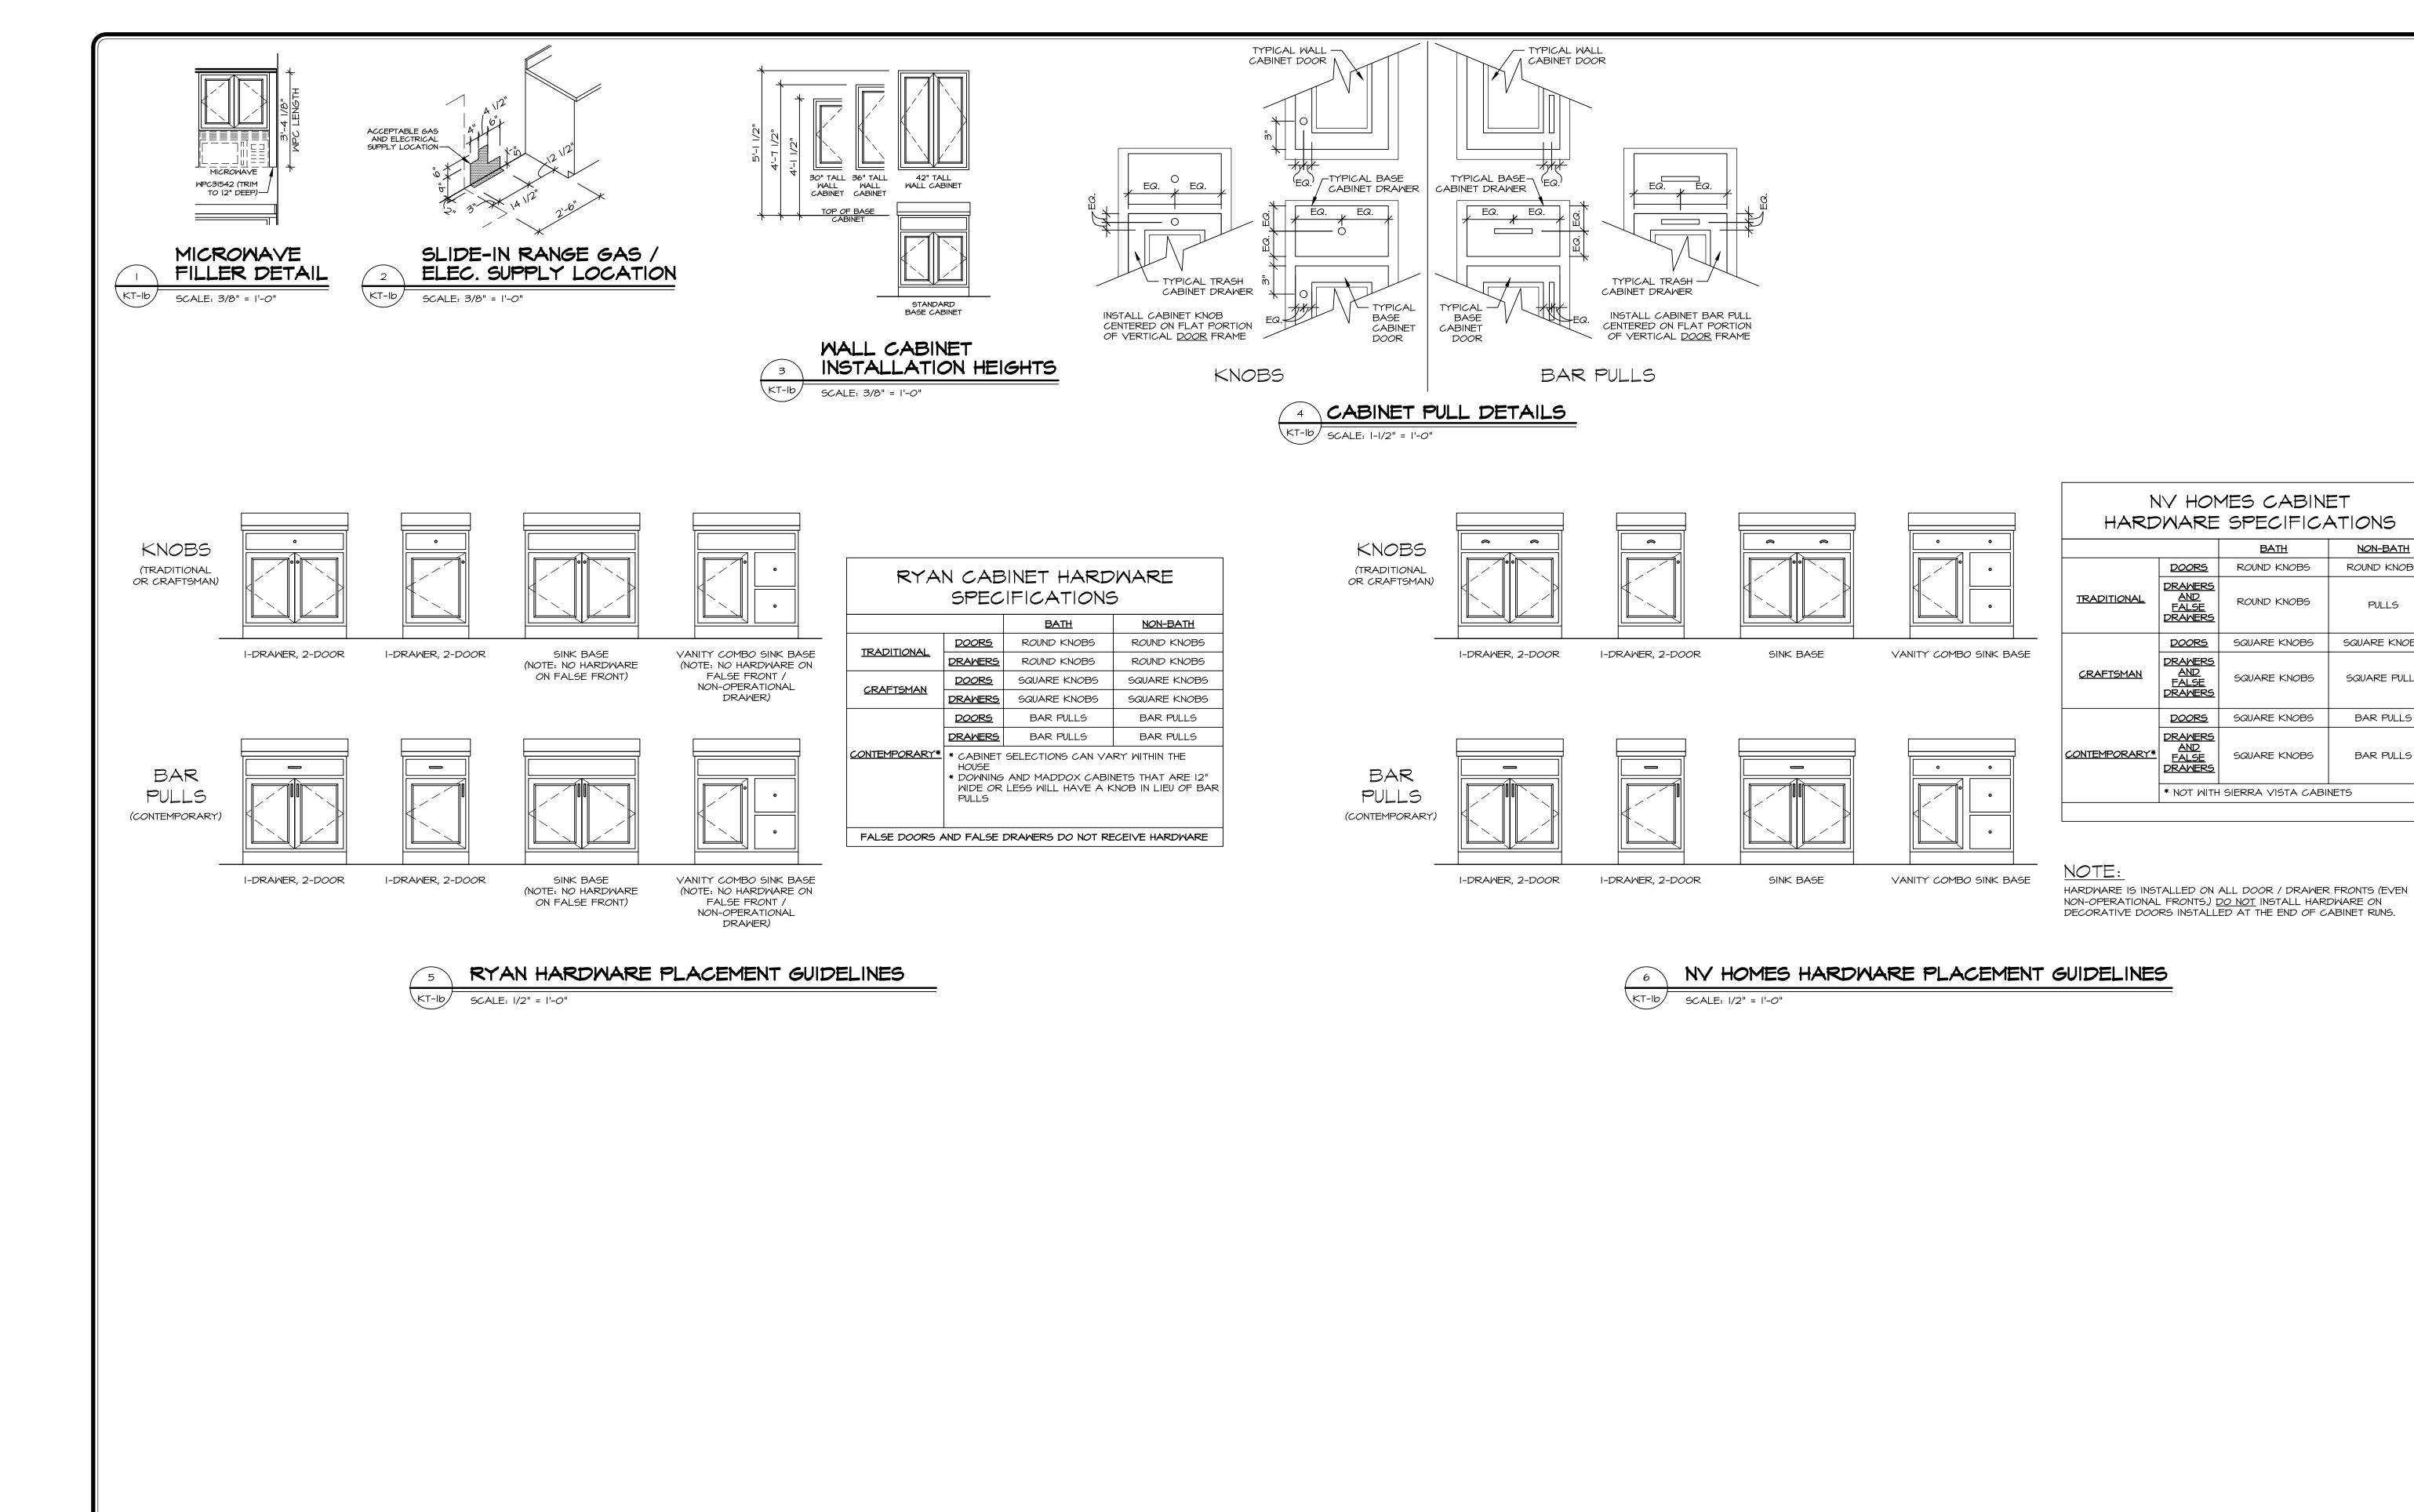

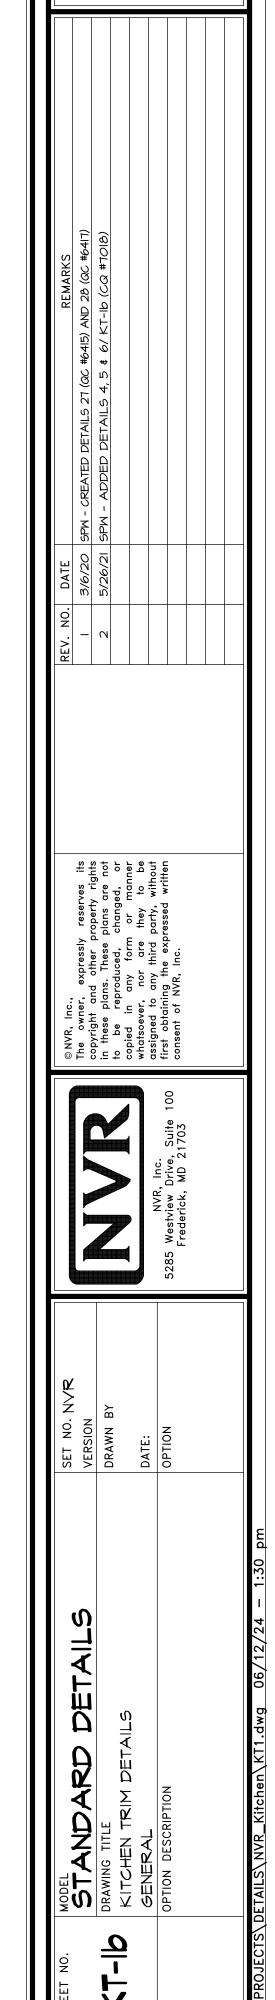

NON-BATH ROUND KNOBS

PULLS

SQUARE KNOBS

SQUARE PULLS

BAR PULLS

BAR PULLS