
S2 460 6855 RIVULET DRIVE MIDDLETOWN, OH 45042


2 Story Basement - 3 pc rough in
2 hose bibs - no valves required
Vent Kitchen
ice maker
1 tub
1 shower
WATER HEATER ELECTRIC 50 GALLON
Inside Water Meter setup


Gas Furnace

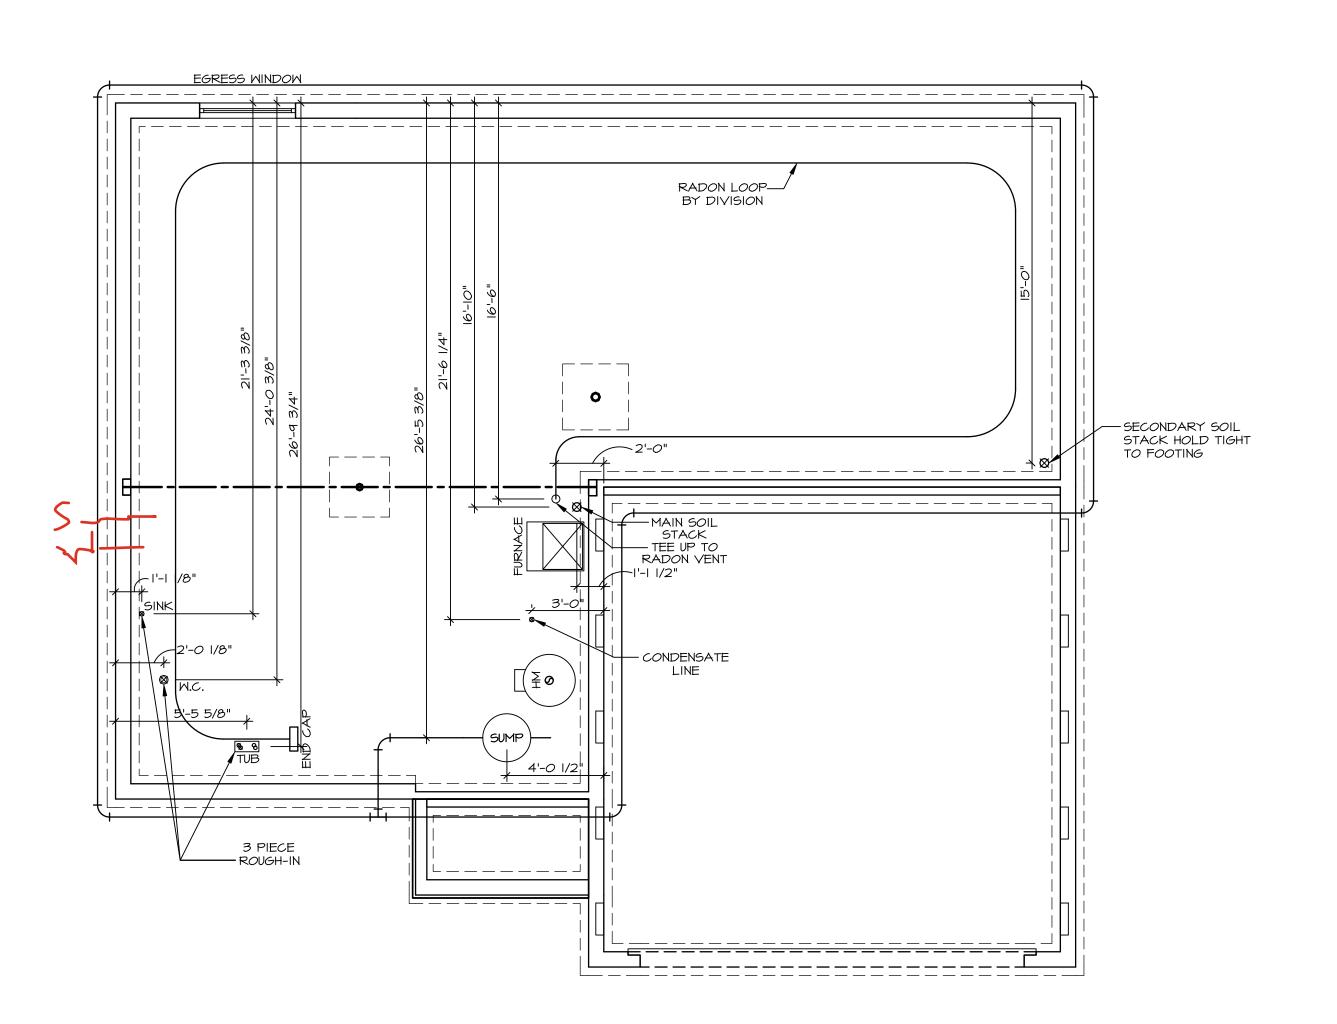


PLUMBING PLAN

A-5 SCALE: 1/4" = 1'-0"

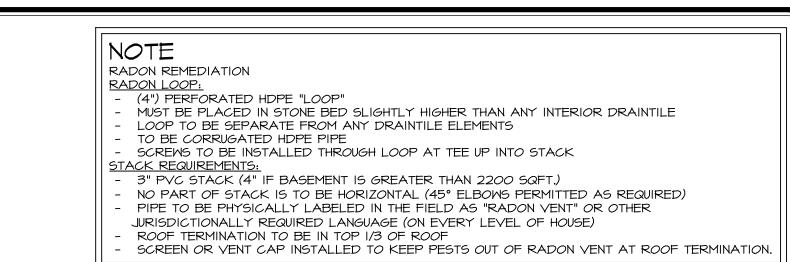

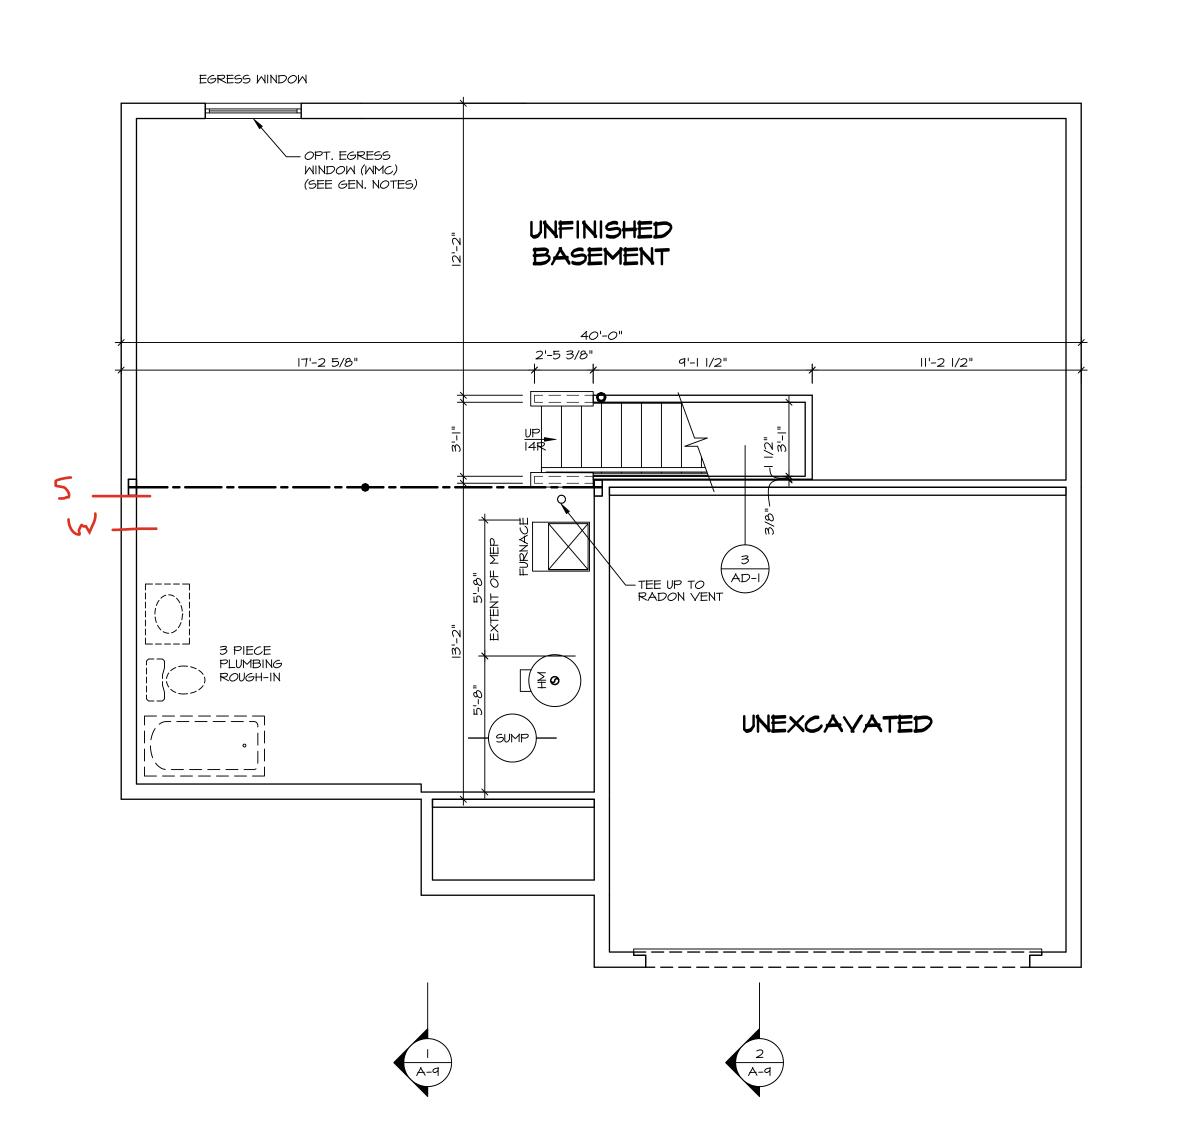

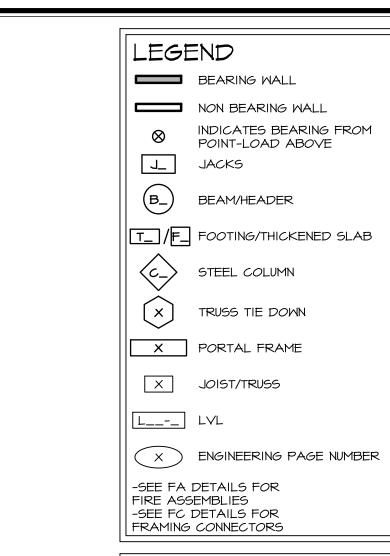

ALL WINDOWS HAVE 8'-0 1/2" HEADER HEIGHT UNLESS OTHERWISE NOTED

FLOOR PLAN NOTES

- ALL HEADERS ARE (2) 2x6 w/ 2x4 WALLS OR (3) 2x6 w/ 2x6 WALLS, UNLESS OTHERWISE NOTED.
 ALL HEADERS TO HAVE (I) 2x4 OR 2x6 JACK AND KING STUD EACH END, UNLESS OTHERWISE NOTED.
 MULTI-OPENING HEADERS TO HAVE (2) JACKS AT INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. NO ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOUS LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISE NOTED.
 ALL EXTERIOR WALLS TO BE 4" w/ OSB OR 3 1/2"
- w/ LAMINATED FIBROUS STRUCTURAL SHEATHING, ALL
 INTERIOR WALLS TO BE 3 I/2", UNLESS OTHERWISE NOTED.

 4. HATCHED AREAS INDICATE DROPPED CEILINGS. ALL
 DROPPED CEILINGS ARE I2" UNLESS OTHERWISE NOTED.

 5. SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIAL
 WALL FRAMING LOCATIONS AND HEADER SIZES, IE
- WALL FRAMING LOCATIONS AND HEADER SIZES, IF APPLICABLE.

 6. SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR INTERIOR TRIM DETAILS.

 7. SEE ARCHITECTURAL DETAIL SHEET "AD" FOR HOUSE
- 8. ALL HEADERS IN NON-BEARING WALLS SHALL BE A SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES ABOVE, UNLESS OTHERWISE NOTED.
 9. TANKED WATER HEATER SHOWN AS BASE CONDITION, OPTIONAL TANKLESS WATER HEATER IS AVAILABLE IN

SPECIFIC INTERIOR TRIM OPTION TABLE.

LIEU OF TANKED WATER HEATER.

10. INTERIOR HEADER HEIGHT TO BE 6'-II" W/ 8'-O" CEILINGS

AND 7'-II" W/ 9'-O" CEILINGS UNLESS OTHERWISE NOTED.

11. BASEMENT FINISH DIMENSIONS ASSUME A I/2" GAP

BETWEEN FRAME WALL AND CONCRETE WALL.

GYPSUM NOTES

AT GARAGE:

GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL FA-I(b) FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.

AT STAIRS:

1/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS IN CLOSET © NVR, Inc.,

The owner, expressly reserves its copyright and other property rights in these plans. These plans are not to be reproduced, changed, or copied in any form manner whotsoever, nor are they to be assigned to any third party, without first obtaining the expressed written consent of NVR, Inc.

5285 Westview Drive, Suite 100 consent of NVR, Inc.


Frederick, MD 21703

© NVR, Inc.

SAMYERS MILL - SIMPLY RYAN - 046c

STREET ADDRESS

6855 RIVULET DRIVE

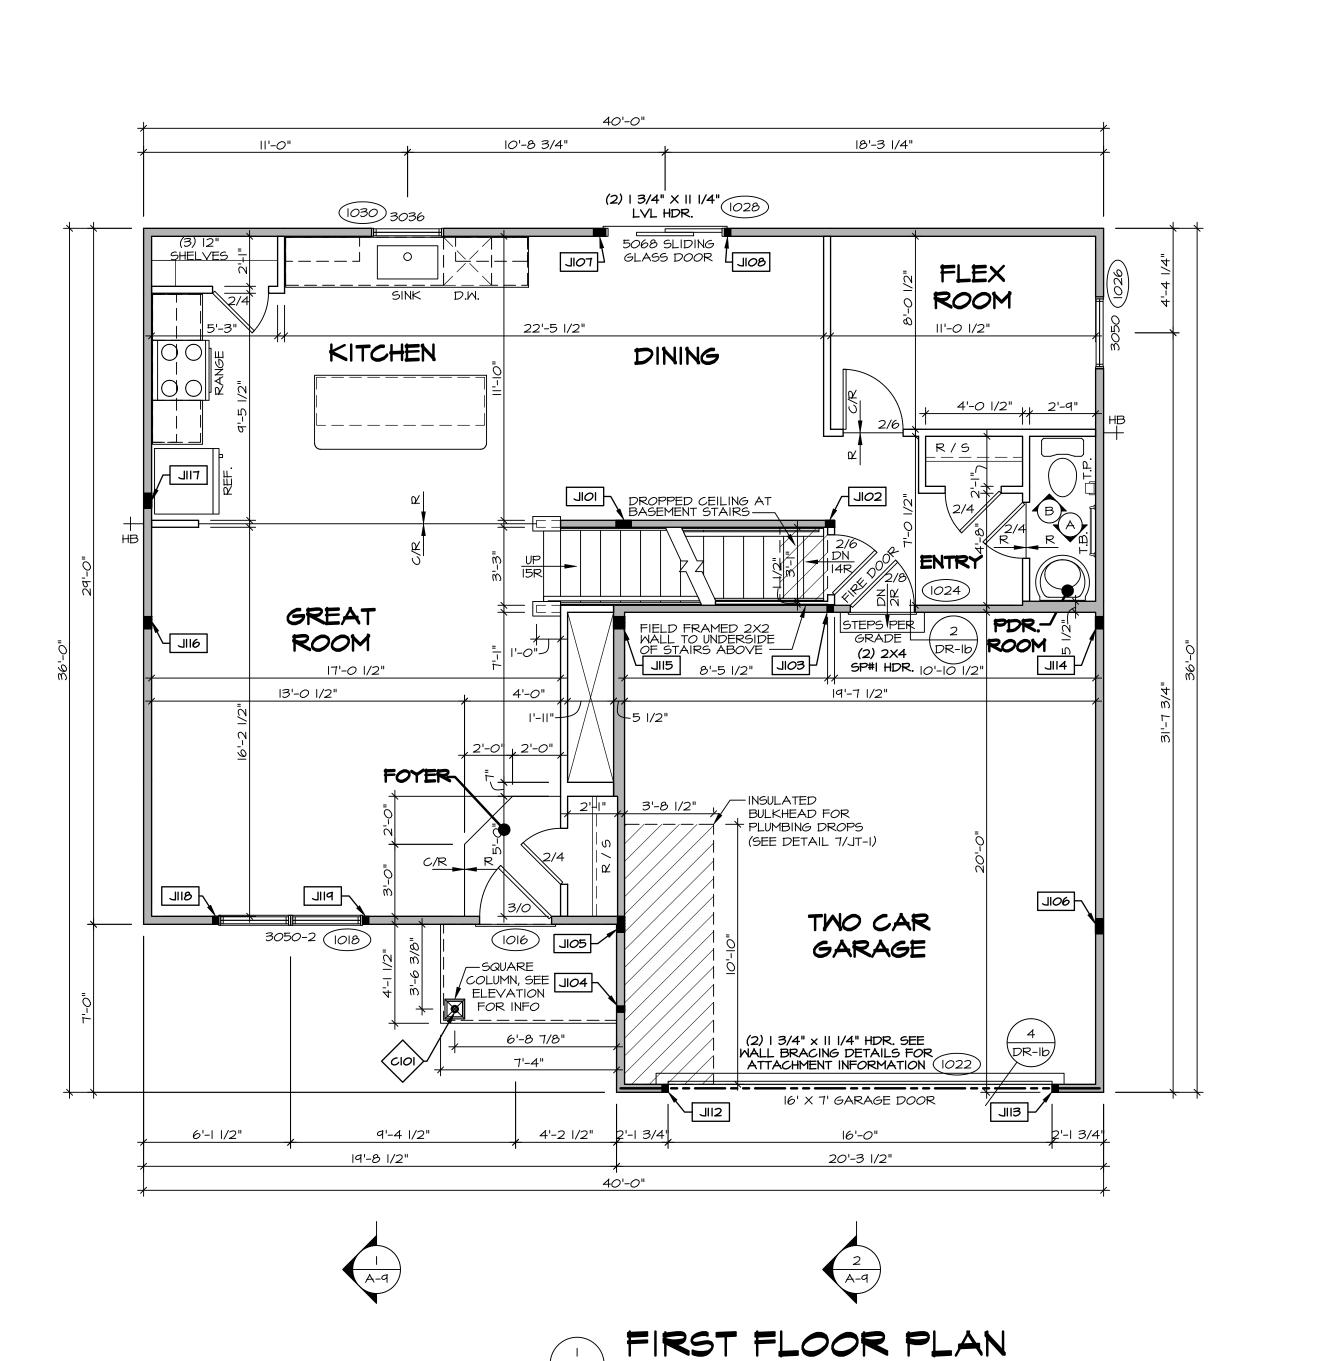

SCALE: 1/4" = 1'-0"

LVL PLY TO PLY FASTENING SCHEDULE: (WHERE APPLICABLE BASED ON LVL USAGE) I.A - (2) PLY UP TO AND INCLUDING II 7/8" TALL: FASTEN PLIES W/ (2) ROWS 16D NAILS AT 12" O.C. OR

ALT I 1/2" WIDE LVL FASTEN PLIES W/ (3) ROWS 12D NAILS AT 12"O.C. 2.A - (2) PLY I4" TO AND I8" TALL (INCLUSIVE): FASTEN PLIES W/ (3) ROWS I6D NAILS AT I2" O.C. OR

ALT I I/2" WIDE LVL FASTEN PLIES W/ (4) ROWS I2D NAILS AT I2"O.C. 3.A - (2) PLY 20" TALL AND OVER: FASTEN PLIES W/ (4) ROWS 16D NAILS AT 12" O.C. OR ALT I 1/2" WIDE LVL FASTEN PLIES W/ (5) ROWS 12D NAILS AT 12"O.C.

4.A - (3) PLY UP TO AND INCLUDING II 7/8" TALL: FASTEN PLIES W/ (2) ROWS I6D NAILS AT I2" O.C. FROM EACH SIDE OR ALT I 1/2" WIDE LVL FASTEN PLIES W/ (3) ROWS 12D NAILS AT 12"O.C. FROM

5.A - (3) PLY 14" TO AND 18" TALL (INCLUSIVE): FASTEN PLIES W/ (3) ROWS 16D NAILS AT 12" O.C. FROM EACH SIDE OR ALT I 1/2" WIDE LVL FASTEN PLIES W/ (4) ROWS 12D NAILS AT 12"O.C. FROM EACH 6.A - (3) PLY 20" TALL AND OVER: FASTEN PLIES W/ (4) ROWS 16D NAILS AT 12" O.C. FROM EACH SIDE

OR ALT I I/2" WIDE LVL FASTEN PLIES W/ (5) ROWS I2D NAILS AT I2"O.C. FROM EACH SIDE. 7.A - (4) PLY (ALL SIZES): FASTEN PLIES W/ (2) ROWS 1/2" DIAMETER A307 BOLTS AT 24" O.C. SEE SHOP DRAWING FOR ADDITIONAL INFORMATION.

LEGEND

BEARING WALL

NON BEARING WALL INDICATES BEARING FROM POINT-LOAD ABOVE

7_ JACKS

BEAM/HEADER

T_ /F_ FOOTING/THICKENED SLAB

STEEL COLUMN TRUSS TIE DOWN

X PORTAL FRAME X JOIST/TRUSS

L__-_ LVL

-SEE FA DETAILS FOR FIRE ASSEMBLIES -SEE FC DETAILS FOR FRAMING CONNECTORS

ALL WINDOWS HAVE 7'-0 1/2" HEADER HEIGHT UNLESS OTHERWISE NOTED

FLOOR PLAN NOTES

- ALL HEADERS ARE (2) 2x6 W/ 2x4 WALLS OR (3) 2x6 W/ 2x6 WALLS, UNLESS OTHERWISE NOTED. . ALL HEADERS TO HAVE (I) 2x4 OR 2x6 JACK AND KING STUD EACH END, UNLESS OTHERWISE NOTED. MULTI-OPENING HEADERS TO HAVE (2) JACKS AT INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. NO
- ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOUS LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISE NOTED. 3. ALL EXTERIOR WALLS TO BE 4" W/ OSB OR 3 1/2"
 W/ LAMINATED FIBROUS STRUCTURAL SHEATHING, ALL
- DROPPED CEILINGS ARE 12" UNLESS OTHERWISE NOTED. SEE ARCHITECTURAL DETAIL 8/IT-IB FOR 3/4" FIRE STOPPING AT BULKHEAD / CEILING PANELS SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIAL WALL FRAMING LOCATIONS AND HEADER SIZES, IF
- APPLICABLE. SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR INTERIOR TRIM DETAILS. . SEE ARCHITECTURAL DETAIL SHEET "AD" FOR HOUSE SPECIFIC INTERIOR TRIM OPTION TABLE.
- . ALL HEADERS IN NON-BEARING WALLS SHALL BE A SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES ABOVE, UNLESS OTHERWISE NOTED. TANKED WATER HEATER SHOWN AS BASE CONDITION,
- OPTIONAL TANKLESS WATER HEATER IS AVAILABLE IN LIEU OF TANKED WATER HEATER. D. INTERIOR HEADER HEIGHT TO BE 6'-II" W/ 8'-0" CEILINGS AND 7'-II" W/ 9'-0" CEILINGS UNLESS OTHERWISE NOTED. BASEMENT FINISH DIMENSIONS ASSUME A 1/2" GAP
- BETWEEN FRAME WALL AND CONCRETE WALL. 2. ALL INTERIOR BEARING WALLS SHALL HAVE GYPSUM APPLIED TO AT LEAST ONE SIDE OR HAVE MID-HEIGHT BLOCKING INSTALLED.

GYPSUM NOTES

AT GARAGE:

GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL FA-I(b) FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.


AT STAIRS:


I/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS IN CLOSET

	FIRST FLOOR JACK	SCHEDUL	E
IDENTIFIER	DESCRIPTION	ENG. NUM.	REMARKS
IOIL	JACK - (5) 2X4 SPF STUD GRADE	1008, 1012	
JI02	JACK - (3) 2X4 SPF STUD GRADE	1006	
SOIL	JACK - (2) 2X4 SPF STUD GRADE	1006	
JIO4	JACK - (2) 2X4 SPF STUD GRADE	1020	
JI <i>0</i> 5	JACK - (5) 2X4 SPF STUD GRADE	2006	
JI06	JACK - (5) 2X4 SPF STUD GRADE	2006	
TOIL	JACK - (4) 2X4 SPF STUD GRADE	1028	
80IL	JACK - (2) 2X4 SPF STUD GRADE	1028	
JII2	JACK - (2) 2X4 SPF STUD GRADE	1022	
SIIL	JACK - (2) 2X4 SPF STUD GRADE	1022	
JII4	JACK - (4) 2X4 SPF STUD GRADE	1010	
JII5	JACK - (4) 2X6 SPF STUD GRADE	1010	
JII6	JACK - (4) 2X4 SPF STUD GRADE	1010	
TIIL	JACK - (5) 2X4 SPF STUD GRADE	1010	
BIIL	JACK - (2) 2X4 SPF STUD GRADE	1018	
PIIL	JACK - (2) 2X4 SPF STUD GRADE	1018	

STEEL COLUMN SCHEDULE				
IDENTIFIER	STYLE	HEIGHT	ENG. NUM.	REMARKS
CIOI	STANCHION PORCH - 3 IN DIA IIGA ADJ	7'-10 5/8"	1020	FBA, FCA

X ENGINEERING PAGE NUMBER INTERIOR WALLS TO BE 3 1/2", UNLESS OTHERWISE NOTED. . HATCHED AREAS INDICATE DROPPED CEILINGS. ALL

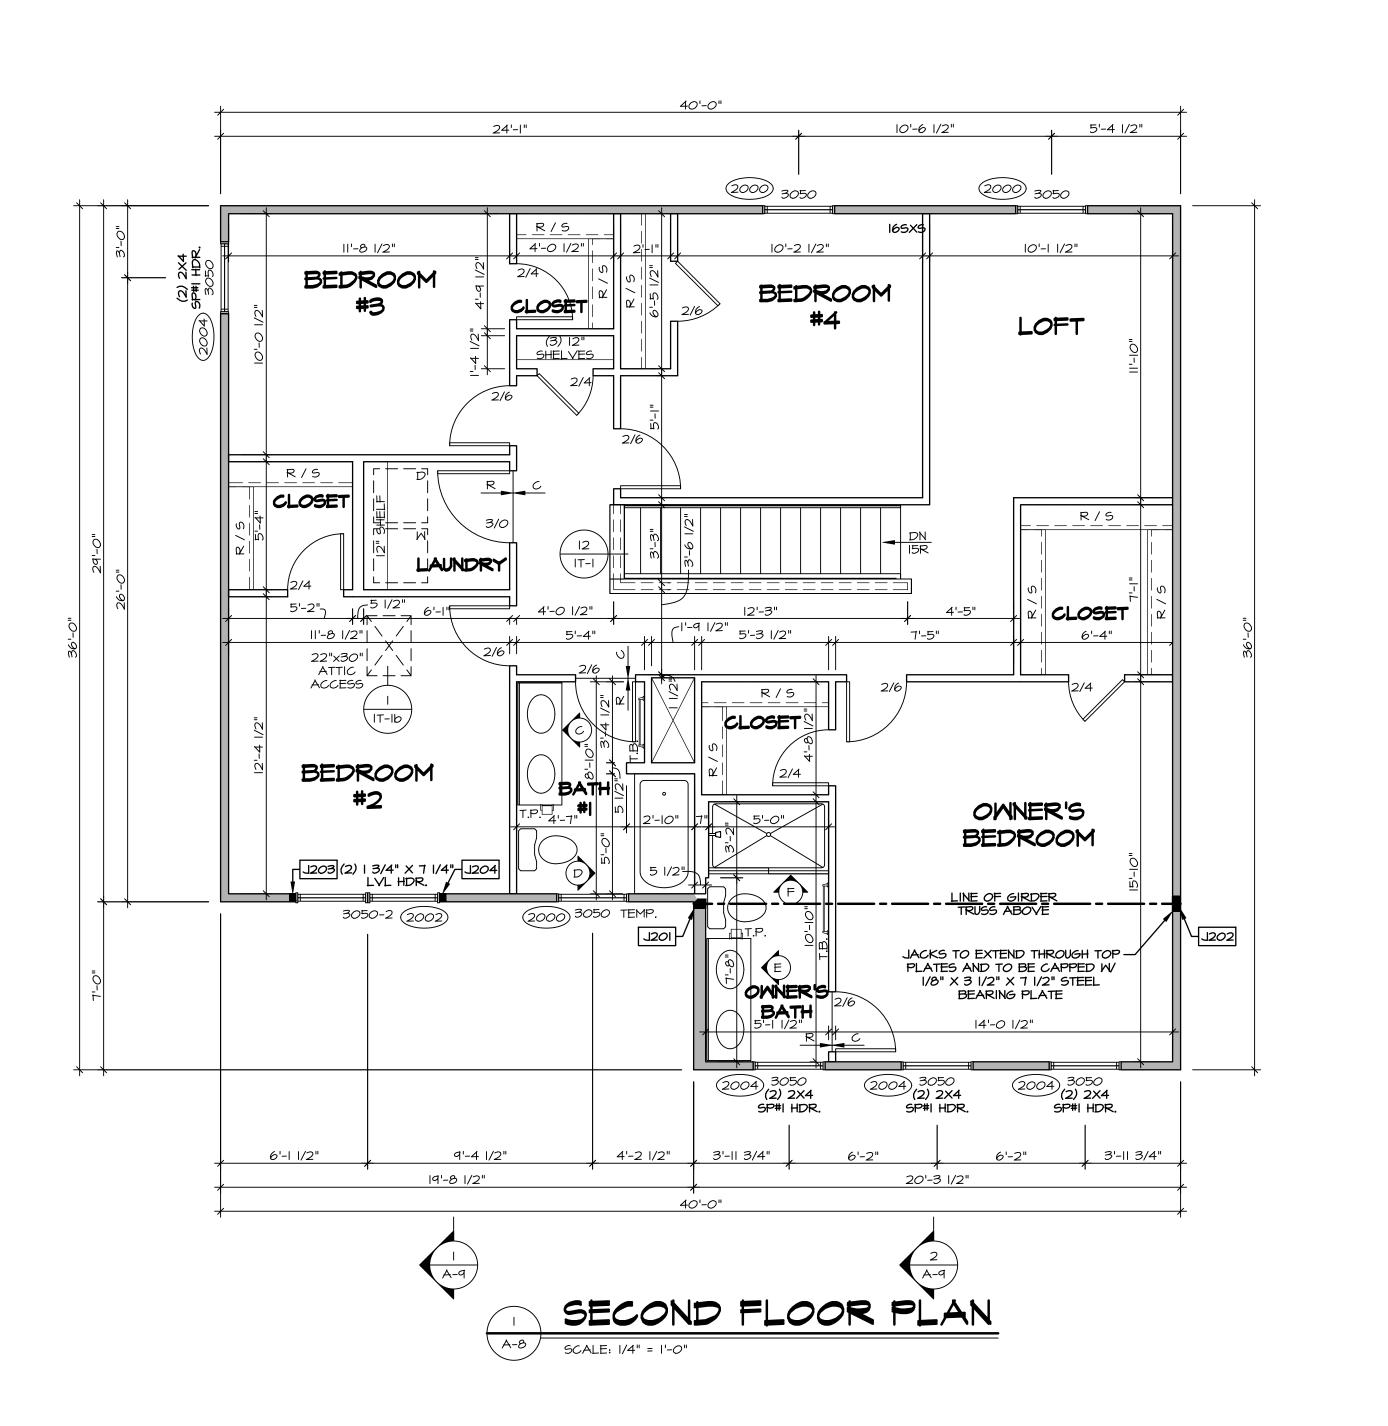

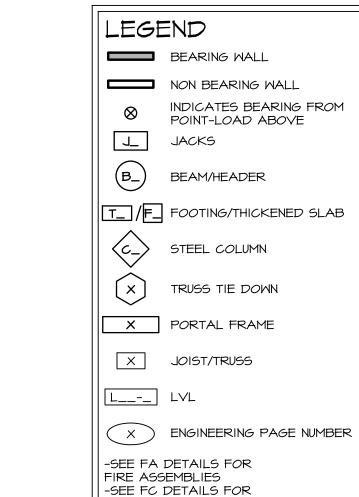

ALL WINDOWS HAVE 7'-4 5/8" HEADER HEIGHT UNLESS OTHERWISE NOTED

FRAMING CONNECTORS

FLOOR PLAN NOTES

- ALL HEADERS ARE (2) 2x6 w/ 2x4 WALLS OR (3) 2x6 w/ 2x6 WALLS, UNLESS OTHERWISE NOTED.
 ALL HEADERS TO HAVE (I) 2x4 OR 2x6 JACK AND KING STUD EACH END, UNLESS OTHERWISE NOTED.
 MULTI-OPENING HEADERS TO HAVE (2) JACKS AT INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. NO ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOUS LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISE NOTED.
- ALL EXTERIOR WALLS TO BE 4" w/ OSB OR 3 I/2" w/ LAMINATED FIBROUS STRUCTURAL SHEATHING, ALL INTERIOR WALLS TO BE 3 I/2", UNLESS OTHERWISE NOTED.
 HATCHED AREAS INDICATE DROPPED CEILINGS. ALL DROPPED CEILINGS ARE I2" UNLESS OTHERWISE NOTED. SEE ARCHITECTURAL DETAIL 8/IT-IB FOR 3/4" FIRE STOPPING AT BULKHEAD / CEILING PANELS
 SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIAL WALL FRAMING LOCATIONS AND HEADER SIZES, IF APPLICABLE.
- APPLICABLE.

 6. SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR INTERIOR TRIM DETAILS.

 7. SEE ARCHITECTURAL DETAIL SHEET "AD" FOR HOUSE SPECIFIC INTERIOR TRIM OPTION TABLE.
- 8. ALL HEADERS IN NON-BEARING WALLS SHALL BE A SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES ABOVE, UNLESS OTHERWISE NOTED.
 9. TANKED WATER HEATER SHOWN AS BASE CONDITION,
- OPTIONAL TANKLESS WATER HEATER IS AVAILABLE IN LIEU OF TANKED WATER HEATER.

 10. INTERIOR HEADER HEIGHT TO BE 6'-II" W/ 8'-O" CEILINGS AND 7'-II" W/ 9'-O" CEILINGS UNLESS OTHERWISE NOTED.
- II. BASEMENT FINISH DIMENSIONS ASSUME A 1/2" GAP
 BETWEEN FRAME WALL AND CONCRETE WALL.

 12. ALL INTERIOR BEARING WALLS SHALL HAVE GYPSUM
 APPLIED TO AT LEAST ONE SIDE OR HAVE MID-HEIGHT

GYPSUM NOTES

BLOCKING INSTALLED.


AT GARAGE:


GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL FA-I(b) FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.

AT STAIRS:


1/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS IN CLOSET

SECOND FLOOR JACK SCHEDULE					
DENTIFIER	DESCRIPTION	ENG. NUM.	REMARKS		
J20I	JACK - (3) 2X6 SPF STUD GRADE	2006			
J202	JACK - (5) 2X4 SPF STUD GRADE	2006			
J203	JACK - (2) 2X4 SPF STUD GRADE	2002			
J204	JACK - (2) 2X4 SPF STUD GRADE	2002			

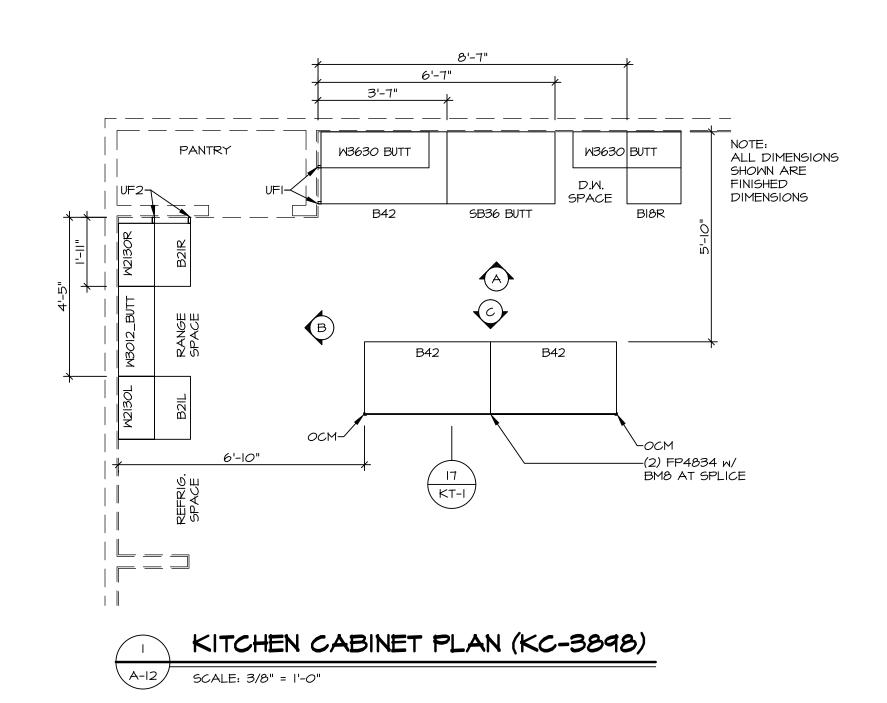


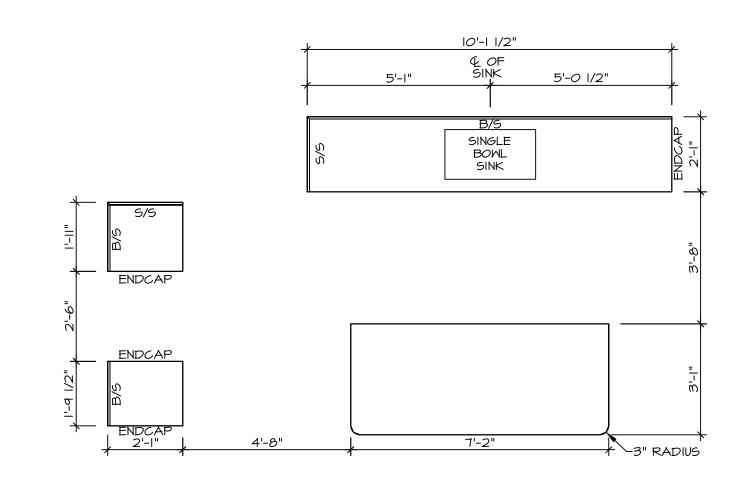


KITCHEN COUNTERTOP PLAN (KT-3898) A-12 SCALE: 3/8" = 1'-0"

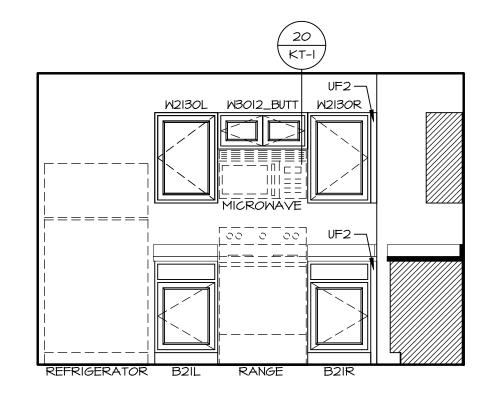



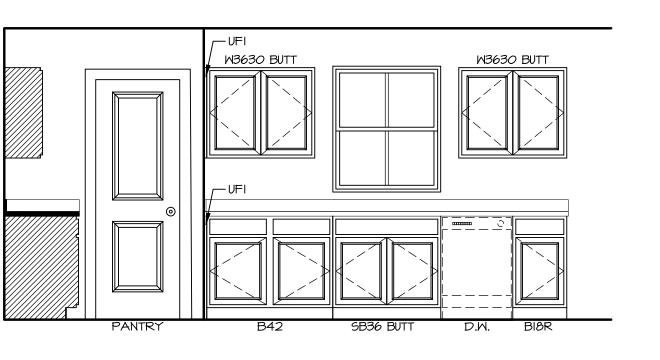



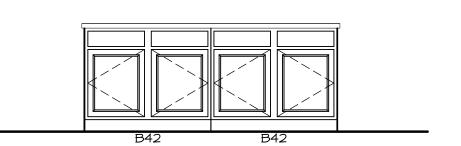

SCALE: 3/8" = 1'-0"

I. CABINET LAYOUT (S) ARE BASED ON FINISHED DIMENSIONS TO DRYWALL.

2. IF KITCHEN PLANS/ELEVATIONS CALL-OUT STANDARD MOLDING, REFER TO STANDARD DETAIL (II/KT-I) FOR REPLACEMENT BASED ON CABINET STYLE.

3. ALL (UF#) FILLERS ARE TO BE "TRIM TO FIT" UNLESS OTHERWISE NOTED.

4. CABINET MUST BE SET, SHIMMED, LEVELED AND PLUMB W ADJOINING BASE CABINETS.

5. SET PRE-FINISHED SCRIBE MOLDING AT CABINET BULKHEADS AND AT ENDS (WHERE CABINETS MEET DRYWALL.) PRE-FINISHED SCRIBE MOLDING SHALL BE USED TO PAD OUT CABINET SIDES AT STILE FOR RETURN PIECES OF THE FACE-MOUNTED CABINET CROWN MOLDING.


6. HARDWARE INSTALL NOTE: KNOBS GO ON OPERABLE DOORS AND DRAWERS FOR ALL KITCHEN AND BATH AREAS. DRAWER FRONTS AND DOORS GET (I) KNOB/PULL. NO HARDWARE ON FALSE DRAWER FRONTS. REFER TO STANDARD DETAIL 5/KT-Ib

NOTES:

CABINETS ARE NOT REPRESENTATIVE OF ALL STYLES AND ARE MEANT AS A GENERAL DEPICTION

OF THE INTENDED CABINET LAYOUT

9		APT. NO.	ZIP 45042	
52-04	RYAN - 0460		STATE OH	
DCY-52-0460	COMM-LOT SAWYERS MILL - SIMPLY RYAN - 0460	STREET ADDRESS 6055 RIVULET DRIVE	CITY MIDDLETOWN	
© NVR, Inc., The owner, expressly reserves its copyright and other property rights in these plans. These plans are not	to be reproduced, changed, or copied in any form or manner whatsoever, nor are they to be assigned to any third party, without	first obtaining the expressed written consent of NVR, Inc.		
© Co		5285 Westview Drive, Suite 100 fire Frederick, MD 21703		/21/24 - 1:31 pm
SET NO. ELDOO VERSION OI RELEASE NO	DRAWN BY DATE:	OPTION		pecific\A-12 KIT_LS.dwg 06,
MODEL FLOER DRAWING TITLE	KITCHEN PLANS & ELEVATIONS	OPTION DESCRIPTION		ves\ELDER_ELD00_01\DCY-S2-0460\3129559\Sheets\Lot Specific\A-12 KIT_LS.dwg 06/21/24 - 1:31 pm

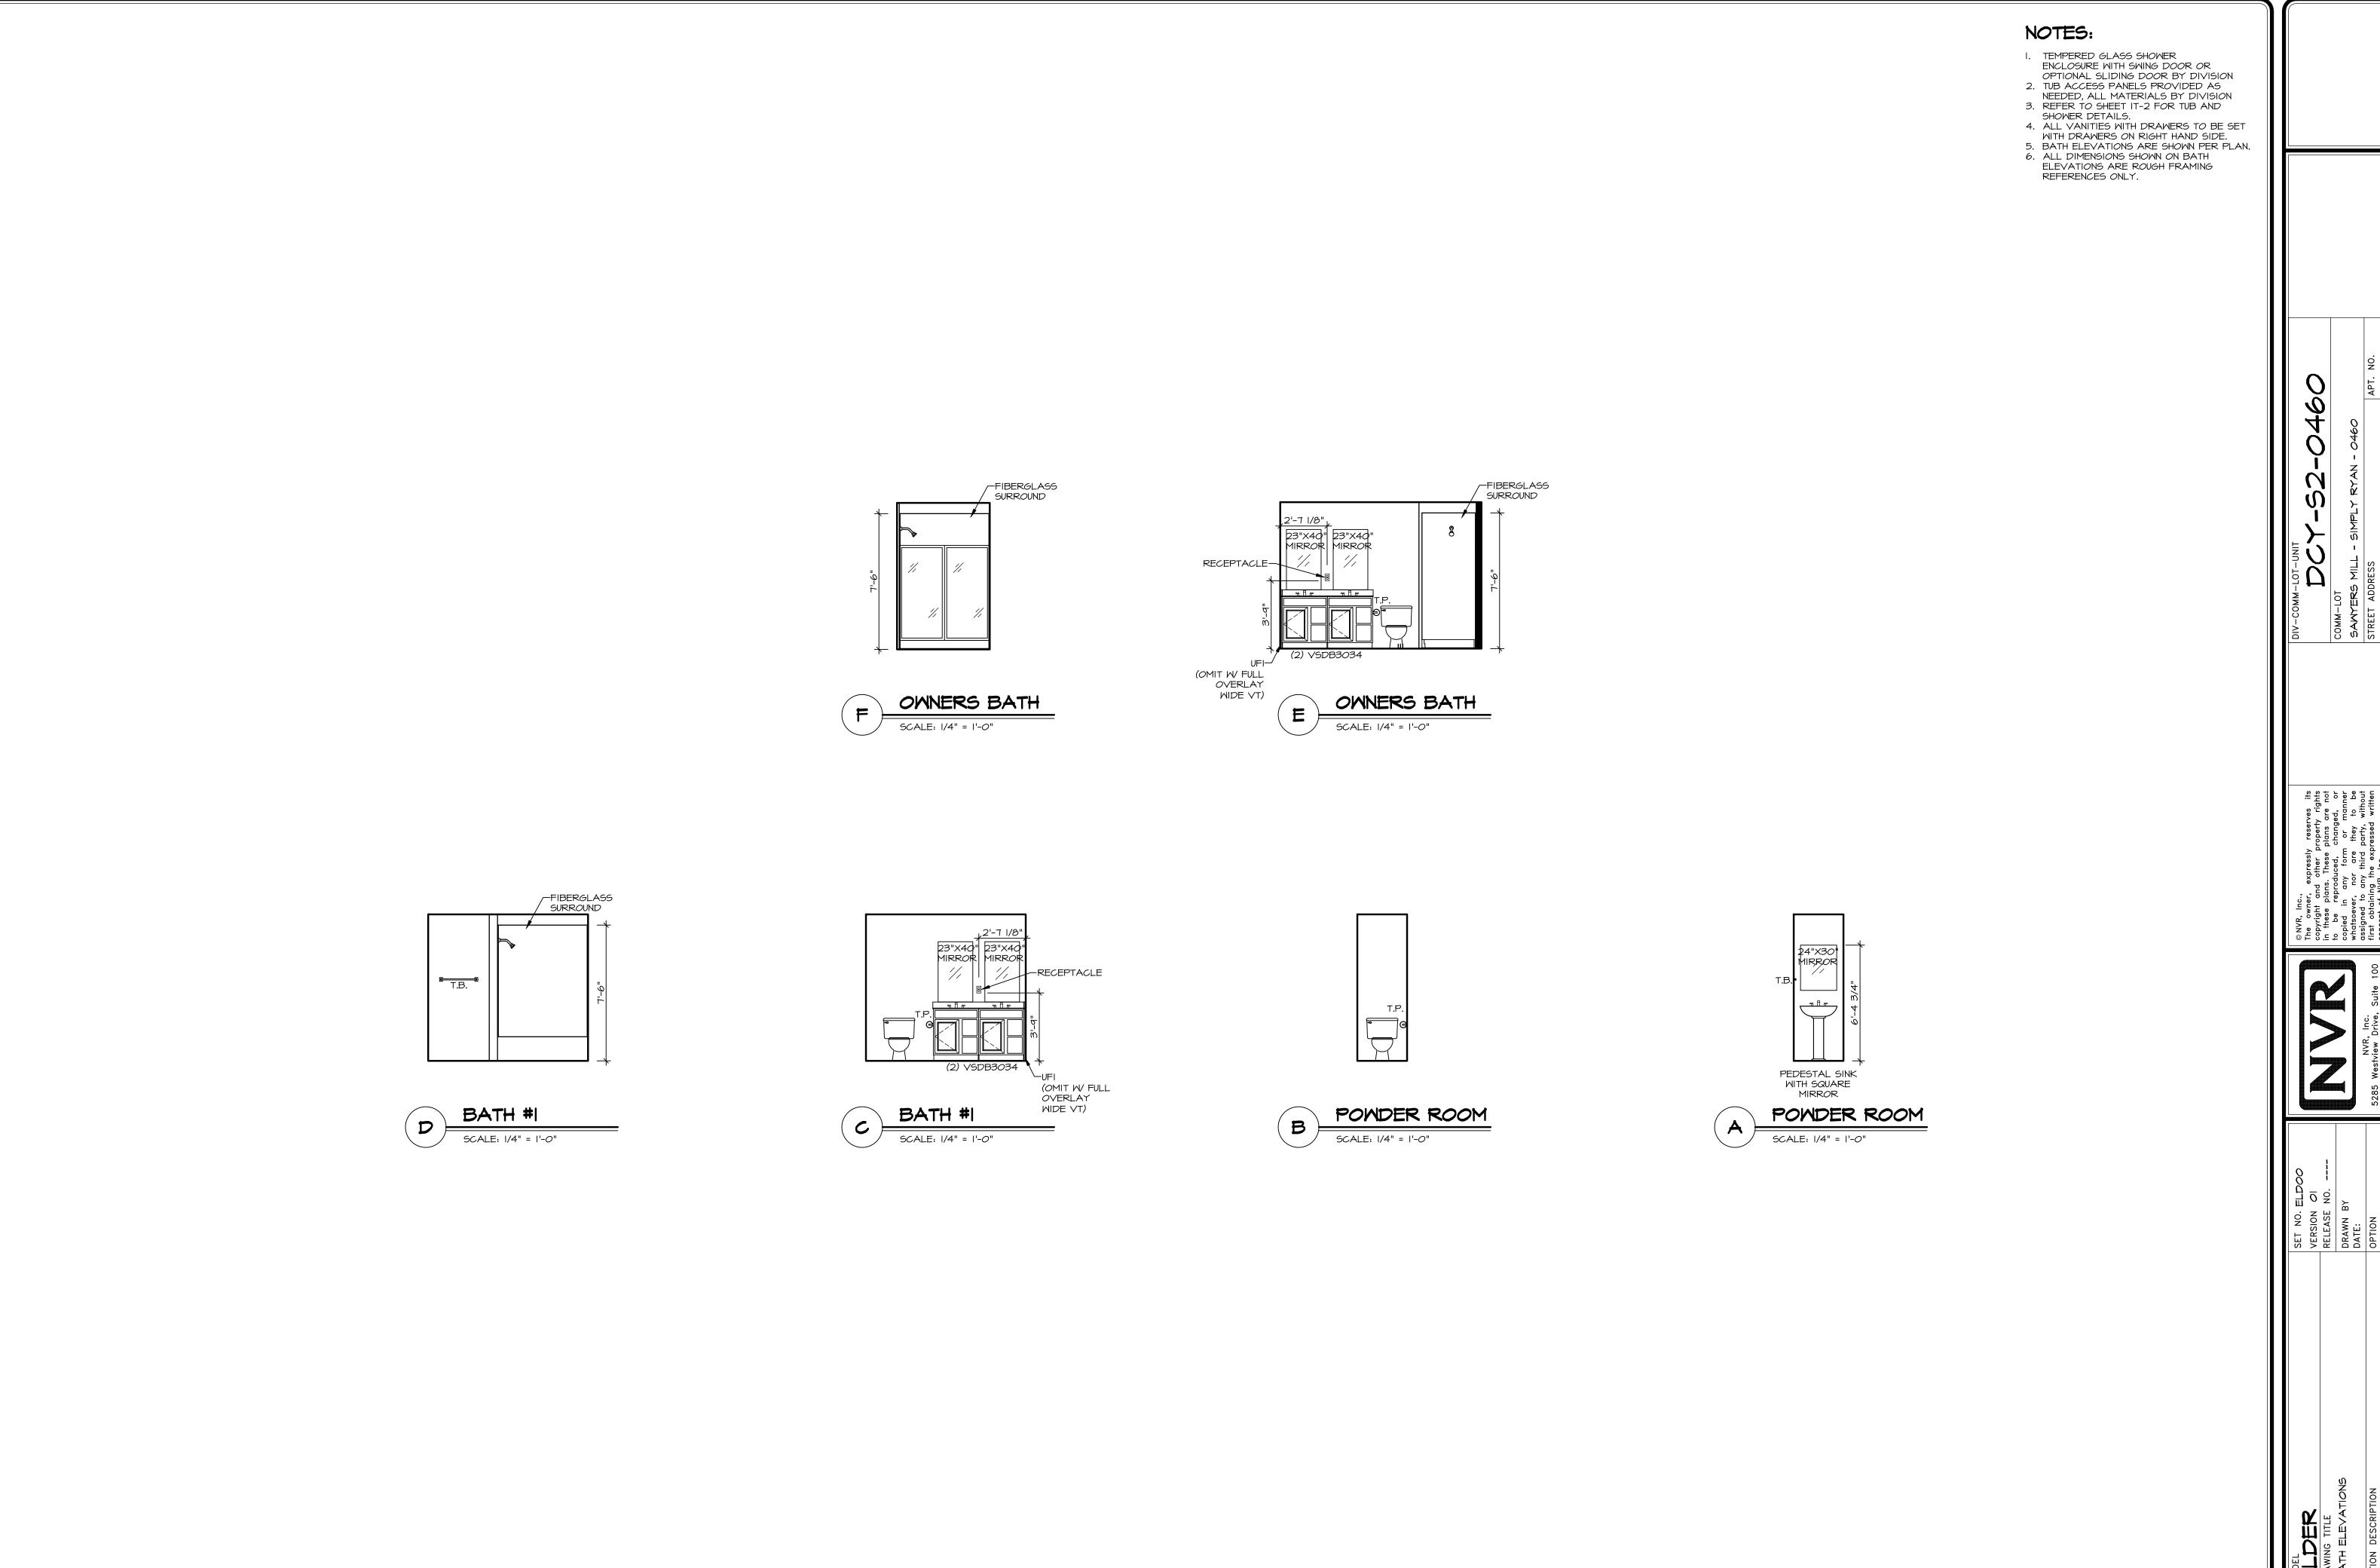

BATH ELEVATIONS

OPTION DESCRIPTION

C:\NVR\Solves\ELDER_ELDOO_01\DCY-S2-0460\3129559\Sheets\Lof S

