



NOTE

RADON REMEDIATION

RADON LOOP:

- (4") PERFORATED HDPE "LOOP"

- MUST BE PLACED IN STONE BED SLIGHTLY HIGHER THAN ANY INTERIOR DRAINTILE

- LOOP TO BE SEPARATE FROM ANY DRAINTILE ELEMENTS

- TO BE CORRUGATED HDPE PIPE

- SCREWS TO BE INSTALLED THROUGH LOOP AT TEE UP INTO STACK

STACK REQUIREMENTS:

- 3" PVC STACK (4" IF BASEMENT IS GREATER THAN 2200 SQFT.)

- NO PART OF STACK IS TO BE HORIZONTAL (45° ELBOWS PERMITTED AS REQUIRED)


- PIPE TO BE PHYSICALLY LABELED IN THE FIELD AS "RADON VENT" OR OTHER

JURISDICTIONALLY REQUIRED LANGUAGE (ON EVERY LEVEL OF HOUSE)


- ROOF TERMINATION TO BE IN TOP 1/3 OF ROOF

- SCREEN OR VENT CAP INSTALLED TO KEEP PESTS OUT OF RADON VENT AT ROOF TERMINATION.

	BASEMENT JACK SCHEDULE						
IDENTIFIER	DESCRIPTION	ENG. NUM.	REMARKS				

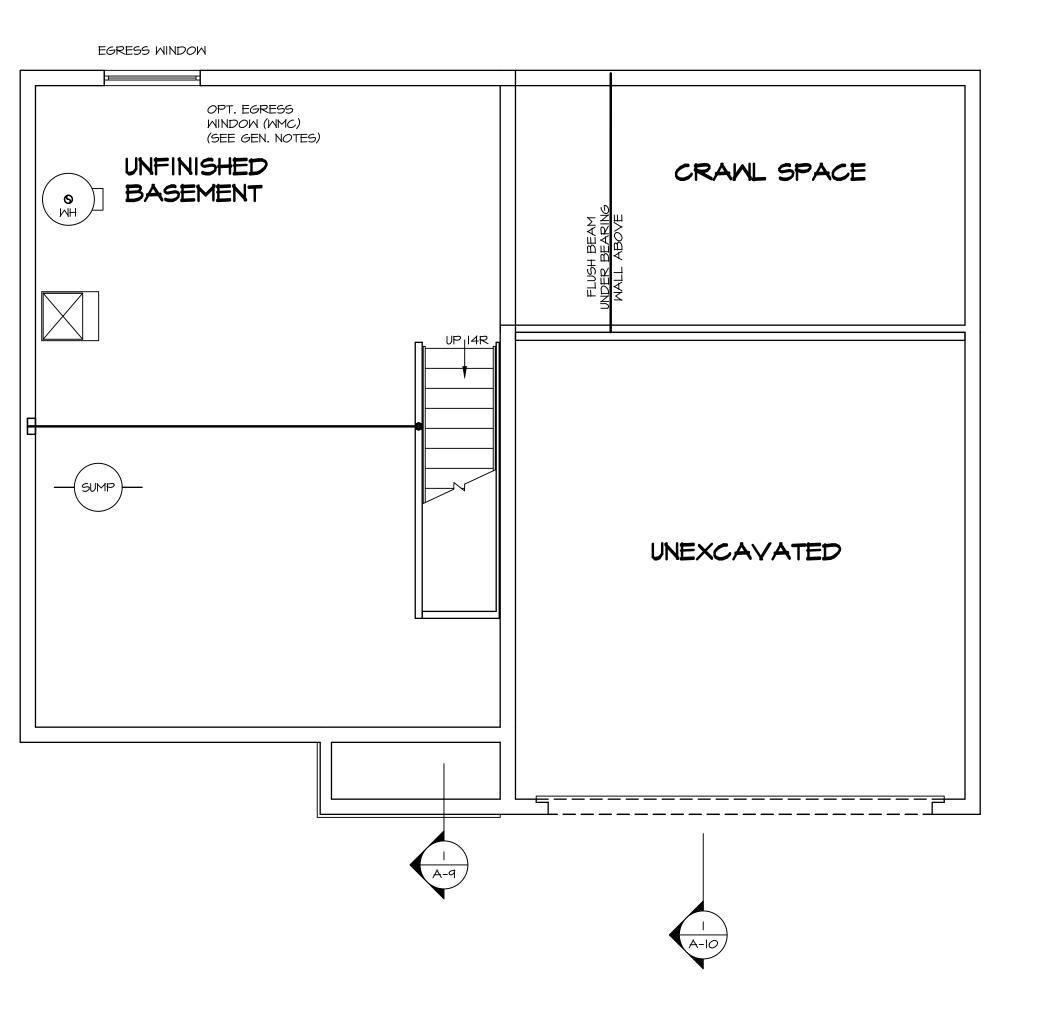



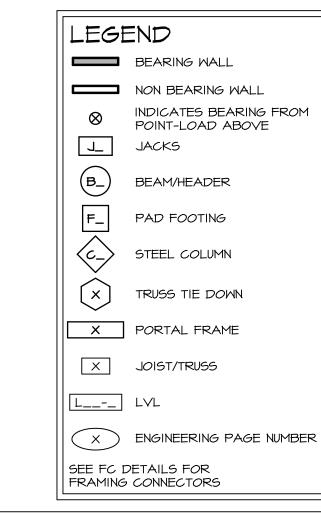

### FLOOR PLAN NOTES

- ALL HEADERS ARE (2) 2x6 w/ 2x4 WALLS OR (3) 2x6 w/ 2x6 WALLS, UNLESS OTHERWISE NOTED. ALL HEADERS TO HAVE (1) 2x4 OR 2x6 JACK AND KING
- STUD EACH END, UNLESS OTHERWISE NOTED. MULTI-OPENING HEADERS TO HAVE (2) JACKS AT INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. NO ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOUS LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISE
- NOTED. 3. ALL EXTERIOR WALLS TO BE 4" w/ OSB OR 3 1/2"
- W/ LAMINATED FIBROUS STRUCTURAL SHEATHING, ALL INTERIOR WALLS TO BE 3 1/2", UNLESS OTHERWISE NOTED. 4. HATCHED AREAS INDICATE DROPPED CEILINGS. ALL
  DROPPED CEILINGS ARE 12" UNLESS OTHERWISE NOTED.

  5. SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIAL
- WALL FRAMING LOCATIONS AND HEADER SIZES, IF APPLICABLE.
- 6. SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR
- INTERIOR TRIM DETAILS.
  . SEE ARCHITECTURAL DETAIL SHEET "AD" FOR HOUSE SPECIFIC INTERIOR TRIM OPTION TABLE. 8. ALL WINDOWS HAVE 7'-0 1/2" HEADER HEIGHT UNLESS
- OTHERWISE NOTED. 9. ALL HEADERS IN NON-BEARING WALLS SHALL BE A SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES
- ABOVE, UNLESS OTHERWISE NOTED.

  10. TANKED WATER HEATER SHOWN AS BASE CONDITION, OPTIONAL TANKLESS WATER HEATER IS AVAILABLE IN LIEU OF TANKED WATER HEATER.

# GYPSUM NOTES

AT GARAGE:


GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL FA-I(b)
FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.

AT STAIRS:


1/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS IN CLOSET

FIRST FLOOR JACK SCHEDULE						
IDENTIFIER	DESCRIPTION	ENG. NUM.	REMARKS			
IOIL	JACK - (3) 2X4 SPF STUD GRADE	1019				
JI02	JACK - (2) 2X4 SPF STUD GRADE	1019				
SOIL	JACK - (2) 2X4 SPF STUD GRADE	1014				
JIO4	JACK - (2) 2X4 SPF STUD GRADE	1014				
JI <i>0</i> 5	JACK - (2) 2X4 SPF STUD GRADE	1012				
JI06	JACK - (4) 2X4 SP#I	1025				
TOIL	JACK - (4) 2X4 SP#I	1025				
80IL	JACK - (2) 2X4 SPF STUD GRADE	1008				
POIL	JACK - (2) 2X4 SPF STUD GRADE	1008				
OIIL	JACK - (2) 2X4 SPF STUD GRADE	1010				
III	JACK - (2) 2X4 SPF STUD GRADE	1010				
JII2	JACK - (4) 2X4 SPF STUD GRADE	1006				
SIIL	JACK - (4) 2X4 SPF STUD GRADE	1006				
JII4	JACK - (4) 2X4 SPF STUD GRADE	1006				
JII5	JACK - (4) 2X4 SPF STUD GRADE	1006				

FIELD INSTALLED FIRST FLOOR BEAM/HEADER SCHEDULE						
IDENTIFIER	DESCRIPTION	LENGTH	ENG. NUM.	REMARKS		
BIOI	INT HEADER - 2X8 - 2 PLY	3'-7"	1019			

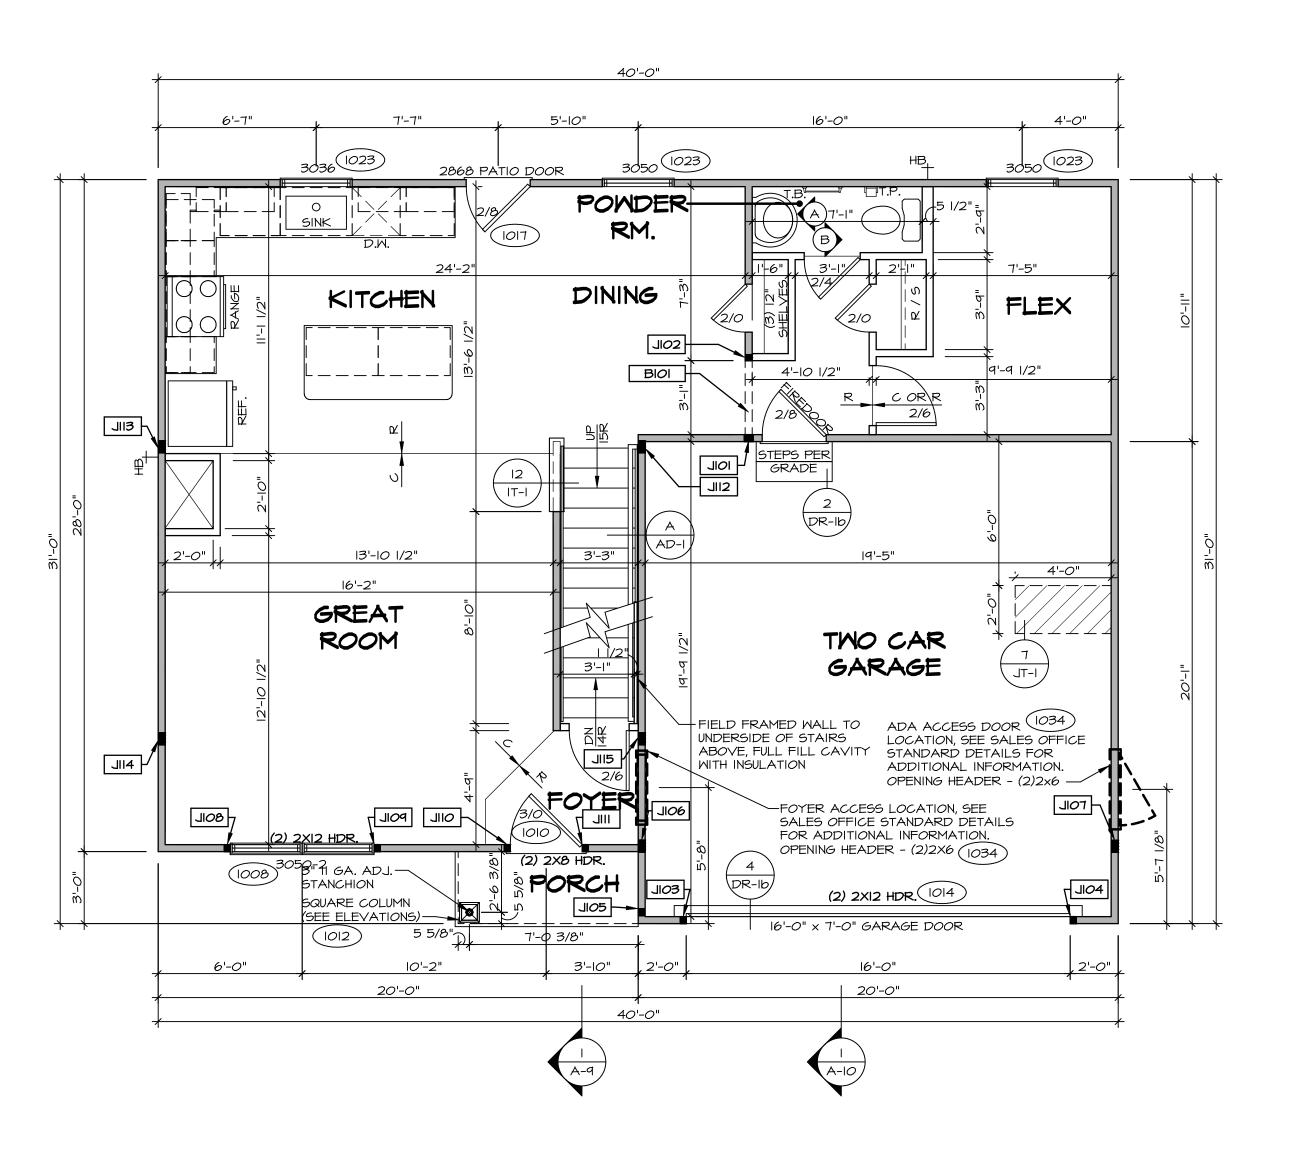



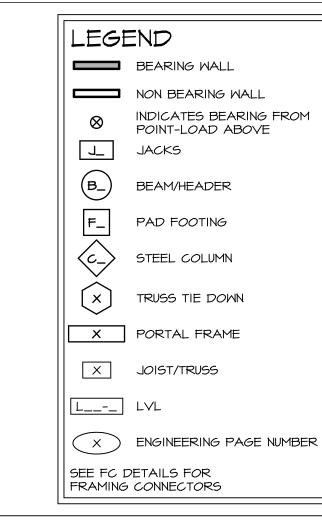

### FLOOR PLAN NOTES

- ALL HEADERS ARE (2) 2x6 w/ 2x4 WALLS OR (3) 2x6 w/ 2x6 WALLS, UNLESS OTHERWISE NOTED.
   ALL HEADERS TO HAVE (1) 2x4 OR 2x6 JACK AND KING
- STUD EACH END, UNLESS OTHERWISE NOTED.

  MULTI-OPENING HEADERS TO HAVE (2) JACKS AT
  INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. NO
  ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOUS
  LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISE
- NOTED.

  3. ALL EXTERIOR WALLS TO BE 4" w/ OSB OR 3 1/2"
  w/ LAMINATED FIBROUS STRUCTURAL SHEATHING, ALL
- INTERIOR WALLS TO BE 3 1/2", UNLESS OTHERWISE NOTED.

  4. HATCHED AREAS INDICATE DROPPED CEILINGS. ALL
- DROPPED CEILINGS ARE I2" UNLESS OTHERWISE NOTED.

  5. SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIAL WALL FRAMING LOCATIONS AND HEADER SIZES, IF APPLICABLE.
- 6. SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR
- INTERIOR TRIM DETAILS.

  7. SEE ARCHITECTURAL DETAIL SHEET "AD" FOR HOUSE SPECIFIC INTERIOR TRIM OPTION TABLE.

  8. ALL WINDOWS HAVE 7'-0 1/2" HEADER HEIGHT UNLESS
- OTHERMISE NOTED.

  9. ALL HEADERS IN NON-BEARING WALLS SHALL BE A SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES
- ABOVE, UNLESS OTHERWISE NOTED.

  10. TANKED WATER HEATER SHOWN AS BASE CONDITION,
  OPTIONAL TANKLESS WATER HEATER IS AVAILABLE IN
  LIEU OF TANKED WATER HEATER.

## GYPSUM NOTES

AT GARAGE:

GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL FA-I(b) FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.

AT STAIRS:

1/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS


NVR, Inc.
5285 Westview Drive, Suite 100
Frederick, MD 21703

DRAWN BY
DATE:
OPTION


PLAN

CECAR RAWING TITLE FIRST FLOOR PLA

**1** 

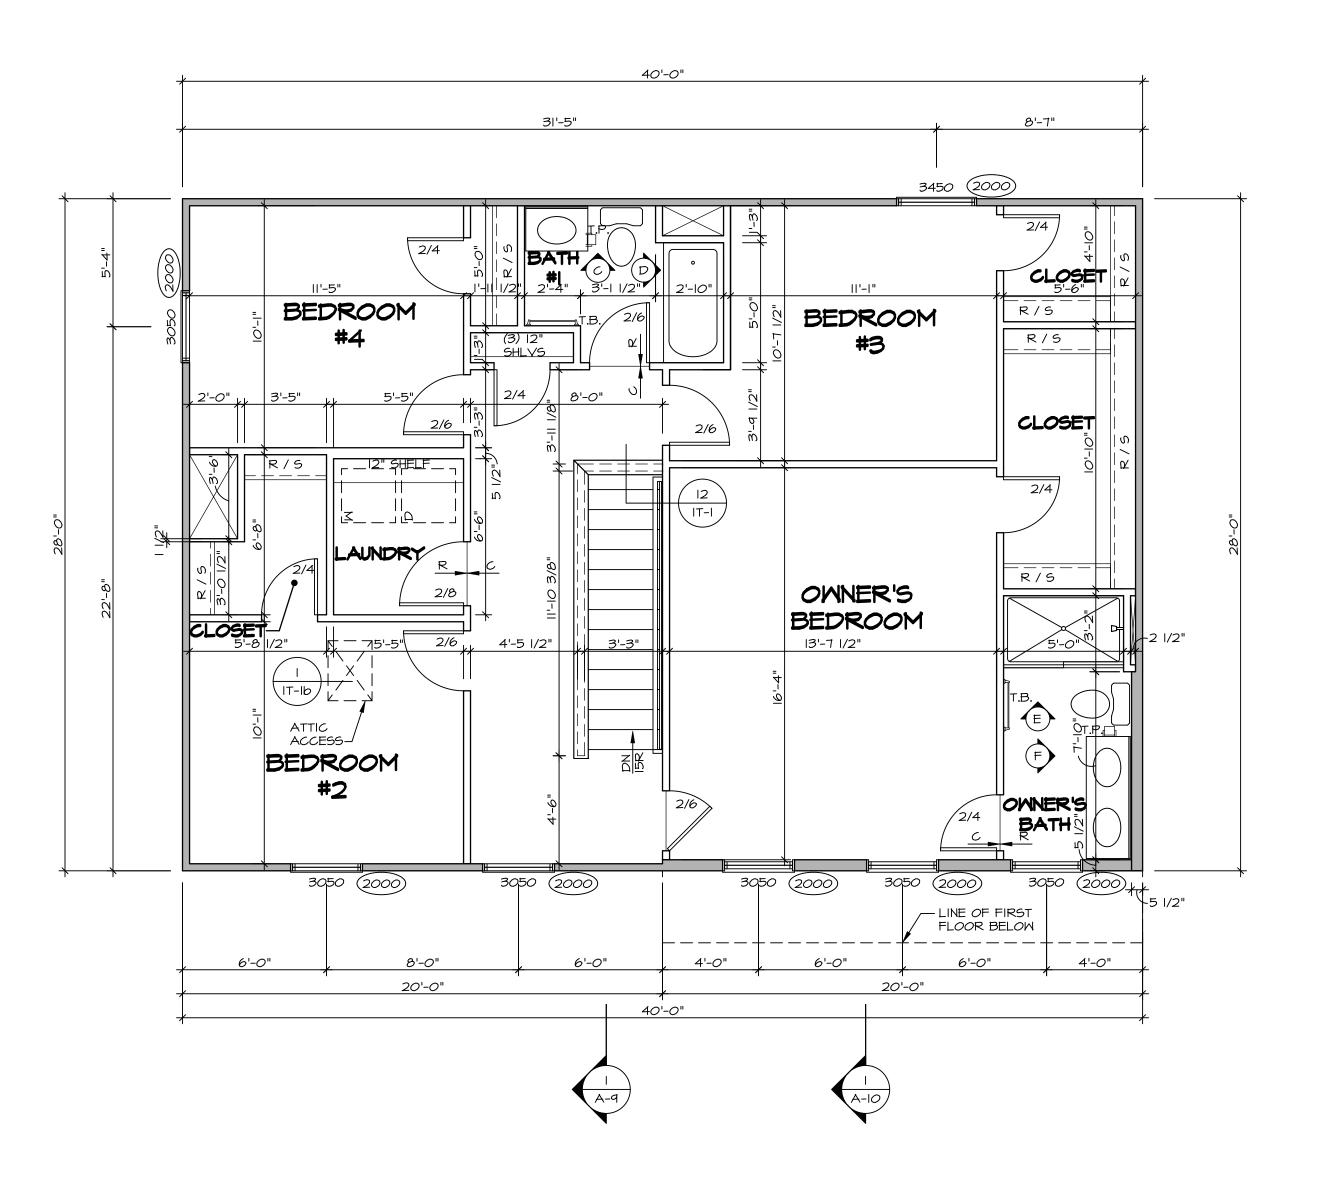



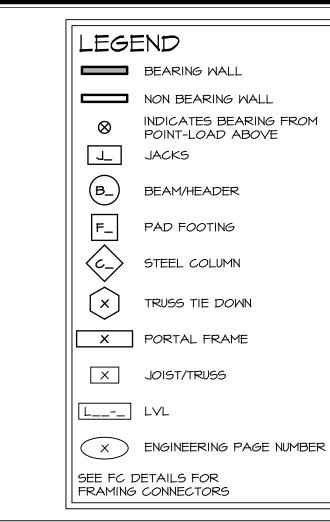

### FLOOR PLAN NOTES

- ALL HEADERS ARE (2) 2x6 w/ 2x4 WALLS OR (3) 2x6 w/ 2x6 WALLS, UNLESS OTHERWISE NOTED. ALL HEADERS TO HAVE (I) 2x4 OR 2x6 JACK AND KING
- STUD EACH END, UNLESS OTHERWISE NOTED. MULTI-OPENING HEADERS TO HAVE (2) JACKS AT INTERMEDIATE BEARING, UNLESS OTHERWISE NOTED. NO ADDITIONAL FLOOR SYSTEM BLOCKING OR CONTINUOUS LOAD PATH JACKS ARE REQUIRED UNLESS OTHERWISE
- NOTED. . ALL EXTERIOR WALLS TO BE 4" W/ OSB OR 3 1/2"
- W/ LAMINATED FIBROUS STRUCTURAL SHEATHING, ALL INTERIOR WALLS TO BE 3 1/2", UNLESS OTHERWISE NOTED. . HATCHED AREAS INDICATE DROPPED CEILINGS. ALL DROPPED CEILINGS ARE 12" UNLESS OTHERWISE NOTED. SEE "BRACED WALL PANEL DETAIL SHEET" FOR SPECIAL
- WALL FRAMING LOCATIONS AND HEADER SIZES, IF
- APPLICABLE.

  6. SEE STANDARD DETAIL CATEGORY "IT" SHEET(S) FOR
- INTERIOR TRIM DETAILS. SEE ARCHITECTURAL DETAIL SHEET "AD" FOR HOUSE SPECIFIC INTERIOR TRIM OPTION TABLE.
- 8. ALL WINDOWS HAVE 7'-0 1/2" HEADER HEIGHT UNLESS OTHERWISE NOTED. 9. ALL HEADERS IN NON-BEARING WALLS SHALL BE A SINGLE FLAT 2X4 OR 2X6 ATTACHED TO CRIPPLES
- ABOVE, UNLESS OTHERWISE NOTED.

  10. TANKED WATER HEATER SHOWN AS BASE CONDITION, OPTIONAL TANKLESS WATER HEATER IS AVAILABLE IN LIEU OF TANKED WATER HEATER.


# GYPSUM NOTES

AT GARAGE:


GYPSUM BOARD AT COMMON WALLS, CEILINGS, BEAM WRAPS AND SUPPORTS PER STANDARD DETAIL FA-I(b) FIRE ASSEMBLIES OR AS REQUIRED BY LOCAL CODE.

AT STAIRS:


1/2" GYPSUM BOARD AT UNDERSIDE OF STAIRS AND WALLS IN CLOSET

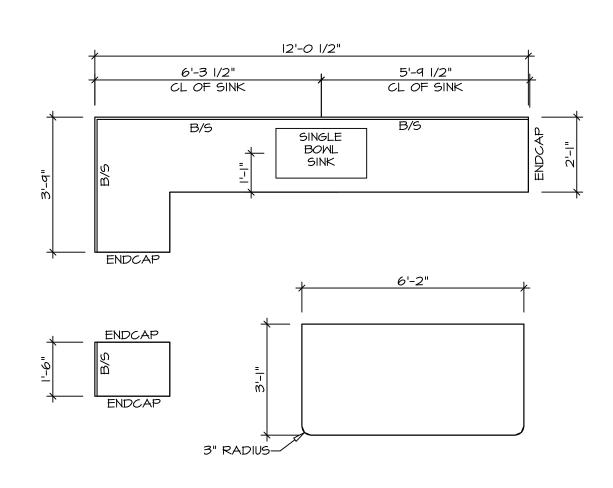




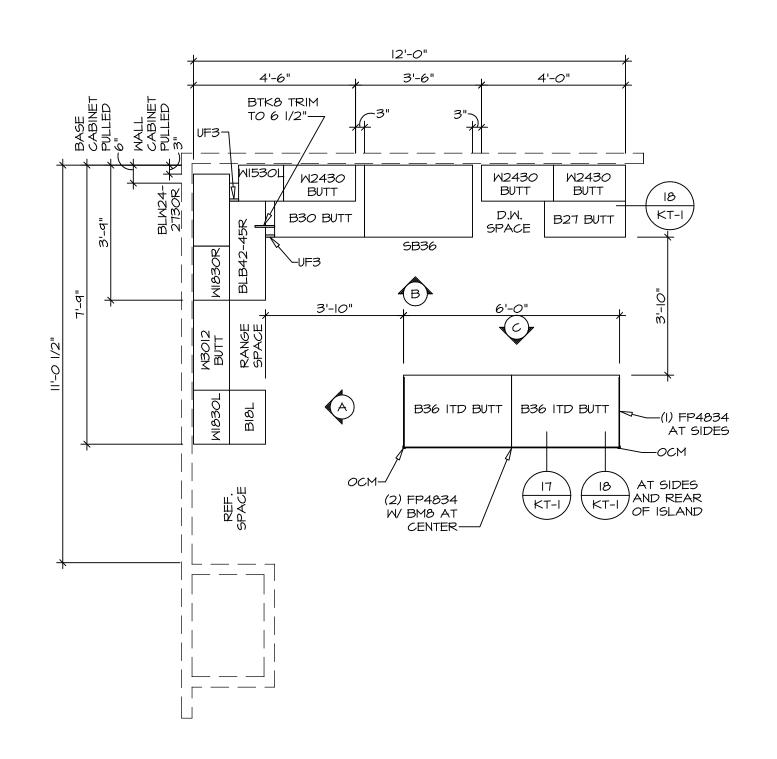


KITCHEN CABINET PLAN KC - 3640 A-12 SCALE: 3/8" = 1'-0"

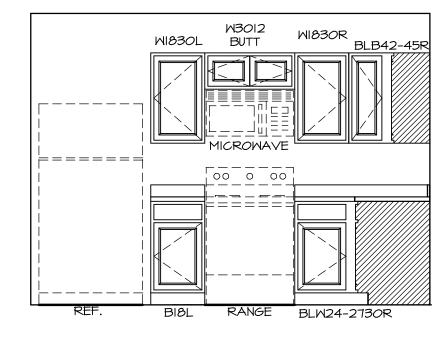



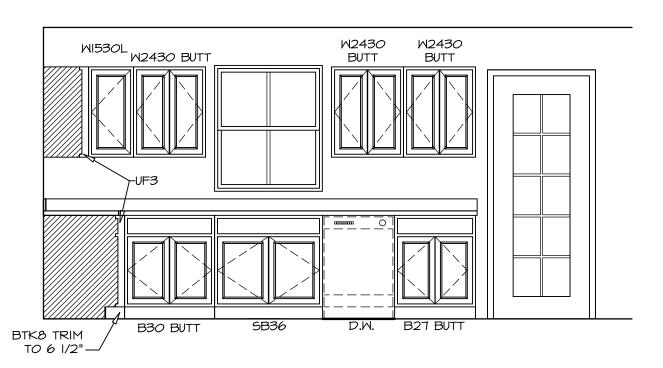



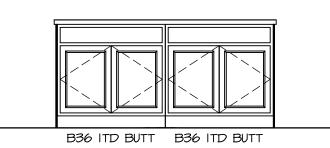


NOTES:

I. CABINET LAYOUT(S) ARE BASED ON FINISHED DIMENSIONS TO DRYWALL.

2. IF KITCHEN PLANS/ELEVATIONS CALL-OUT STANDARD MOULDING, REFER TO STANDARD DETAIL (II/KT-I) FOR REPLACEMENT BASED ON CABINET STYLE.

3. ALL (UF#) FILLERS ARE TO BE "TRIM TO FIT".

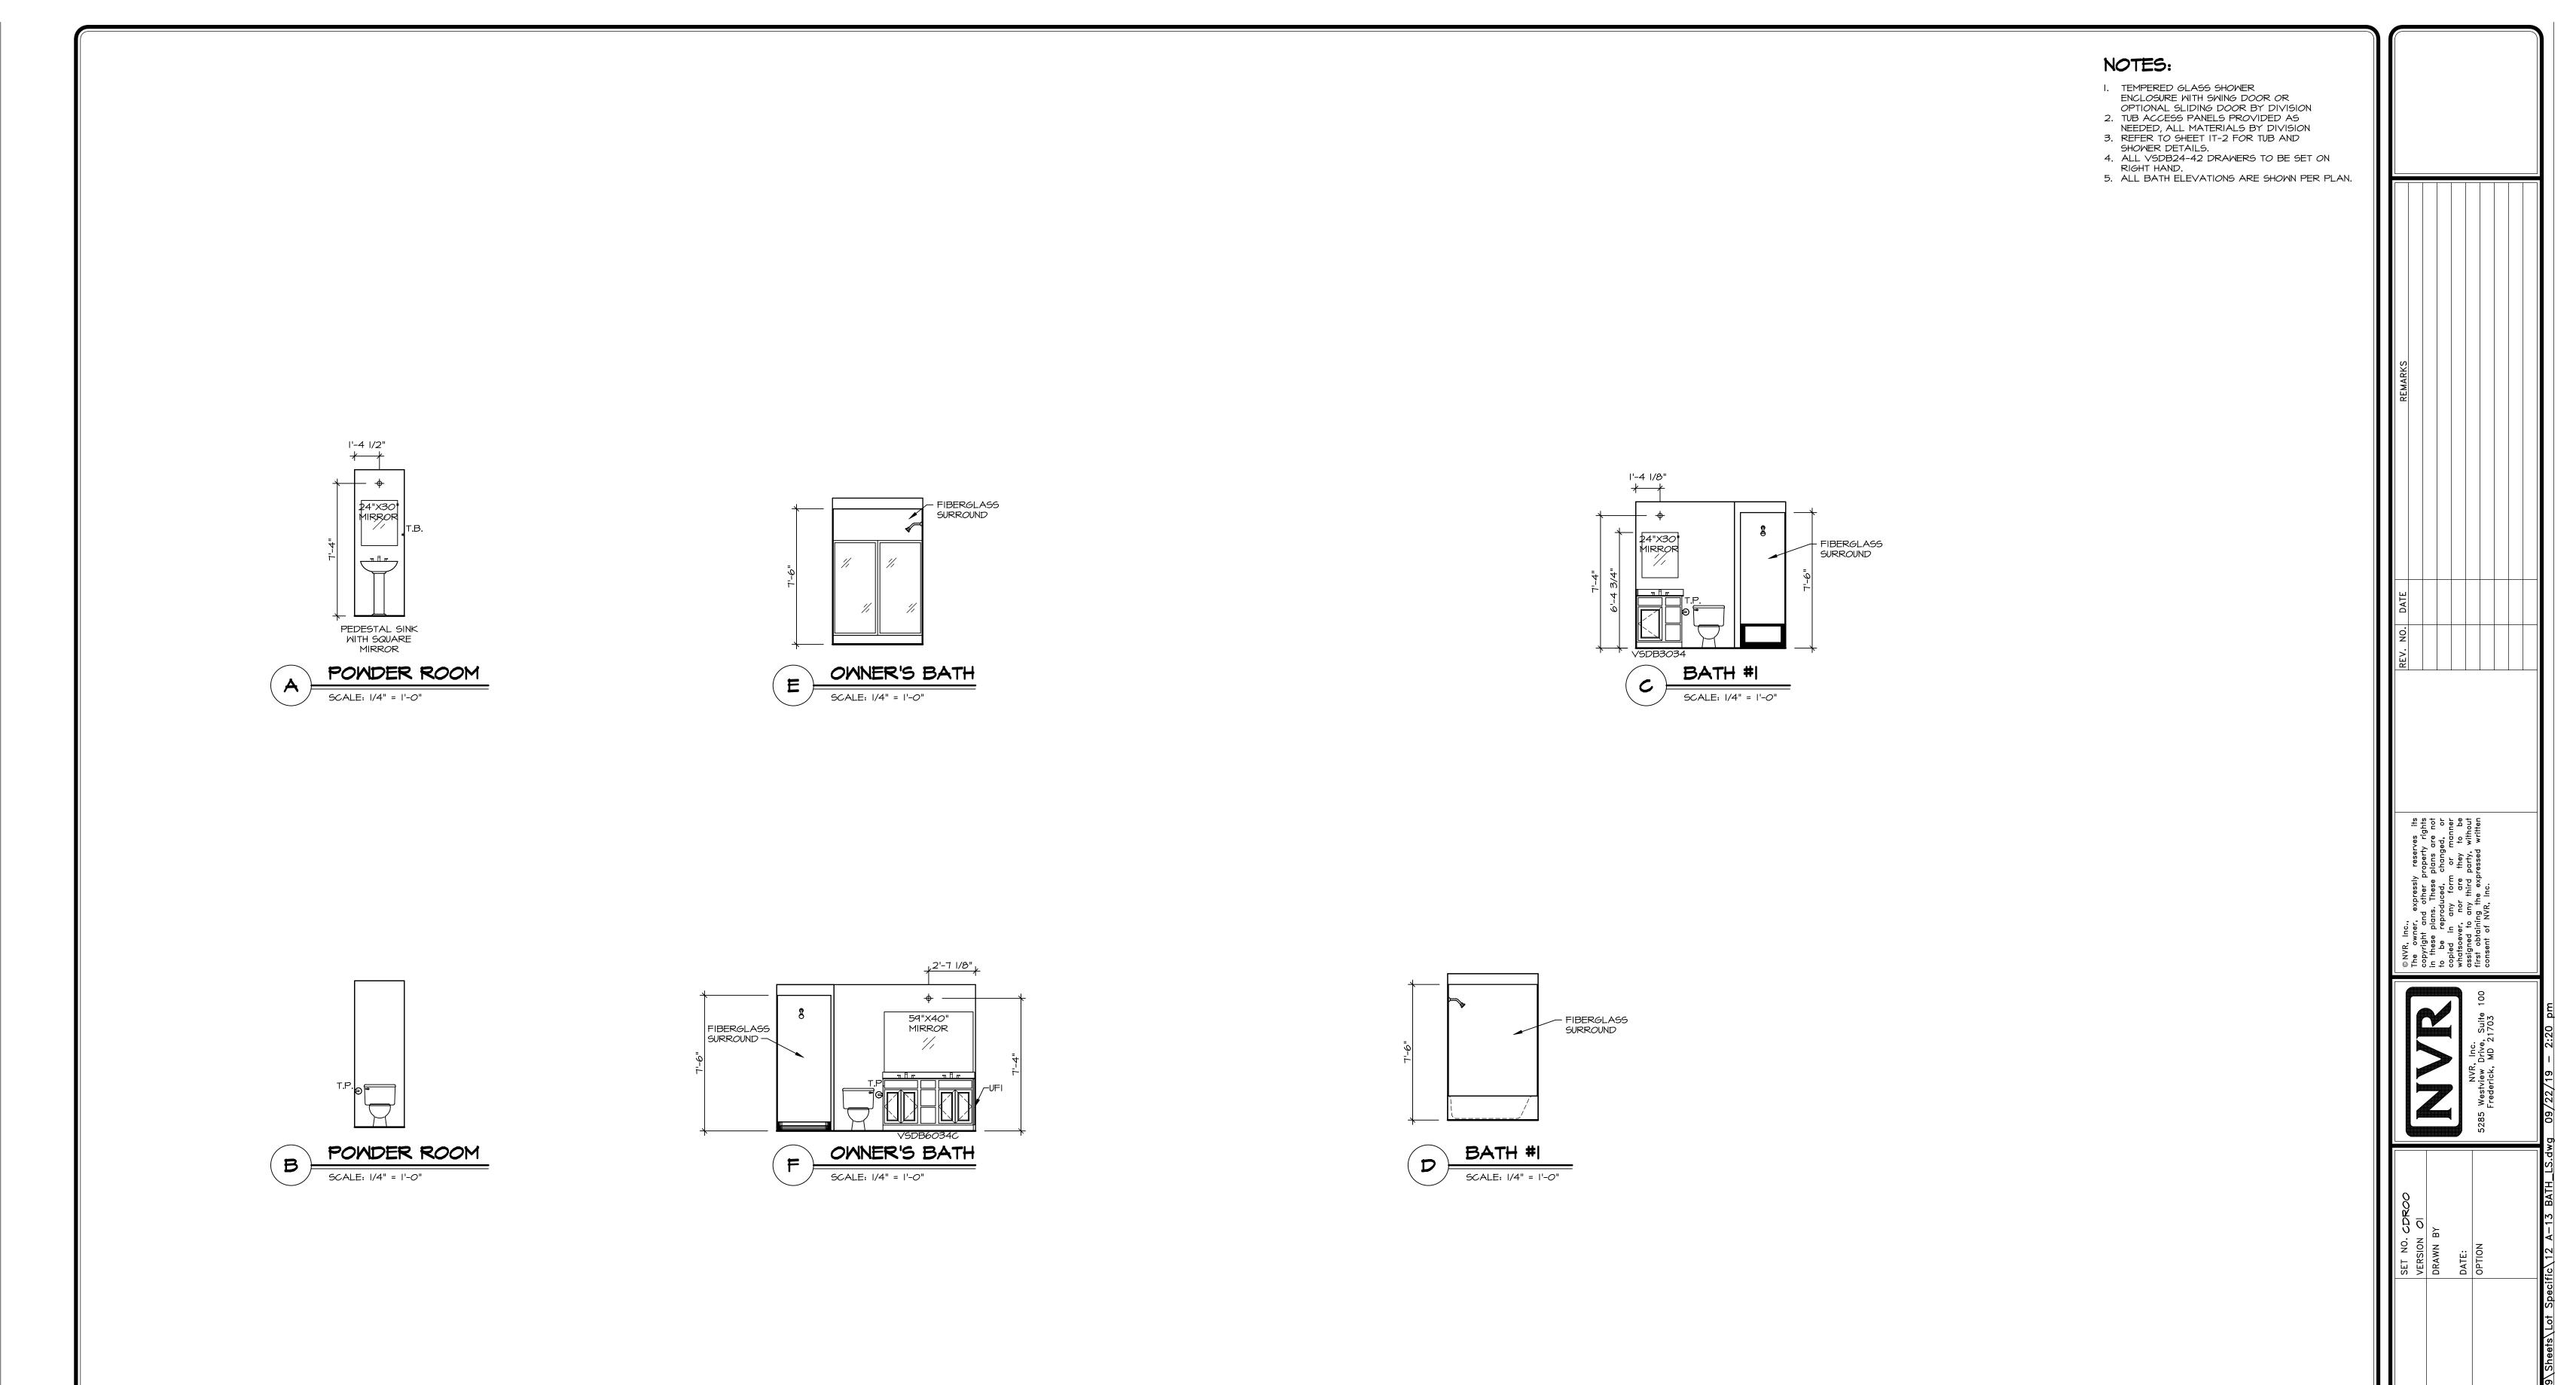

DRAWING TITLE
BATH ELEVATIONS
OPTION DESCRIPTION