


**NATE !**

**MAKE SURE SUMP INSTALLED  
ALL PVC LINES ASIDE OF ONE 2" RISER CAPPED OFF !!**

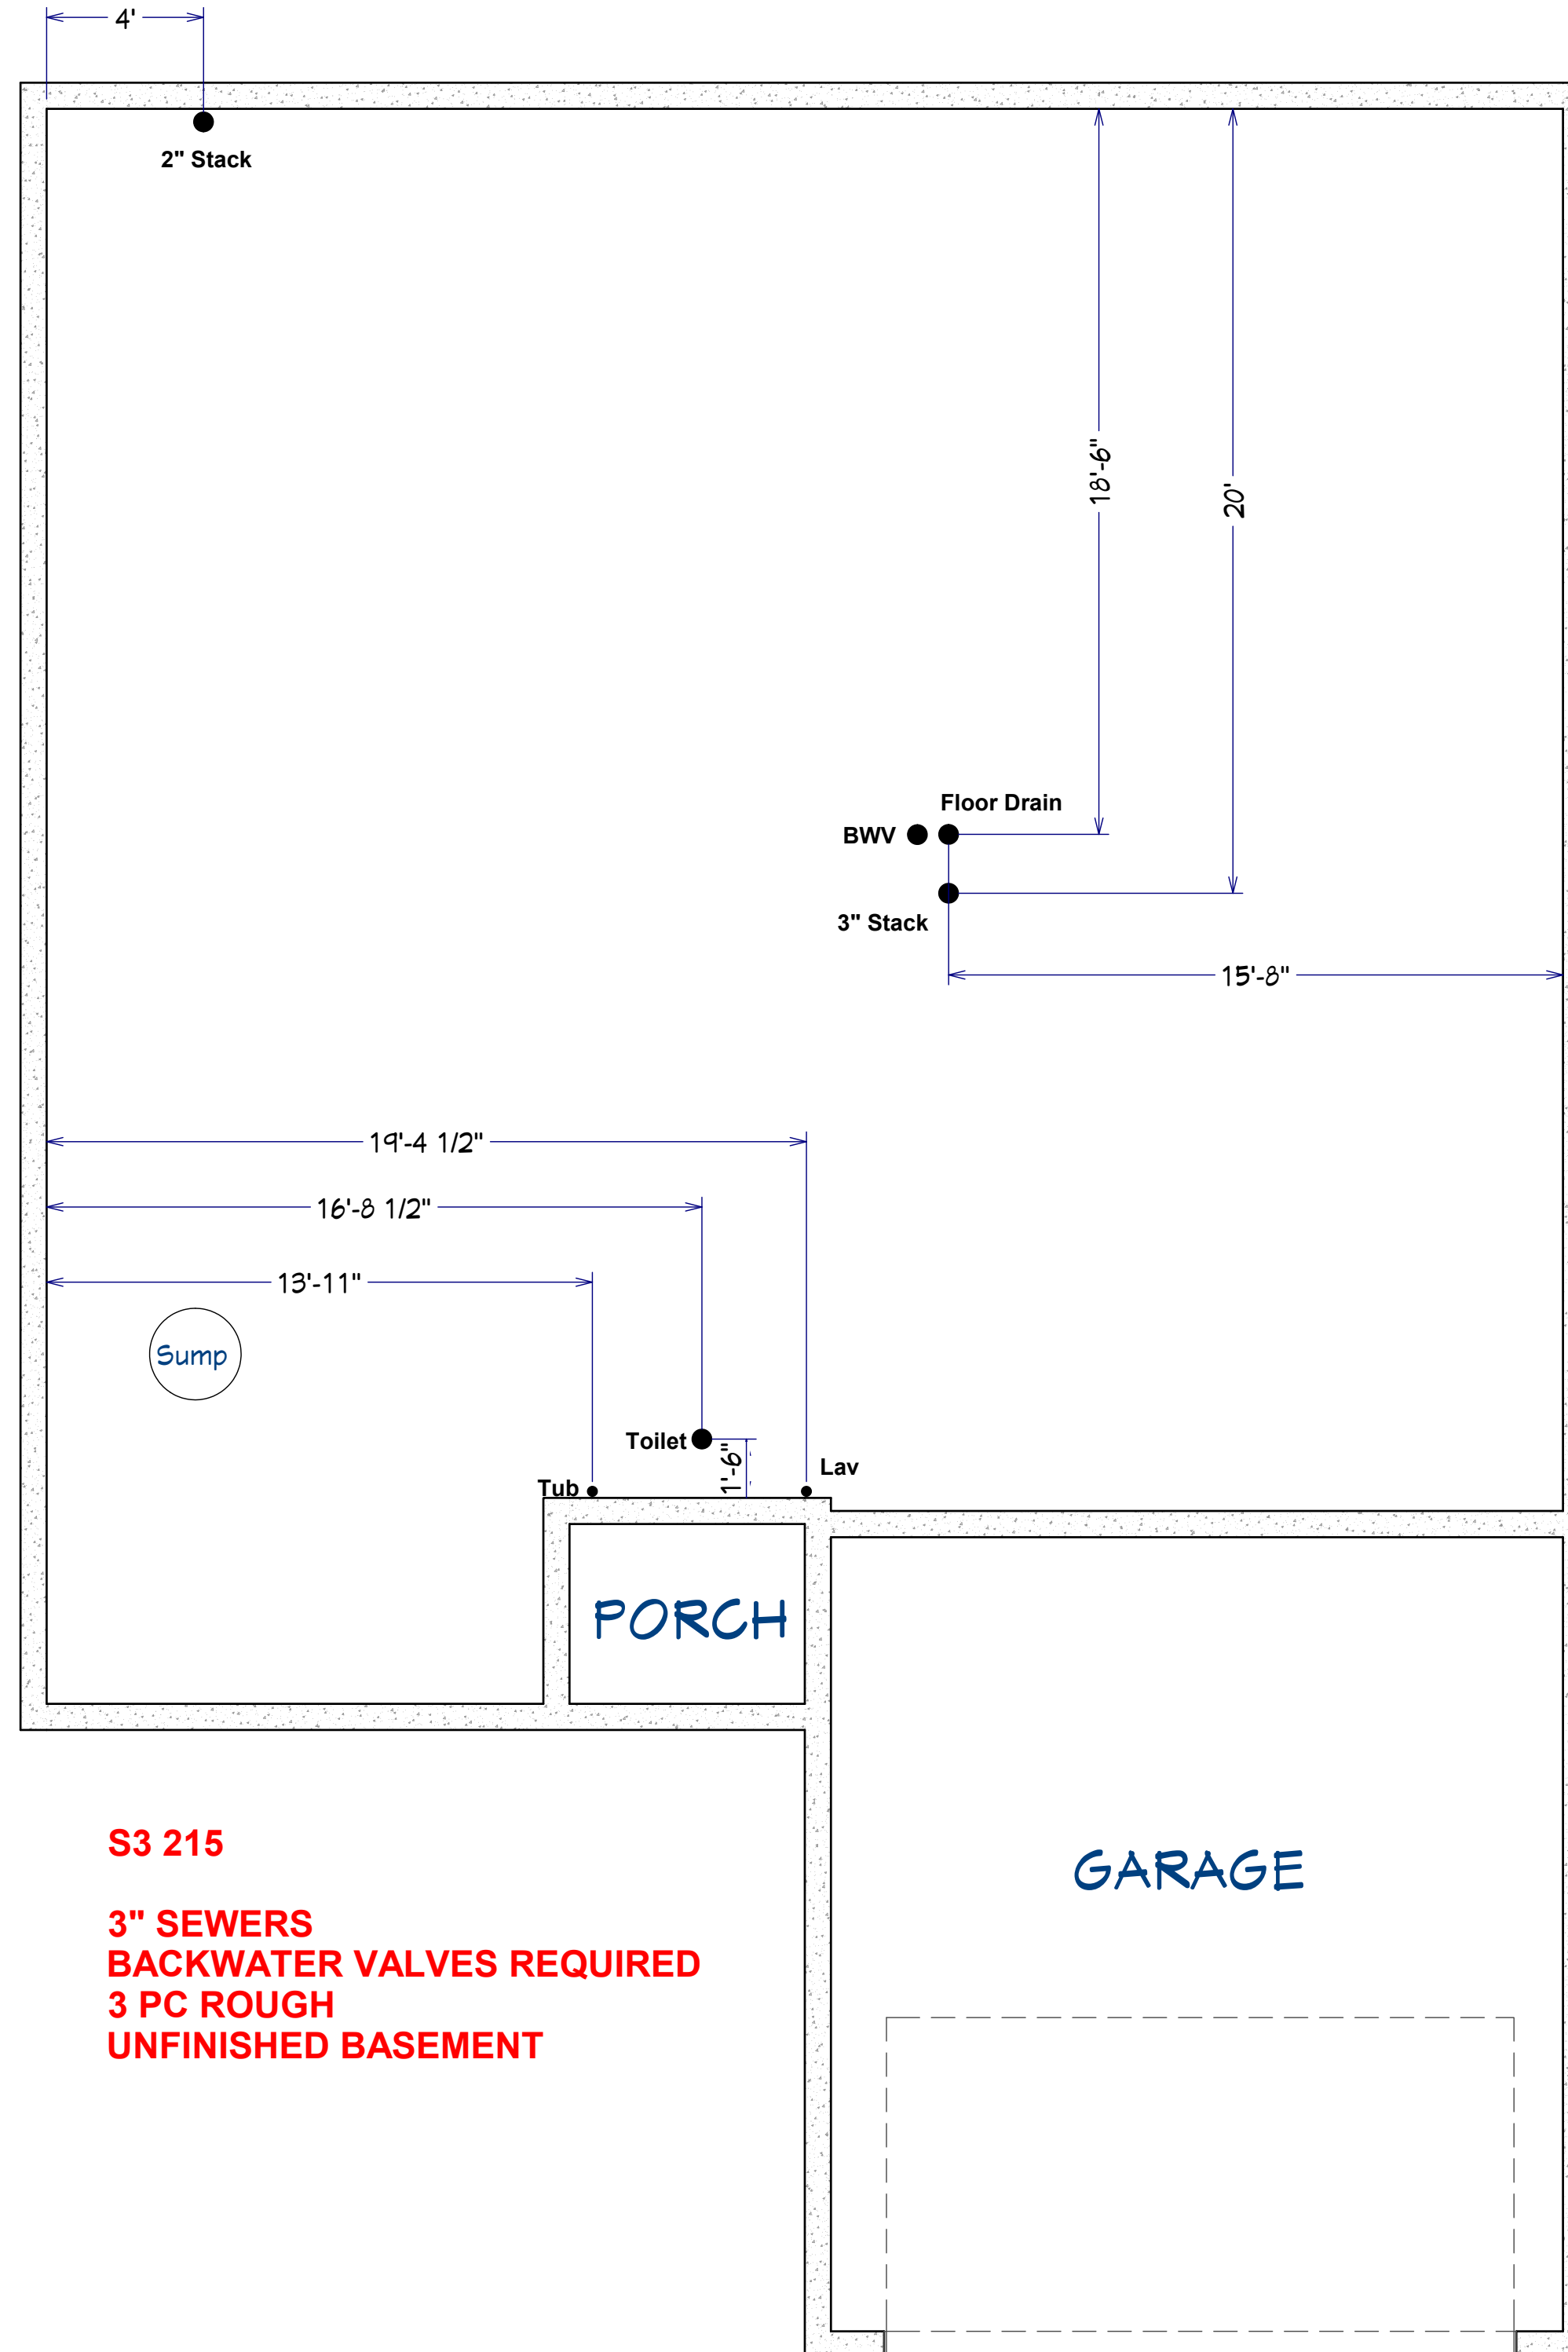

**S3 215**

**3" SEWERS  
BACKWATER VALVES REQUIRED  
3 PC ROUGH  
UNFINISHED BASEMENT**