


**NATE !
MAKE SURE SUMP INSTALLED
ALL PVC LINES ASIDE OF ONE 2" RISER CAPPED OFF !!**

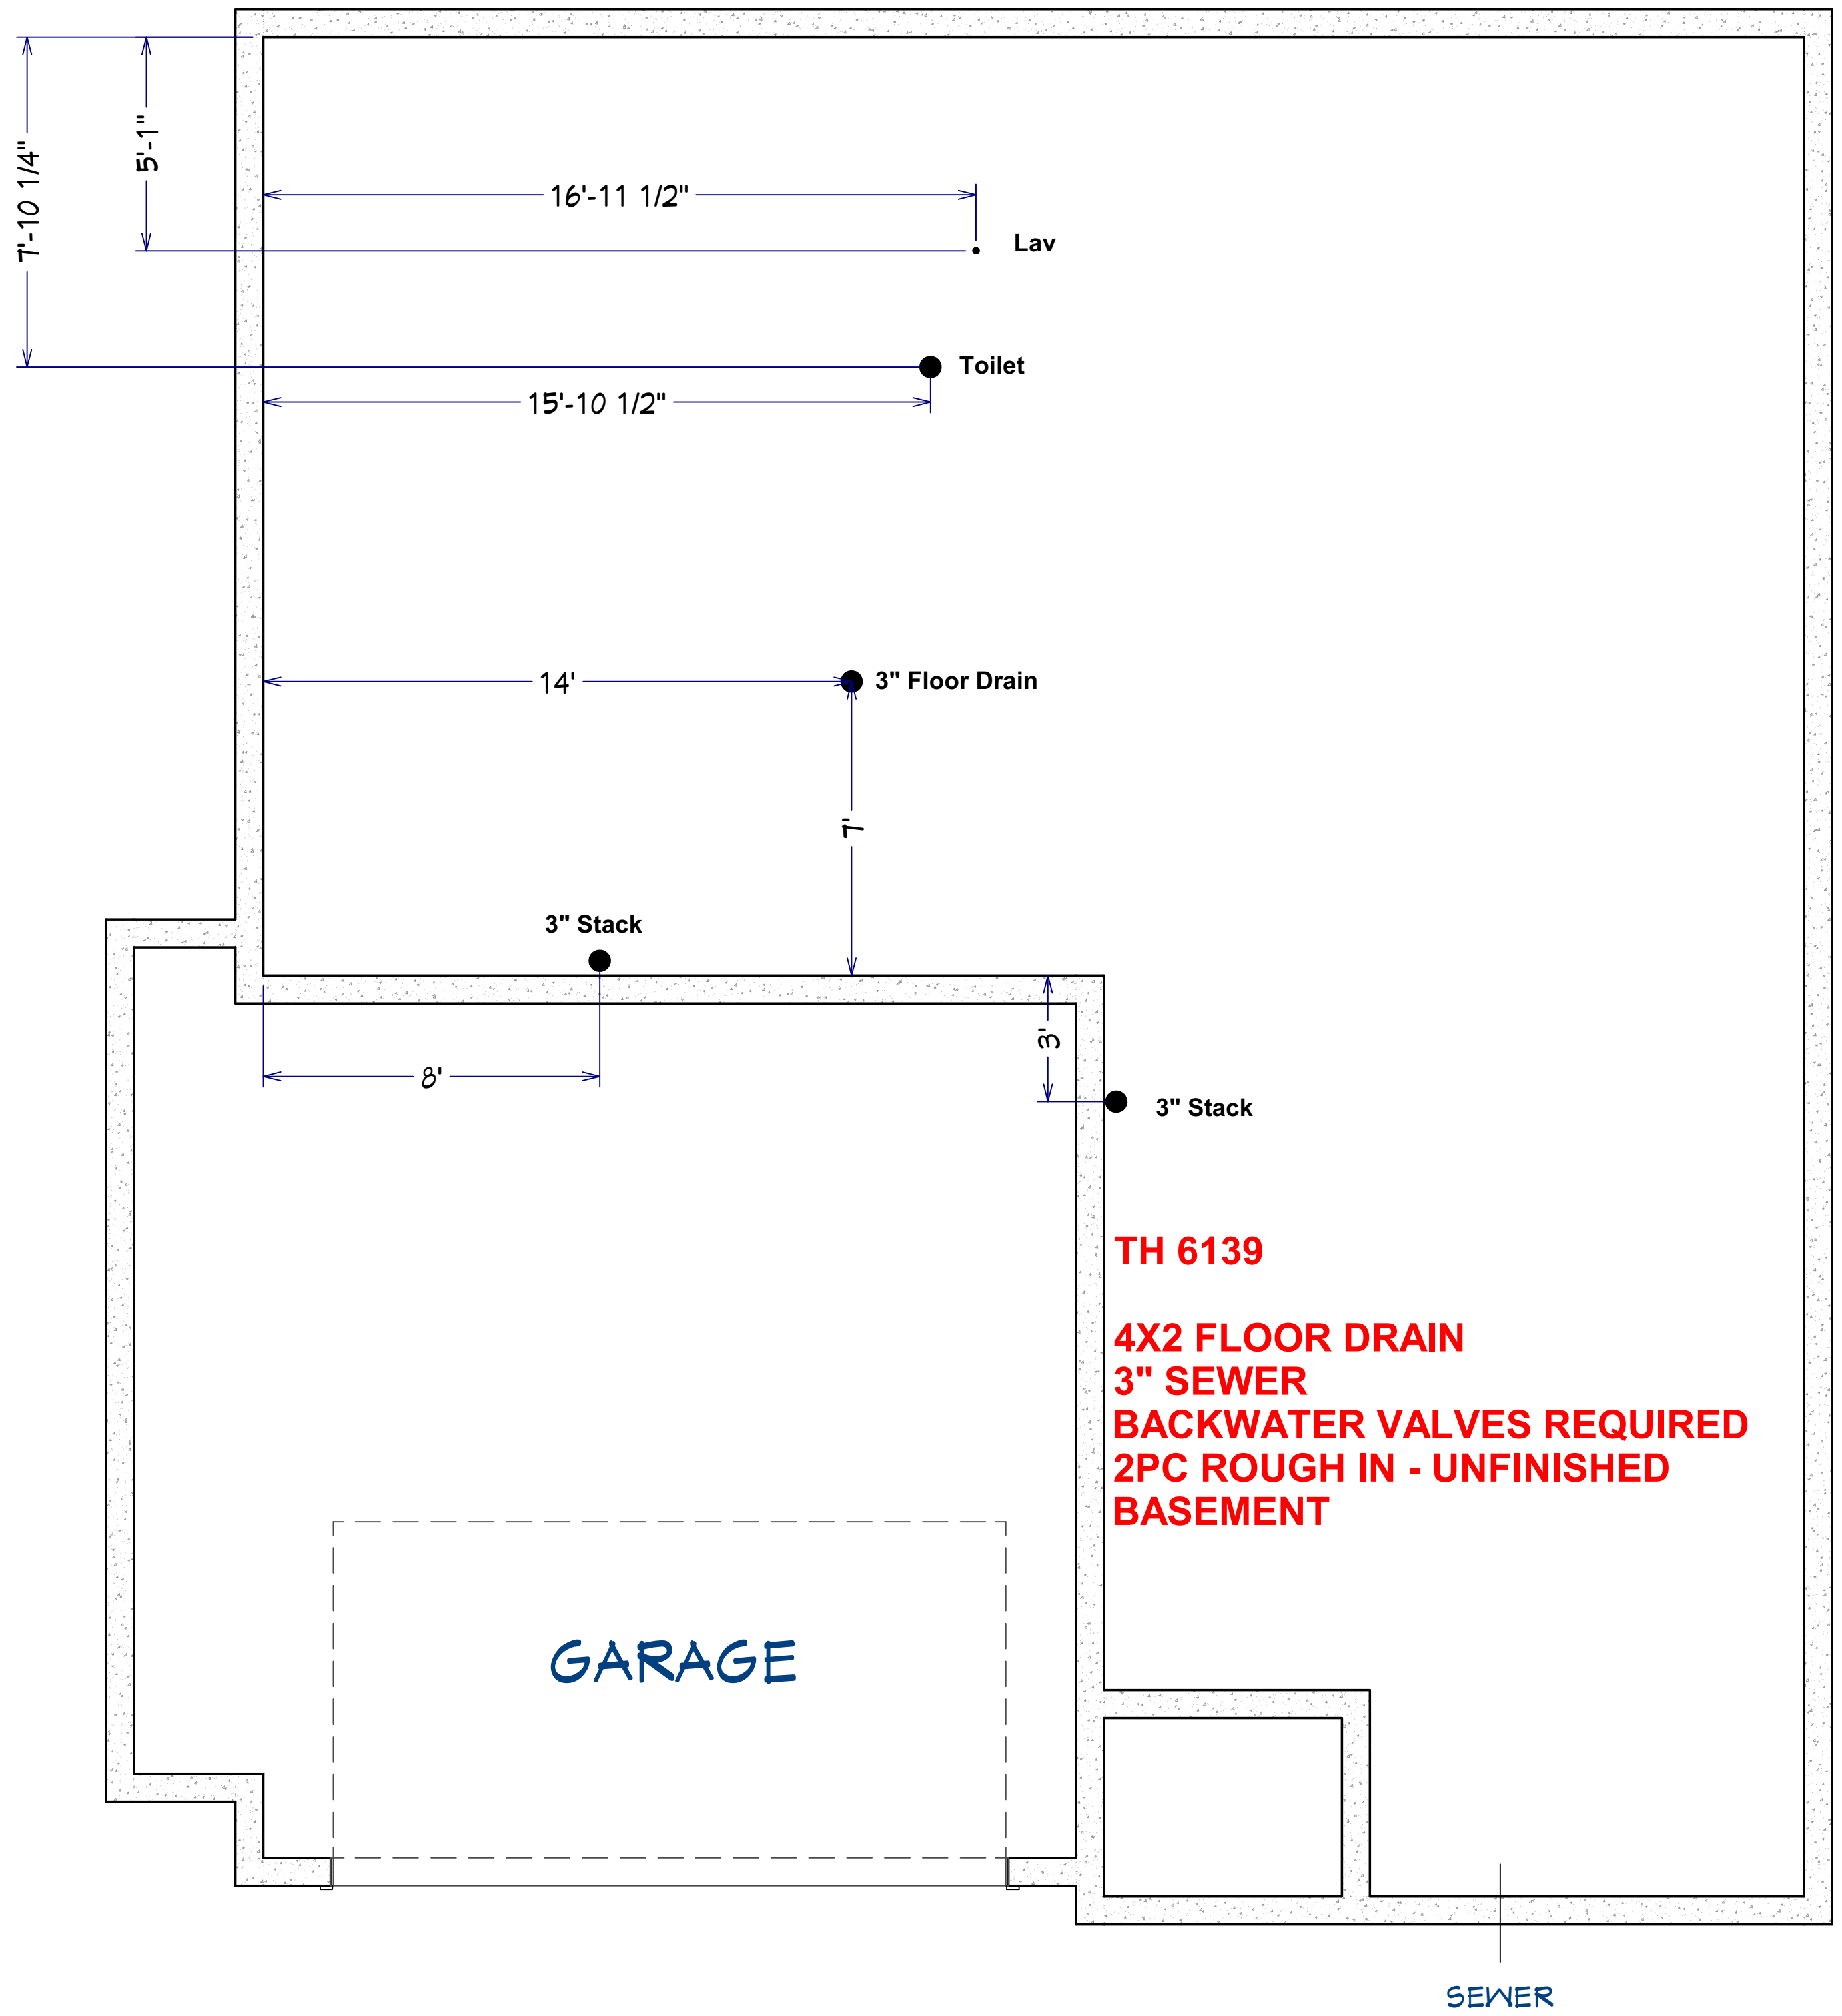

**TH 6139
4X2 FLOOR DRAIN
3" SEWER
BACKWATER VALVES REQUIRED
2PC ROUGH IN - UNFINISHED
BASEMENT**