NATE !

MAKE SURE SUMP INSTALLED
ALL PVC LINES ASIDE OF ONE 2" RISER CAPPED OFF !!

TR 2227
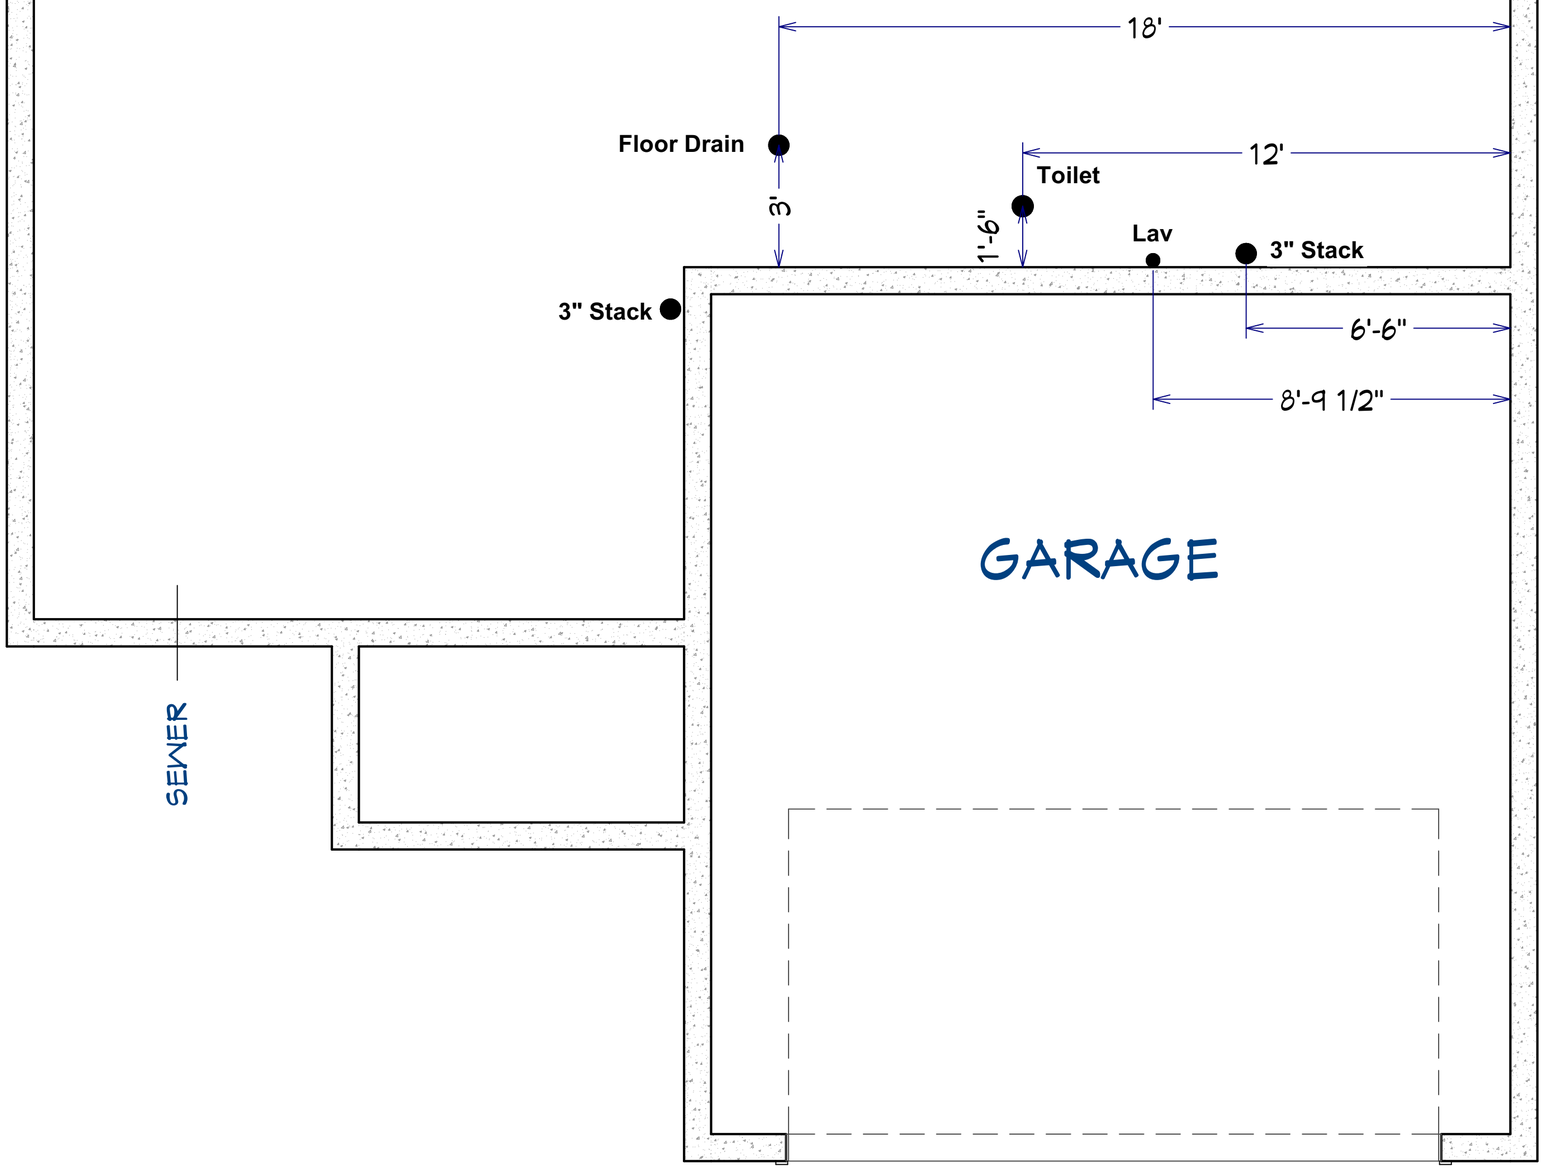
UNFINISHED BASEMENT
2 PC ROUGH
BACKWATER VALVES REQUIRED
3" SEWERS
4X2 FLOOR DRAIN